



State of Idaho

DEPARTMENT OF WATER RESOURCES

1301 North Orchard Street, P.O. Box 83720, Boise, Idaho 83720-0098

Phone: (208) 327-7900 FAX: (208) 327-7866

DIRK KEMPTHORNE
GOVERNOR

KARL J. DREHER
DIRECTOR

Date: August 31, 2004
To: Distribution List
From: Ed Hagan, IDWR Technical Hydrogeologist
Subject: Summary of year **2003** detections of concern
Statewide Ambient Ground Water Quality Monitoring Program

An Excel spreadsheet containing Statewide Program detections of concern, sorted by county and well location, along with figures showing the locations of sites where constituents of concern were detected are attached. The spreadsheet lists sites where a constituent was detected above a maximum contaminant level (MCL), or where volatile organic compounds (VOC), pesticides, or household products were detected at any concentration. All previous sample detections for the constituents exceeding an MCL are provided for historical perspective. VOCs and pesticides previously detected at a site also are included in the tables.

The Statewide Program collected samples from 398 sites during the summer of 2003. These sites include 28 new sites that were sampled for the first time. Detections of concern were found in samples from 106 sites. One or more constituents above an MCL (excluding radioactivity) were detected at 67 sites. Arsenic (49 sites), nitrate (11 sites), fecal coliform (8 sites), and fluoride (4 sites) were the constituents measured above their respective MCL.

Water samples from all sites were tested for inorganic compounds and field parameters (temperature, pH, specific conductance, dissolved oxygen, and alkalinity), and pesticides by immunoassay. Water samples from 49 wells were analyzed by the USGS for constituents commonly found in household and industrial wastewater including sex and steroidal hormones, topical disinfectants, cleaning chemicals, pesticides, and chlorinated solvents. Detections of these compounds are identified as household products on the legends of the attached maps. Phenol, an ingredient in disinfectants, antiseptics, and medicinal preparations such as mouthwash and throat lozenges, was detected in 37 of the 49 wells. The results from a site tested for household products are attached to show the constituents included in the analyses.

Water samples from only the new sites were analyzed for gross alpha and gross beta. Water samples from two of the new sites contained adjusted gross alpha activity¹ above the MCL of 15 pCi/L.

Arsenic speciation analyses were performed on samples with total arsenic levels over 10 µg/L. VOC analyses were limited to new sites and sites with previous VOC detections.

With the exception of adjusted gross alpha activity, notification was sent to the well owner when an existing MCL was exceeded. Otherwise, the well owner was notified of the detection at the time of mass notification (all data sent to well owners) in April 2003.

If you have questions regarding specific areas of the state, please contact the person associated with the area of responsibility shown on the attached figure.

¹ Total gross alpha activity can be determined by speciating the sample for uranium and radium and subtracting the results from the total gross alpha activity. Previous statewide program results indicate the adjusted alpha activity is approximately 69% of the total gross alpha activity. This factor was used to estimate an adjusted alpha activity.

Idaho Department of Water Resources
Statewide Ground Water Quality Monitoring Program

Sample Results

Site ID #####	Station Name #####	Sample Date & Time July 2, 2003 2:15 PM	Sample ID GWQM-2003-097
------------------	-----------------------	--	----------------------------

Well Data

County Canyon	Latitude 43.669444	Longitude -116.8225	Altitude 2420 ft
Water Use H		Well Depth 36 ft	Casing Depth 35 ft

Hormones by Immunoassay

ND ug/L Estradiol

Industrial and Household Wastewater Products

<0.5 ug/l 1,4-Dichlorobenzene	<0.5 ug/l 1-Methylnaphthalene	<0.5 ug/l 2,6-Dimethylnaphthalene
<0.5 ug/l 2-Methylnaphthalene	<1 ug/l 3-Methyl-1H-indole	<5 ug/l 3-tert-Butyl-4-hydroxyanisole
<1 ug/l 4-Cumylphenol	<5 ug/l 4-Nonylphenol	<1 ug/l 4-Octylphenol
<1 ug/l 4-tert-Octylphenol	<2 ug/l 5-Methyl-1H-benzotriazole	<1 ug/l 62091
<0.5 ug/l 9,10-Anthraquinone	<0.5 ug/l Acetophenone	<0.5 ug/l Acetyl hexamethyl tetrahydro naphthalene
<0.5 ug/l Anthracene	<0.5 ug/l Benzo[a]pyrene	<0.5 ug/l Benzophenone
<1 ug/l Bisphenol A	<0.5 ug/l Bromacil	<0.5 ug/l Caffeine
<0.5 ug/l Camphor	<1 ug/l Carbaryl	<0.5 ug/l Carbazole
<0.5 ug/l Chlorpyrifos	<1 ug/l Cotinine	<0.5 ug/l DEET
<0.5 ug/l Diazinon	<1 ug/l Dichlorvos	<5 ug/l Diethoxynonylphenol
<1 ug/l Diethoxyoctylphenol	<0.5 ug/l D-Limonene	<1 ug/l Ethoxyoctylphenol
<0.5 ug/l Fluoranthene	<0.5 ug/l Hexahydrohexamethyl cyclopentabenzopyran	<0.5 ug/l Indole
<0.5 ug/l Isoborneol	<0.5 ug/l Isophorone	<0.5 ug/l Isopropylbenzene
<0.5 ug/l Isoquinoline	<0.5 ug/l Menthol	<0.5 ug/l Metalaxyl
<0.5 ug/l Methyl salicylate	<0.5 ug/l Metolachlor	<0.5 ug/l Naphthalene
<1 ug/l p-Cresol	<2 ug/l Pentachlorophenol	<0.5 ug/l Phenanthrene
E0.47 ug/l Phenol	<0.5 ug/l Prometon	<0.5 ug/l Pyrene
<0.5 ug/l Tetrachloroethene	<0.5 ug/l Tribromomethane	<0.5 ug/l Tributyl phosphate
<0.5 ug/l Triethyl citrate	<0.5 ug/l Triphenyl phosphate	<0.5 ug/l Tris(2-butoxyethyl) phosphate
<0.5 ug/l Tris(2-chloroethyl) phosphate	<0.5 ug/l Tris(dichloroisopropyl) phosphate	

Inorganics and Field Analysis

26 °C Air Temperature	299 mg/L Alkalinity	<0.04 mg/L Ammonia
25.5 ug/L Arsenate	28 ug/L Arsenic MCL 10 ug/L EXCEEDED	<0.1 ug/L Arsenite
47.6 ug/L Barium	365 mg/L Bicarbonate	<0.037 ug/L Cadmium
41.7 mg/L Calcium	0 mg/L Carbonate	8.99 mg/L Chloride
<0.1 ug/L Disodium Methyl Arsonate	6.5 mg/L Dissolved Oxygen	<1 col/100 ml Fecal Coliform
0.63 mg/L Fluoride	240 mg/L Hardness	<8 ug/L Iron
33.4 mg/L Magnesium	0.7 ug/L Manganese	<0.1 ug/L Monosodium Methyl Arsonate
7.38 mg/L Nitrate	<0.008 mg/L Nitrite	7.5 pH
<0.09 mg/L Phosphorus	2.8 mg/L Potassium	1.75 ug/L Selenium
67 mg/L Silica	75.5 mg/L Sodium	0.67 t/af Solids
720 uS/cm Specific Conductance	53.2 mg/L Sulfate	14.2 °C Water Temperature

Pesticides by Immunoassay

0.10 ug/L Alachlor

ND ug/L Atrazine

ND ug/L Metolachlor

Sex and Steroidal Hormones


<2 ug/l 3-beta-Coprostanol

<2 ug/l beta-Sitosterol


<2 ug/l beta-Stigmastanol

<2 ug/l Cholesterol


Statewide Program Sites with MCL exceedance or detection of VOC, pesticide, or household product in 2003

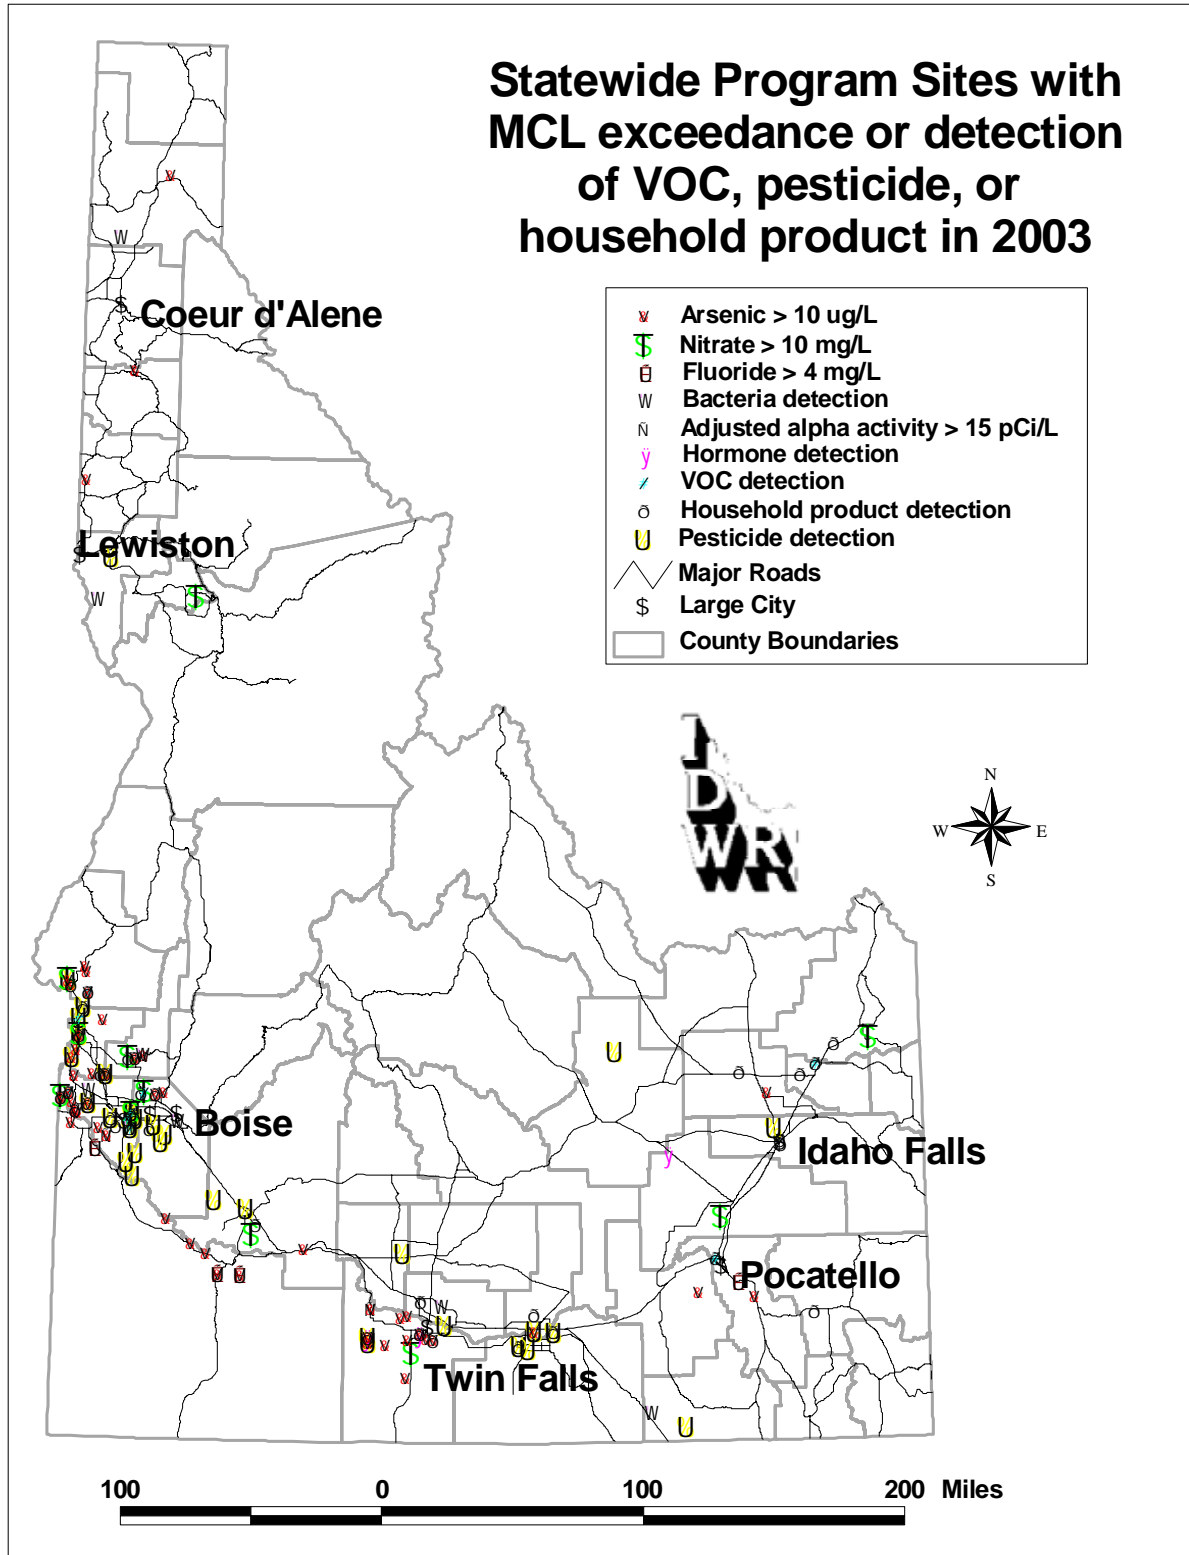


Statewide Program Detections of Concern Treasure Valley - 2003

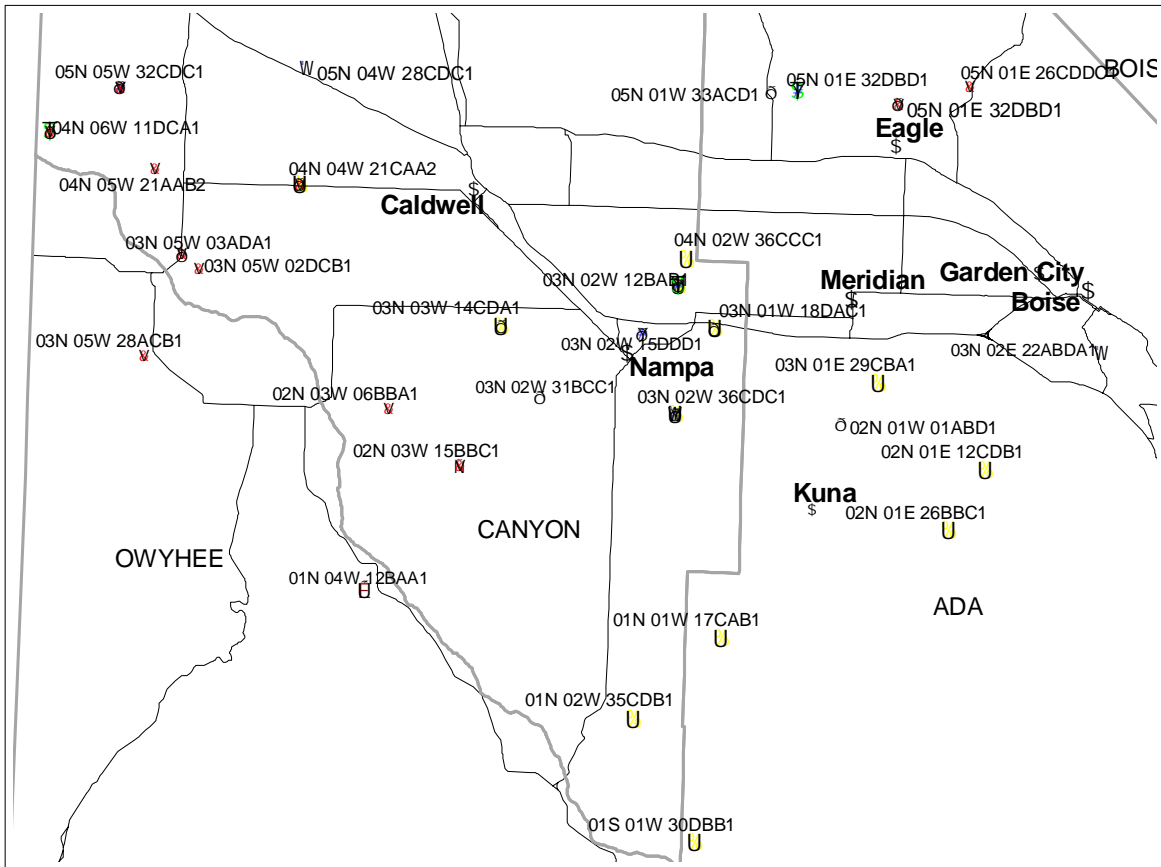


- v Arsenic > 10 ug/L
- \$ Nitrate > 10 mg/L
- B Fluoride > 4 mg/L
- W Bacteria detection
- N Adjusted alpha activity > 15 pCi/L
- Y Hormone detection
- Z VOC detection
- H Household product detection
- U Pesticide detection
- Major Roads
- \$ Large City
- County Boundaries




Statewide Program Detections of Concern Gem, Payette, Washington Counties - 2003

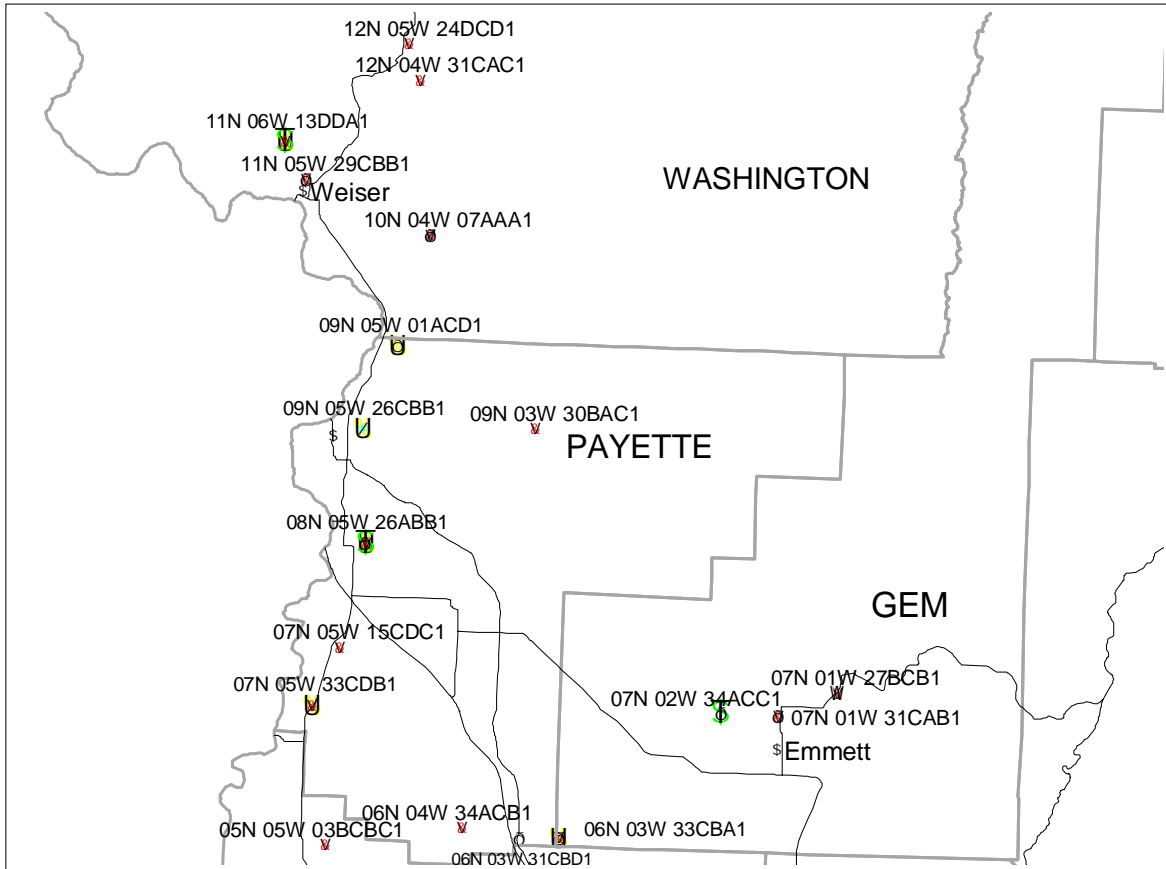

- ▼ Arsenic > 10 ug/L
- ⌘ Nitrate > 10 mg/L
- Fluoride > 4 mg/L
- W Bacteria detection
- N Adjusted alpha activity > 15 pCi/L
- ▼ Hormone detection
- ▼ VOC detection
- H Household product detection
- U Pesticide detection
- Major Roads
- \$ Large City
- County Boundaries




Statewide Program Detections of Concern Magic Valley - 2003

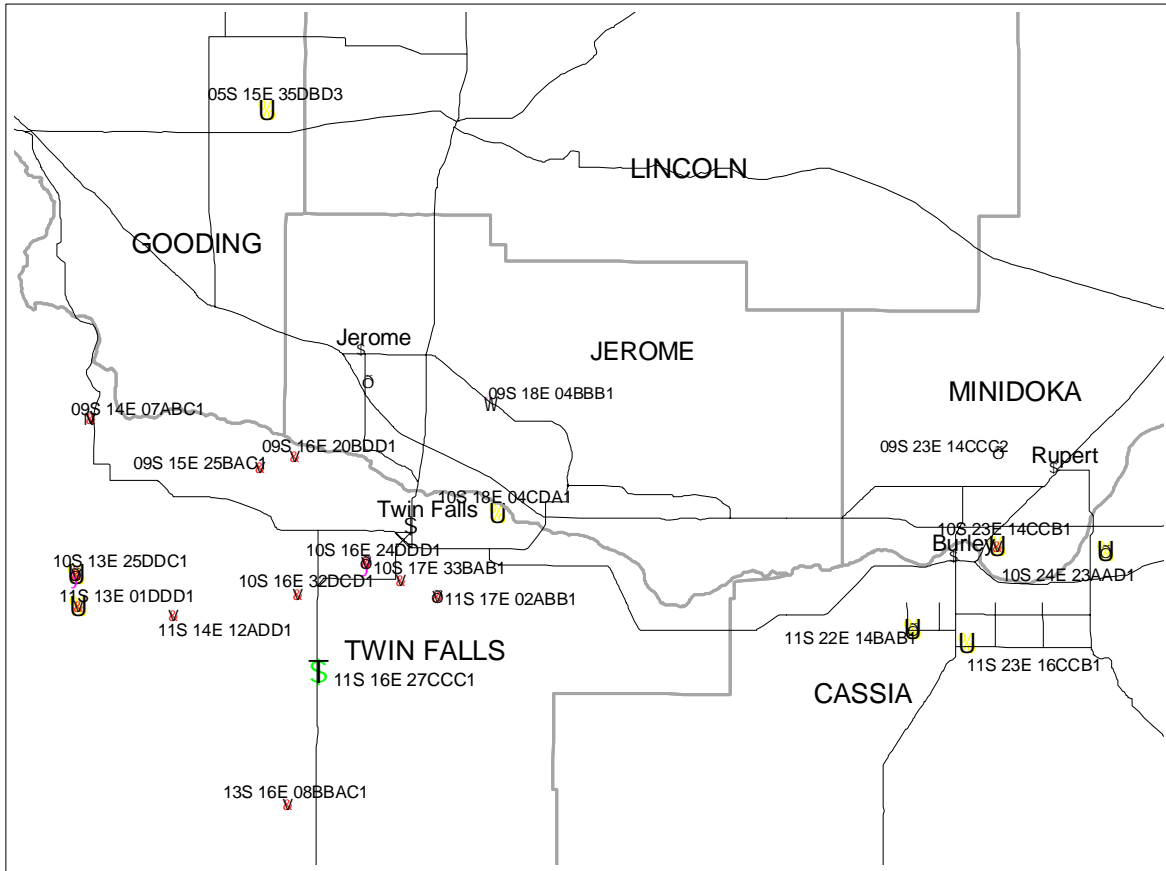


10 0 10 20 Miles



- ⚡ Arsenic > 10 ug/L
- Ⓢ Nitrate > 10 mg/L
- ⊖ Fluoride > 4 mg/L
- ⊖ Bacteria detection
- ⊖ Adjusted alpha activity > 15 pCi/L
- ⚡ Hormone detection
- ⚡ VOC detection
- ⊖ Household product detection
- Ⓢ Pesticide detection
- ⚡ Major Roads
- Ⓢ Large City
- ⊖ County Boundaries




Statewide Program Detections of Concern Pocatello Area - 2003

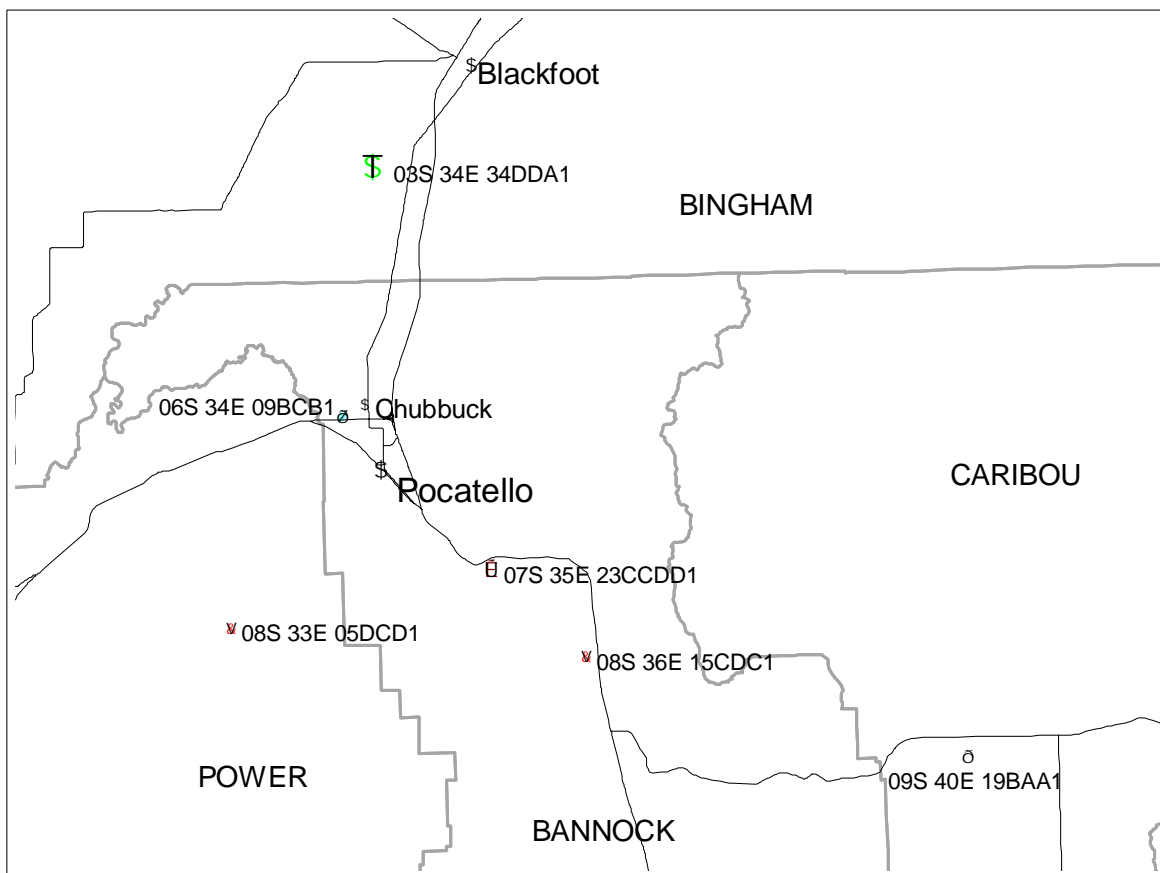


10 0 10 20 Miles




- ▼ Arsenic > 10 ug/L
- ⌘ Nitrate > 10 mg/L
- ⊞ Fluoride > 4 mg/L
- W Bacteria detection
- ⊞ Adjusted alpha activity > 15 pCi/L
- ⌘ Hormone detection
- ⌘ VOC detection
- Household product detection
- U Pesticide detection
- ⌘ Major Roads
- \$ Large City
- County Boundaries



Statewide Program Detections of Concern Idaho Falls Area - 2003

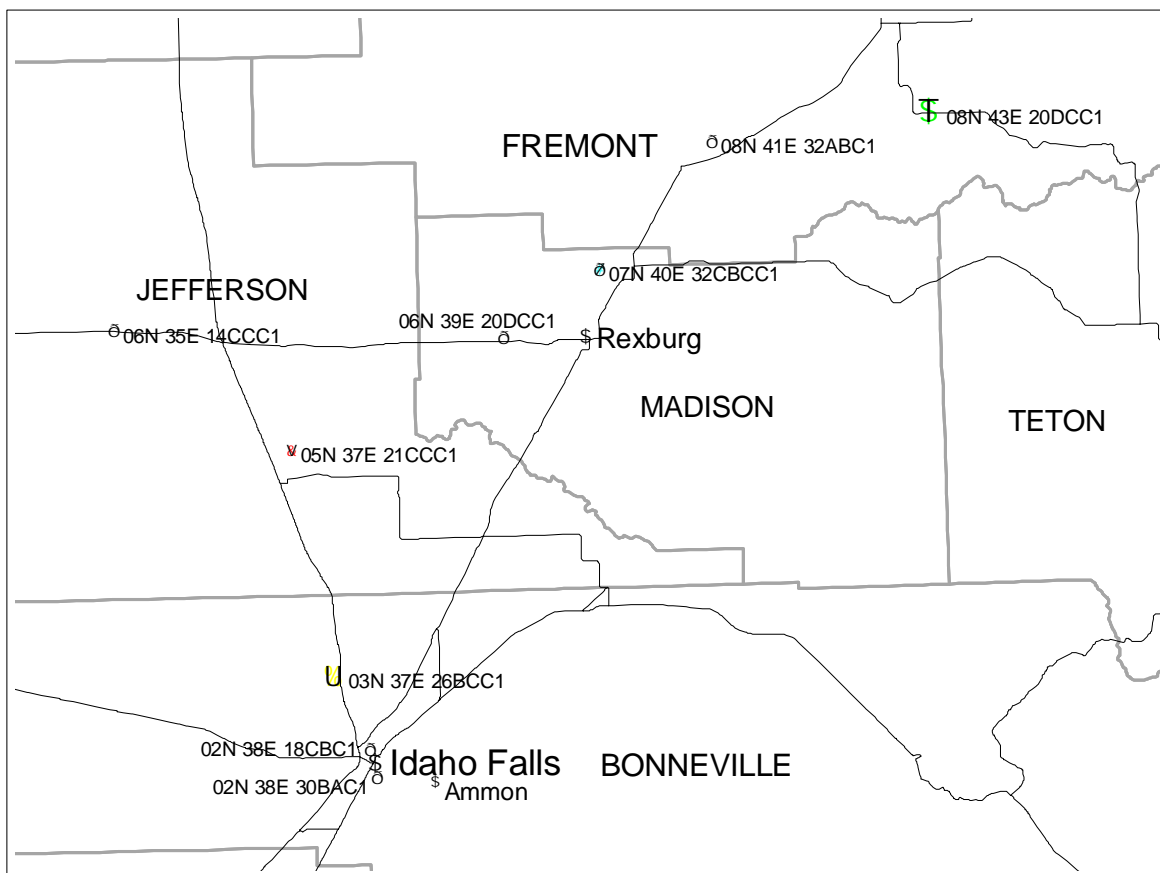


- ▼ Arsenic > 10 ug/L
- § Nitrate > 10 mg/L
- ⊖ Fluoride > 4 mg/L
- ⊖ Bacteria detection
- ⊖ Adjusted alpha activity > 15 pCi/L
- ⊖ Hormone detection
- ⊖ VOC detection
- Household product detection
- U Pesticide detection
- Major Roads
- \$ Large City
- County Boundaries



Areas of Responsibility for Ground Water Quality Questions and Issues

November, 2001

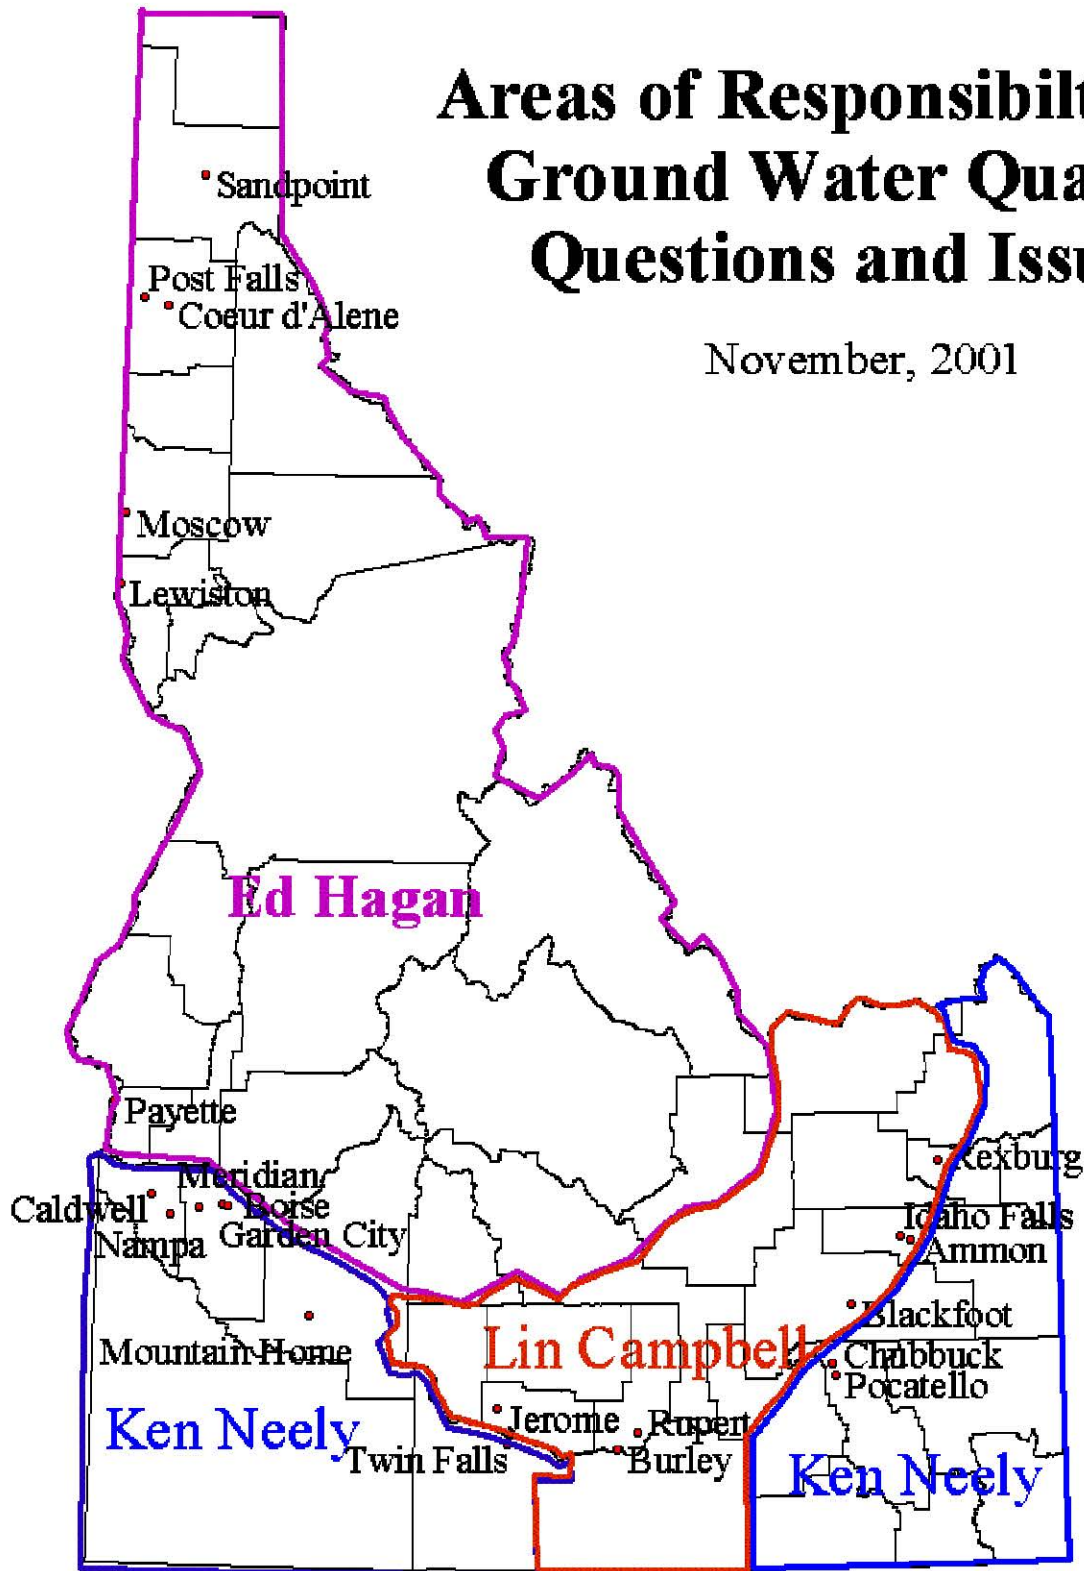

Station	County	Water Use	YrCode	Sample Date	Method	Detection of Concern	value	units	MCL
01N 01W 17CAB1	Ada	Domestic	Reg	26-Jun-03	Immunoassay	Alachlor	0.08	ug/L	2
01N 01W 17CAB1				21-Jul-98	Immunoassay	Alachlor	ND	ug/L	2
01N 01W 17CAB1				16-Aug-94	Immunoassay	Alachlor	ND	ug/L	2
01S 01W 30DBB1	Ada	Domestic	Reg	02-Jul-03	Immunoassay	Alachlor	0.06	ug/L	2
01S 01W 30DBB1				02-Jul-03	Immunoassay	Atrazine	0.1	ug/L	3
01S 01W 30DBB1				20-Jul-98	Immunoassay	Alachlor	ND	ug/L	2
01S 01W 30DBB1				20-Jul-98	Immunoassay	Atrazine	ND	ug/L	3
01S 01W 30DBB1				23-Aug-94	Immunoassay	Alachlor	ND	ug/L	2
01S 01W 30DBB1				23-Aug-94	Immunoassay	Atrazine	ND	ug/L	3
02N 01E 12CDB1	Ada	Domestic	Reg	26-Aug-03	Immunoassay	Atrazine	0.06	ug/L	3
02N 01E 12CDB1				13-Jul-98	GC - USGS	Atrazine	0.05	ug/L	3
02N 01E 12CDB1				13-Jul-98	Immunoassay	Atrazine	0.06	ug/L	3
02N 01E 12CDB1				13-Jul-98	GC - USGS	Atrazine, desethyl	0.04	ug/L	NE
02N 01E 12CDB1				13-Jul-98	GC - USGS	Simazine	0.03	ug/L	4
02N 01E 12CDB1				24-Aug-94	Immunoassay	Atrazine	0.09	ug/L	3
02N 01E 26BBC1	Ada	Domestic	Reg	09-Jul-03	Immunoassay	Atrazine	0.15	ug/L	3
02N 01E 26BBC1				13-Jul-98	Rad Chem	Adjusted Alpha Activity	18.5	pCi/L	15
02N 01E 26BBC1				13-Jul-98	Immunoassay	Atrazine	0.08	ug/L	3
02N 01E 26BBC1				13-Jul-98	GC - USGS	Atrazine	0.08	ug/L	3
02N 01E 26BBC1				13-Jul-98	GC - USGS	Atrazine, desethyl	0.05	ug/L	NE
02N 01E 26BBC1				18-Aug-94	Immunoassay	Atrazine	0.12	ug/L	3
02N 01W 01ABD1	Ada	Domestic	Annual	20-Aug-03	GCMS - USGS	1,4-Dichlorobenzene	0.1	ug/l	75
02N 01W 01ABD1				20-Aug-03	GCMS - USGS	Phenol	1.6	ug/l	NE
02N 01W 01ABD1				26-Jun-01	Immunoassay	Atrazine	0.08	ug/L	3
02N 01W 01ABD1				26-Jun-01	GC - Alpha Analytical	Dichlorobenzene,1,4-	ND	ug/L	75
02N 01W 01ABD1				20-Jun-00	Immunoassay	Atrazine	0.07	ug/L	3
02N 01W 01ABD1				21-Jul-99	Immunoassay	Atrazine	0.08	ug/L	3
02N 01W 01ABD1				21-Jul-99	GC - Alpha Analytical	Dichlorobenzene,1,4-	ND	ug/L	75
02N 01W 01ABD1				14-Jul-98	Rad Chem	Adjusted Alpha Activity	23.9	pCi/L	15
02N 01W 01ABD1				14-Jul-98	Immunoassay	Atrazine	0.08	ug/L	3
02N 01W 01ABD1				14-Jul-98	GC - USGS	Atrazine	0.073	ug/L	3
02N 01W 01ABD1				14-Jul-98	GC - USGS	Atrazine, desethyl	0.07	ug/L	NE
02N 01W 01ABD1				14-Jul-98	GC - Alpha Analytical	Dichlorobenzene,1,4-	ND	ug/L	75
02N 01W 01ABD1				14-Jul-98	Immunoassay	Simazine	0.04	ug/L	4
02N 01W 01ABD1				04-Aug-97	GC - USGS	Atrazine	0.0681	ug/L	3
02N 01W 01ABD1				04-Aug-97	Immunoassay	Atrazine	0.052	ug/L	3
02N 01W 01ABD1				04-Aug-97	GC - USGS	Atrazine, desethyl	0.0401	ug/L	NE
02N 01W 01ABD1				04-Aug-97	GC - Alpha Analytical	Dichlorobenzene,1,4-	ND	ug/L	75

Station	County	Water Use	YrCode	Sample Date	Method	Detection of Concern	value	units	MCL
02N 01W 01ABD1				04-Aug-97	GC - USGS	Simazine	0.005	ug/L	4
02N 01W 01ABD1				16-Jul-96	Immunoassay	Atrazine	0.19	ug/L	3
02N 01W 01ABD1				16-Jul-96	GC - USGS	Atrazine	0.059	ug/L	3
02N 01W 01ABD1				16-Jul-96	GC - USGS	Atrazine, desethyl	0.051	ug/L	NE
02N 01W 01ABD1				16-Jul-96	GC - Alpha Analytical	Dichlorobenzene,1,4-	ND	ug/L	75
02N 01W 01ABD1				16-Jul-96	GC - USGS	Simazine	0.005	ug/L	4
02N 01W 01ABD1				23-Aug-95	GC - USGS	Atrazine	0.04	ug/L	3
02N 01W 01ABD1				23-Aug-95	Immunoassay	Atrazine	0.12	ug/L	3
02N 01W 01ABD1				23-Aug-95	GC - USGS	Atrazine, desethyl	0.033	ug/L	NE
03N 01E 29CBA1	Ada	Domestic	Reg	29-Aug-03	Immunoassay	Atrazine	0.25	ug/L	3
03N 01E 29CBA1				09-Jul-98	Rad Chem	Adjusted Alpha Activity	21.4	pCi/L	15
03N 01E 29CBA1				09-Jul-98	GC - USGS	Atrazine	0.096	ug/L	3
03N 01E 29CBA1				09-Jul-98	Immunoassay	Atrazine	0.27	ug/L	3
03N 01E 29CBA1				18-Jul-94	Rad Chem	Adjusted Alpha Activity	18.6	pCi/L	15
03N 01E 29CBA1				18-Jul-94	Immunoassay	Atrazine	0.1	ug/L	3
03N 01E 29CBA1				18-Jul-94	Rad Chem	Uranium	33	pCi/L	30
03N 01E 29CBA1				09-Jul-98	GC - USGS	Atrazine, desethyl	0.1	ug/L	NE
03N 02E 22ABDA1	Ada	Irrigation	Annual	28-Aug-03	USGS ONSITE	Fecal Coliform	7	col/100 ml	0
03N 02E 22ABDA1				05-Sep-02	USGS ONSITE	Fecal Coliform	0	col/100 ml	0
03N 02E 22ABDA1				19-Jul-01	USGS ONSITE	Fecal Coliform	0	col/100 ml	0
03N 02E 22ABDA1				24-Jul-00	USGS ONSITE	Fecal Coliform	0	col/100 ml	0
03N 02E 22ABDA1				01-Sep-99	USGS ONSITE	Fecal Coliform	0	col/100 ml	0
03N 02E 22ABDA1				14-Jul-98	USGS ONSITE	Fecal Coliform	0	col/100 ml	0
03N 02E 22ABDA1				13-Aug-97	USGS ONSITE	Fecal Coliform	0	col/100 ml	0
03N 02E 22ABDA1				15-Jul-96	USGS ONSITE	Fecal Coliform	0	col/100 ml	0
03N 02E 22ABDA1				14-Jul-94	USGS ONSITE	Fecal Coliform	0	col/100 ml	0
05N 01E 26CDDC1	Ada	Domestic	Reg	11-Jul-03	USGS Trace Element	Arsenic	22	ug/L	10
05N 01E 26CDDC1				01-Jul-98	USGS Trace Element	Arsenic	20	ug/L	10
05N 01E 26CDDC1				25-Jul-94	USGS Trace Element	Arsenic	20	ug/L	10
05N 01E 32DBD1	Ada	Domestic	Annual	13-Aug-03	USGS Trace Element	Arsenic	10.6	ug/L	10
05N 01E 32DBD1				13-Aug-03	GCMS - USGS	Phenol	0.4	ug/l	
05N 01E 32DBD1				24-Jun-02	USGS Trace Element	Arsenic	10.9	ug/L	10
05N 01E 32DBD1				16-Jul-01	USGS Trace Element	Arsenic	10.3	ug/L	10
05N 01E 32DBD1				01-Aug-00	USGS Trace Element	Arsenic	11.2	ug/L	10
05N 01E 32DBD1				26-Aug-99	USGS Trace Element	Arsenic	12	ug/L	10
05N 01E 32DBD1				26-Aug-99	GC - USGS	Atrazine	0.035	ug/L	3
05N 01E 32DBD1				26-Aug-99	GC - USGS	Atrazine, desethyl	0.018	ug/L	NE
05N 01E 32DBD1				26-Aug-99	GC - USGS	Sevin	0.003	ug/L	NE

Station	County	Water Use	YrCode	Sample Date	Method	Detection of Concern	value	units	MCL
05N 01E 32DBD1				01-Jul-98	USGS Trace Element	Arsenic	11	ug/L	10
05N 01E 32DBD1				01-Jul-98	GC - USGS	Atrazine	0.035	ug/L	3
05N 01E 32DBD1				01-Jul-98	Immunoassay	Atrazine	0.05	ug/L	3
05N 01E 32DBD1				01-Jul-98	GC - USGS	Atrazine, desethyl	0.03	ug/L	NE
05N 01E 32DBD1				22-Jul-97	USGS Trace Element	Arsenic	11	ug/L	10
05N 01E 32DBD1				22-Jul-97	GC - USGS	Atrazine	0.0407	ug/L	3
05N 01E 32DBD1				22-Jul-97	GC - USGS	Atrazine, desethyl	0.0178	ug/L	NE
05N 01E 32DBD1				22-Jul-97	GC - USGS	Simazine	0.003	ug/L	4
05N 01E 32DBD1				01-Aug-96	USGS Trace Element	Arsenic	12	ug/L	10
05N 01E 32DBD1				01-Aug-96	Immunoassay	Atrazine	0.06	ug/L	3
05N 01E 32DBD1				01-Aug-96	GC - USGS	Atrazine	0.0562	ug/L	3
05N 01E 32DBD1				01-Aug-96	GC - USGS	Atrazine, desethyl	0.0276	ug/L	NE
05N 01E 32DBD1				01-Aug-96	GC - USGS	Chloropyrifos	0.0038	ug/L	NE
05N 01E 32DBD1				01-Aug-96	GC - USGS	Metolachlor	0.0039	ug/L	NE
05N 01E 32DBD1				01-Aug-96	GC - USGS	Simazine	0.005	ug/L	4
05N 01E 32DBD1				07-Aug-95	USGS Trace Element	Arsenic	10	ug/L	10
05N 01E 32DBD1				07-Aug-95	GC - USGS	Atrazine	0.064	ug/L	3
05N 01E 32DBD1				07-Aug-95	Immunoassay	Atrazine	0.13	ug/L	3
05N 01E 32DBD1				07-Aug-95	GC - USGS	Atrazine, desethyl	0.042	ug/L	NE
05N 01E 32DBD1				05-Aug-94	USGS Trace Element	Arsenic	13	ug/L	10
05N 01E 32DBD1				05-Aug-94	Immunoassay	Atrazine	0.23	ug/L	3
05N 01W 33ACD1	Ada	Domestic	Reg	07-Jul-03	GCMS - USGS	Phenol	0.4	ug/l	NE
05N 01W 34ACAC1	Ada	Domestic	New	07-Jul-03	USGS NUTRIENTS	Nitrate	12.9	mg/L	10
05N 01W 34ACAC1				07-Jul-03	GC - Alpha Analytical	Trichloropropane,1,2,3-	1.83	ug/L	NE
06S 34E 09BCB1	Bannock	Domestic	Annual	04-Sep-03	GCMS - USGS	Phenol	0.54	ug/l	NE
06S 34E 09BCB1				04-Sep-03	GCMS - USGS	Tetrachloroethylene	0.5	ug/l	5
06S 34E 09BCB1				04-Sep-03	GCMS - USGS	Tris(2-butoxyethyl) phosphate	0.4	ug/l	NE
06S 34E 09BCB1				27-Aug-01	GC - Alpha Analytical	Tetrachloroethylene	1.18	ug/L	5
06S 34E 09BCB1				08-Aug-00	GC - Alpha Analytical	Tetrachloroethylene	1.04	ug/L	5
06S 34E 09BCB1				31-Aug-99	GC - USGS	Atrazine	0.011	ug/L	3
06S 34E 09BCB1				31-Aug-99	GC - USGS	Atrazine, desethyl	0.006	ug/L	NE
06S 34E 09BCB1				31-Aug-99	GC - USGS	Prometon	0.002	ug/L	NE
06S 34E 09BCB1				31-Aug-99	GC - USGS	Simazine	0.003	ug/L	4
06S 34E 09BCB1				31-Aug-99	GC - USGS	Tebuthiuron	0.002	ug/L	NE
06S 34E 09BCB1				31-Aug-99	GC - Alpha Analytical	Tetrachloroethylene	1.27	ug/L	5
06S 34E 09BCB1				12-Aug-98	GC - Alpha Analytical	Tetrachloroethylene	1.53	ug/L	5
06S 34E 09BCB1				16-Jun-97	GC - Alpha Analytical	Tetrachloroethylene	1.79	ug/L	5
06S 34E 09BCB1				21-Jun-96	GC - Alpha Analytical	Tetrachloroethylene	2.14	ug/L	5
06S 34E 09BCB1				19-Aug-92	GC - Alpha Analytical	Tetrachloroethylene	2.3	ug/L	5

Station	County	Water Use	YrCode	Sample Date	Method	Detection of Concern	value	units	MCL
07S 35E 23CCDD1	Bannock	Domestic	Reg	05-Sep-03	USGS Common Ion	Fluoride	4.14	mg/L	4
07S 35E 23CCDD1				29-Jul-98	USGS Common Ion	Fluoride	3.6	mg/L	4
07S 35E 23CCDD1				15-Jul-94	USGS Common Ion	Fluoride	1.8	mg/L	4
08S 36E 15CDC1	Bannock	Domestic	Annual	02-Sep-03	USGS Trace Element	Arsenic	40.6	ug/L	10
08S 36E 15CDC1				25-Jul-02	USGS Trace Element	Arsenic	41.7	ug/L	10
08S 36E 15CDC1				25-Jul-02	USGS ONSITE	Fecal Coliform	1	col/100 ml	0
08S 36E 15CDC1				07-Sep-01	USGS Trace Element	Arsenic	38.3	ug/L	10
08S 36E 15CDC1				18-Jun-00	USGS Trace Element	Arsenic	44.5	ug/L	10
08S 36E 15CDC1				24-Jun-99	USGS Trace Element	Arsenic	45	ug/L	10
08S 36E 15CDC1				24-Jun-99	GC - USGS	Atrazine, desethyl	0.001	ug/L	NE
08S 36E 15CDC1				29-Jul-98	USGS Trace Element	Arsenic	42	ug/L	10
08S 36E 15CDC1				31-Jul-97	USGS Trace Element	Arsenic	40	ug/L	10
08S 36E 15CDC1				24-Jun-96	USGS Trace Element	Arsenic	45	ug/L	10
08S 36E 15CDC1				20-Aug-92	USGS Trace Element	Arsenic	41	ug/L	10
46N 03W 12BCB1	Benewah	Domestic	Reg	17-Jul-03	USGS Trace Element	Arsenic	16.3	ug/L	10
46N 03W 12BCB1				24-Jul-98	USGS Trace Element	Arsenic	15	ug/L	10
46N 03W 12BCB1				03-Aug-94	USGS Trace Element	Arsenic	15	ug/L	10
01N 31E 03CDD1	Bingham	Domestic	New	14-Oct-03	Immunoassay	Estradiol	3.02	ug/L	NE
03S 34E 34DDA1	Bingham	Domestic	Annual	27-Aug-03	USGS NUTRIENTS	Nitrate	10.8	mg/L	10
03S 34E 34DDA1				21-Aug-02	USGS NUTRIENTS	Nitrate	11.9	mg/L	10
03S 34E 34DDA1				06-Sep-01	USGS NUTRIENTS	Nitrate	11.9	mg/L	10
03S 34E 34DDA1				29-Jun-00	USGS NUTRIENTS	Nitrate	11.5	mg/L	10
03S 34E 34DDA1				29-Jul-99	USGS NUTRIENTS	Nitrate	10.9	mg/L	10
03S 34E 34DDA1				12-Aug-98	USGS NUTRIENTS	Nitrate	10.5	mg/L	10
03S 34E 34DDA1				20-Aug-97	USGS NUTRIENTS	Nitrate	10.7	mg/L	10
03S 34E 34DDA1				21-Aug-96	USGS NUTRIENTS	Nitrate	9.9	mg/L	10
03S 34E 34DDA1				06-Aug-93	USGS NUTRIENTS	Nitrate	6.1	mg/L	10
54N 04W 14CDC1	Bonner	Domestic	Reg	24-Jul-03	USGS ONSITE	Fecal Coliform	11	col/100 ml	0
54N 04W 14CDC1				06-Aug-98	USGS ONSITE	Fecal Coliform	ND	col/100 ml	0
54N 04W 14CDC1				26-Jul-94	USGS ONSITE	Fecal Coliform	ND	col/100 ml	0
58N 01W 34BAA1	Bonner	Domestic	Reg	01-Jul-03	USGS Trace Element	Arsenic	13.6	ug/L	10
58N 01W 34BAA1				24-Aug-99	USGS Trace Element	Arsenic	14	ug/L	10
58N 01W 34BAA1				27-Jul-94	USGS Trace Element	Arsenic	15	ug/L	10
02N 38E 18CBC1	Bonneville	Public	Annual	26-Aug-03	GCMS - USGS	Phenol	1	ug/l	NE

Station	County	Water Use	YrCode	Sample Date	Method	Detection of Concern	value	units	MCL
02N 38E 30BAC1	Bonneville	Public	Reg	26-Aug-03	GCMS - USGS	Phenol	1.9	ug/l	NE
03N 37E 26BCC1	Bonneville	Domestic	Reg	26-Aug-03	Immunoassay	Atrazine	0.25	ug/L	3
03N 37E 26BCC1				13-Aug-98	Immunoassay	Atrazine	ND	ug/L	3
03N 37E 26BCC1				15-Jul-94	Immunoassay	Atrazine	ND	ug/L	3
07N 27E 12AAB1	Butte	Irrigation	Reg	01-Jul-03	Immunoassay	Atrazine	0.15	ug/L	3
07N 27E 12AAB1				02-Sep-99	Immunoassay	Atrazine	ND	ug/L	3
07N 27E 12AAB1				21-Sep-94	Immunoassay	Atrazine	ND	ug/L	3
01N 02W 35CDB1	Canyon	Domestic	Reg	26-Jun-03	Immunoassay	Alachlor	0.07	ug/L	2
01N 02W 35CDB1				07-Jul-98	Immunoassay	Alachlor	0.24	ug/L	2
01N 02W 35CDB1				21-Sep-94	Immunoassay	Alachlor	0.09	ug/L	2
01N 02W 35CDB1				26-Jun-03	Immunoassay	Atrazine	ND	ug/L	3
01N 02W 35CDB1				07-Jul-98	Immunoassay	Atrazine	0.12	ug/L	3
01N 02W 35CDB1				21-Sep-94	Immunoassay	Atrazine	ND	ug/L	3
02N 03W 06BBA1	Canyon	Domestic	Reg	02-Jul-03	USGS Trace Element	Arsenic	28	ug/L	10
02N 03W 06BBA1				08-Jul-98	USGS Trace Element	Arsenic	17	ug/L	10
02N 03W 06BBA1				02-Aug-94	USGS Trace Element	Arsenic	27	ug/L	10
02N 03W 15BBC1	Canyon	Domestic	New	04-Sep-03	RadChem	Adjusted Alpha Activity	20.4	pCi/L	15
02N 03W 15BBC1				04-Sep-03	USGS Trace Element	Arsenic	12.2	ug/L	10
03N 01W 18DAC1	Canyon	Domestic	Annual	17-Jun-03	Immunoassay	Atrazine	0.28	ug/L	3
03N 01W 18DAC1				17-Jun-03	GCMS - USGS	Phenol	0.62	ug/l	NE
03N 01W 18DAC1				01-Jul-02	Immunoassay	Atrazine	ND	ug/L	3
03N 01W 18DAC1				27-Jun-01	Immunoassay	Atrazine	0.06	ug/L	3
03N 01W 18DAC1				29-Jun-00	Immunoassay	Atrazine	0.06	ug/L	3
03N 01W 18DAC1				14-Jun-99	Immunoassay	Atrazine	ND	ug/L	3
03N 01W 18DAC1				08-Jul-98	Immunoassay	Atrazine	0.12	ug/L	3
03N 01W 18DAC1				08-Jul-98	GC - USGS	Atrazine	0.033	ug/L	3
03N 01W 18DAC1				08-Jul-98	GC - USGS	Atrazine, desethyl	0.03	ug/L	NE
03N 01W 18DAC1				08-Jul-98	GC - USGS	Simazine	0.0055	ug/L	4
03N 01W 18DAC1				14-Aug-97	Rad Chem	Adjusted Alpha Activity	22.6	pCi/L	15
03N 01W 18DAC1				14-Aug-97	GC - USGS	Atrazine	0.0432	ug/L	3
03N 01W 18DAC1				14-Aug-97	Immunoassay	Atrazine	0.035	ug/L	3
03N 01W 18DAC1				14-Aug-97	GC - USGS	Atrazine, desethyl	0.0184	ug/L	NE
03N 01W 18DAC1				14-Aug-97	GC - USGS	Simazine	0.005	ug/L	4
03N 01W 18DAC1				06-Aug-96	GC - USGS	Atrazine	0.039	ug/L	3
03N 01W 18DAC1				06-Aug-96	Immunoassay	Atrazine	0.06	ug/L	3

Station	County	Water Use	YrCode	Sample Date	Method	Detection of Concern	value	units	MCL
03N 01W 18DAC1				06-Aug-96	GC - USGS	Atrazine, desethyl	0.014	ug/L	NE
03N 01W 18DAC1				06-Aug-96	GC - USGS	Simazine	0.002	ug/L	4
03N 01W 18DAC1				27-Aug-93	Rad Chem	Adjusted Alpha Activity	19.4	pCi/L	15
03N 01W 18DAC1				27-Aug-93	Rad Chem	Uranium	30	pCi/L	30
03N 02W 12BAB1	Canyon	Stock	Reg	13-Jun-03	GCMS - USGS	1,4-Dichlorobenzene	0.069	ug/l	75
03N 02W 12BAB1				13-Jun-03	Immunoassay	Atrazine	0.13	ug/L	3
03N 02W 12BAB1				13-Jun-03	USGS NUTRIENTS	Nitrate	21.2	mg/L	10
03N 02W 12BAB1				13-Jun-03	GCMS - USGS	Phenol	0.4	ug/l	NE
03N 02W 12BAB1				22-Jul-98	Rad Chem	Adjusted Alpha Activity	27.8	pCi/L	15
03N 02W 12BAB1				22-Jul-98	GC - Alpha Analytical	Dichlorobenzene,1,4-	ND	ug/L	75
03N 02W 12BAB1				22-Jul-98	GC - USGS	Atrazine	0.1	ug/L	3
03N 02W 12BAB1				22-Jul-98	Immunoassay	Atrazine	ND	ug/L	3
03N 02W 12BAB1				22-Jul-98	GC - USGS	Atrazine, desethyl	0.09	ug/L	NE
03N 02W 12BAB1				22-Jul-98	USGS NUTRIENTS	Nitrate	28.1	mg/L	10
03N 02W 12BAB1				21-Sep-94	Immunoassay	Atrazine	0.59	ug/L	3
03N 02W 12BAB1				21-Sep-94	Rad Chem	Adjusted Alpha Activity	22.4	pCi/L	15
03N 02W 12BAB1				21-Sep-94	GC - Alpha Analytical	Dichlorobenzene,1,4-	ND	ug/L	75
03N 02W 12BAB1				21-Sep-94	USGS NUTRIENTS	Nitrate	22	mg/L	10
03N 02W 12BAB1				21-Sep-94	Rad Chem	Uranium	40	mg/L	30
03N 02W 15DDD1	Canyon	Irrigation	Reg	13-Jun-03	GCMS - USGS	1,4-Dichlorobenzene	0.078	ug/l	75
03N 02W 15DDD1				13-Jun-03	GCMS - USGS	Phenol	0.4	ug/l	NE
03N 02W 15DDD1				26-Aug-98	GC - Alpha Analytical	Dichlorobenzene,1,4-	ND	ug/L	75
03N 02W 15DDD1				23-Sep-94	GC - Alpha Analytical	Dichlorobenzene,1,4-	ND	ug/L	75
03N 02W 31BCC1	Canyon	Irrigation	Reg	19-Jun-03	GCMS - USGS	Phenol	0.53	ug/l	NE
03N 02W 31BCC1				21-Jul-08	Rad Chem	Adjusted Alpha Activity	18	pCi/L	15
03N 02W 36CDC1	Canyon	Domestic	Reg	29-Aug-03	GCMS - USGS	1,4-Dichlorobenzene	0.1	ug/l	75
03N 02W 36CDC1				29-Aug-03	Immunoassay	Atrazine	0.18	ug/L	3
03N 02W 36CDC1				29-Aug-03	USGS ONSITE	Fecal Coliform	13	col/100 ml	0
03N 02W 36CDC1				29-Aug-03	GCMS - USGS	Phenol	0.5	ug/l	NE
03N 02W 36CDC1				17-Jun-99	Immunoassay	Atrazine	0.08	ug/L	3
03N 02W 36CDC1				17-Jun-99	GC - Alpha Analytical	Dichlorobenzene,1,4-	ND	ug/L	75
03N 02W 36CDC1				17-Jun-99	USGS ONSITE	Fecal Coliform	ND	col/100 ml	0
03N 02W 36CDC1				25-Jul-95	Immunoassay	Atrazine	0.21	ug/L	3
03N 02W 36CDC1				25-Jul-95	GC - USGS	Atrazine	0.076	ug/L	3
03N 02W 36CDC1				25-Jul-95	GC - USGS	Atrazine, desethyl	0.072	ug/L	NE
03N 02W 36CDC1				25-Jul-95	GC - Alpha Analytical	Dichlorobenzene,1,4-	ND	ug/L	75
03N 03W 14CDA1	Canyon	Domestic	Annual	01-Jul-03	Immunoassay	Alachlor	0.06	ug/L	2

Station	County	Water Use	YrCode	Sample Date	Method	Detection of Concern	value	units	MCL
03N 03W 14CDA1				01-Jul-03	Immunoassay	Atrazine	0.06	ug/L	3
03N 03W 14CDA1				01-Jul-03	GCMS - USGS	Phenol	1.7	ug/l	NE
03N 03W 14CDA1				10-Jun-02	Alchem GC	Alachlor	ND	ug/l	2
03N 03W 14CDA1				10-Jun-02	Immunoassay	Alachlor	0.11	ug/L	2
03N 03W 14CDA1				10-Jun-02	Immunoassay	Atrazine	ND	ug/L	3
03N 03W 14CDA1				10-Jun-02	GC- State Lab	Atrazine	ND	ug/l	3
03N 03W 14CDA1				10-Jun-02	GC- State Lab	Dacthal (DCPA)	1.3	ug/l	NE
03N 03W 14CDA1				09-Jul-01	Immunoassay	Alachlor	0.1	ug/L	2
03N 03W 14CDA1				09-Jul-01	Immunoassay	Atrazine	0.07	ug/L	3
03N 03W 14CDA1				28-Jun-00	Immunoassay	Alachlor	0.28	ug/L	2
03N 03W 14CDA1				28-Jun-00	Immunoassay	Atrazine	0.08	ug/L	3
03N 03W 14CDA1				15-Jun-99	Immunoassay	Alachlor	0.29	ug/L	2
03N 03W 14CDA1				15-Jun-99	Immunoassay	Atrazine	0.1	ug/L	3
03N 03W 14CDA1				03-Aug-98	Immunoassay	Alachlor	ND	ug/L	2
03N 03W 14CDA1				03-Aug-98	Rad Chem	Adjusted Alpha Activity	22.3	pCi/L	15
03N 03W 14CDA1				03-Aug-98	GC - USGS	Alachlor	ND	ug/L	2
03N 03W 14CDA1				03-Aug-98	Immunoassay	Atrazine	0.12	ug/L	3
03N 03W 14CDA1				03-Aug-98	GC - USGS	Atrazine	0.064	ug/L	3
03N 03W 14CDA1				03-Aug-98	GC - USGS	Atrazine, desethyl	0.05	ug/L	NE
03N 03W 14CDA1				03-Aug-98	GC - USGS	Dacthal (DCPA)	ND	ug/L	NE
03N 03W 14CDA1				03-Aug-98	GC - USGS	Simazine	0.0308	ug/L	4
03N 03W 14CDA1				03-Aug-98	Immunoassay	Simazine	0.06	ug/L	4
03N 03W 14CDA1				18-Aug-97	Rad Chem	Adjusted Alpha Activity	26.7	pCi/L	15
03N 03W 14CDA1				18-Aug-97	Immunoassay	Alachlor	0.25	ug/L	2
03N 03W 14CDA1				18-Aug-97	GC - USGS	Alachlor	ND	ug/L	2
03N 03W 14CDA1				18-Aug-97	Immunoassay	Atrazine	ND	ug/L	3
03N 03W 14CDA1				18-Aug-97	GC - USGS	Atrazine	0.0493	ug/L	3
03N 03W 14CDA1				18-Aug-97	GC - USGS	Atrazine, desethyl	0.0407	ug/L	NE
03N 03W 14CDA1				18-Aug-97	GC - USGS	Dacthal (DCPA)	ND	ug/L	NE
03N 03W 14CDA1				18-Aug-97	GC - USGS	Simazine	0.02	ug/L	4
03N 03W 14CDA1				18-Aug-97	Immunoassay	Simazine	0.05	ug/L	4
03N 03W 14CDA1				07-Aug-96	Immunoassay	Alachlor	0.21	ug/L	2
03N 03W 14CDA1				07-Aug-96	GC - USGS	Alachlor	ND	ug/L	2
03N 03W 14CDA1				07-Aug-96	GC - USGS	Atrazine	0.052	ug/L	3
03N 03W 14CDA1				07-Aug-96	Immunoassay	Atrazine	0.1	ug/L	3
03N 03W 14CDA1				07-Aug-96	GC - USGS	Atrazine, desethyl	0.012	ug/L	NE
03N 03W 14CDA1				07-Aug-96	GC - USGS	Dacthal (DCPA)	ND	ug/L	NE
03N 03W 14CDA1				07-Aug-96	GC - USGS	Simazine	0.01	ug/L	4
03N 03W 14CDA1				22-Sep-94	Rad Chem	Adjusted Alpha Activity	16.8	pCi/L	15
03N 03W 14CDA1				22-Sep-94	Immunoassay	Alachlor	0.26	ug/L	2
03N 03W 14CDA1				22-Sep-94	Immunoassay	Atrazine	0.1	ug/L	3

Station	County	Water Use	YrCode	Sample Date	Method	Detection of Concern	value	units	MCL
03N 05W 02DCB1	Canyon	Domestic	Reg	11-Jun-03	USGS Trace Element	Arsenic	14.4	ug/L	10
03N 05W 02DCB1				03-Aug-98	USGS Trace Element	Arsenic	14	ug/L	10
03N 05W 02DCB1				20-Sep-94	USGS Trace Element	Arsenic	14	ug/L	10
03N 05W 03ADA1	Canyon	Commercial	Reg	11-Jun-03	USGS Trace Element	Arsenic	45	ug/L	10
03N 05W 03ADA1				11-Jun-03	GCMS - USGS	Phenol	0.42	ug/l	NE
03N 05W 03ADA1				03-Aug-98	Rad Chem	Adjusted Alpha Activity	16.3	pCi/L	15
03N 05W 03ADA1				03-Aug-98	USGS Trace Element	Arsenic	48	ug/L	10
03N 05W 03ADA1				03-Aug-98	GC - USGS	Metribuzin	0.037	ug/L	NE
03N 05W 03ADA1				03-Aug-98	Immunoassay	Metribuzin	ND	ug/L	NE
03N 05W 03ADA1				20-Sep-94	USGS Trace Element	Arsenic	50	ug/L	10
04N 02W 36CCC1	Canyon	Domestic	Reg	17-Jun-03	Immunoassay	Atrazine	0.14	ug/L	3
04N 02W 36CCC1				05-Aug-97	Immunoassay	Atrazine	0.031	ug/L	3
04N 02W 36CCC1				05-Aug-97	GC - USGS	Atrazine	0.0415	ug/L	3
04N 02W 36CCC1				05-Aug-97	GC - USGS	Atrazine, desethyl	0.0196	ug/L	NE
04N 02W 36CCC1				02-Sep-93	Rad Chem	Adjusted Alpha Activity	18.2	pCi/L	15
04N 02W 36CCC1				02-Sep-93	Immunoassay	Atrazine	ND	ug/L	3
04N 02W 36CCC1				02-Sep-93	GC - USGS	Atrazine	ND	ug/L	3
04N 04W 21CAA2	Canyon	Domestic	Annual	02-Jul-03	Immunoassay	Alachlor	0.1	ug/L	2
04N 04W 21CAA2				02-Jul-03	USGS Trace Element	Arsenic	28	ug/L	10
04N 04W 21CAA2				02-Jul-03	GCMS - USGS	Phenol	0.47	ug/l	NE
04N 04W 21CAA2				16-Jul-02	Immunoassay	Alachlor	0.13	ug/L	2
04N 04W 21CAA2				16-Jul-02	USGS Trace Element	Arsenic	27.1	ug/L	10
04N 04W 21CAA2				24-Jul-01	Immunoassay	Alachlor	0.22	ug/L	2
04N 04W 21CAA2				24-Jul-01	USGS Trace Element	Arsenic	23.6	ug/L	10
04N 04W 21CAA2				29-Aug-00	Immunoassay	Alachlor	0.13	ug/L	2
04N 04W 21CAA2				29-Aug-00	USGS Trace Element	Arsenic	23.8	ug/L	10
04N 04W 21CAA2				16-Jun-99	Immunoassay	Alachlor	0.13	ug/L	2
04N 04W 21CAA2				16-Jun-99	USGS Trace Element	Arsenic	26	ug/L	10
04N 04W 21CAA2				05-Aug-98	USGS Trace Element	Arsenic	28	ug/L	10
04N 04W 21CAA2				05-Aug-98	GC - USGS	Atrazine	0.005	ug/L	3
04N 04W 21CAA2				04-Aug-97	USGS Trace Element	Arsenic	24	ug/L	10
04N 04W 21CAA2				04-Aug-97	GC - USGS	Atrazine	0.0039	ug/L	3
04N 04W 21CAA2				04-Aug-97	GC - USGS	Atrazine, desethyl	0.0034	ug/L	NE
04N 04W 21CAA2				04-Aug-97	GC - USGS	Sevin	0.0233	ug/L	NE
04N 04W 21CAA2				29-Jul-96	USGS Trace Element	Arsenic	25	ug/L	10
04N 04W 21CAA2				29-Jul-96	GC - USGS	Atrazine	0.003	ug/L	3
04N 04W 21CAA2				29-Jul-96	GC - USGS	Atrazine, desethyl	0.003	ug/L	NE
04N 04W 21CAA2				15-Aug-95	USGS Trace Element	Arsenic	23	ug/L	10
04N 04W 21CAA2				15-Aug-95	GC - USGS	Atrazine	0.002	ug/L	3

Station	County	Water Use	YrCode	Sample Date	Method	Detection of Concern	value	units	MCL
04N 04W 21CAA2				25-Aug-92	USGS Trace Element	Arsenic	27	ug/L	10
04N 05W 21AAB2	Canyon	Domestic	Annual	03-Jul-03	USGS Trace Element	Arsenic	55.6	ug/L	10
04N 05W 21AAB2				17-Jul-02	USGS Trace Element	Arsenic	53.5	ug/L	10
04N 05W 21AAB2				12-Jul-01	USGS Trace Element	Arsenic	48.6	ug/L	10
04N 05W 21AAB2				05-Jul-00	USGS Trace Element	Arsenic	55.8	ug/L	10
04N 05W 21AAB2				16-Jun-99	USGS Trace Element	Arsenic	57	ug/L	10
04N 05W 21AAB2				05-Aug-98	USGS Trace Element	Arsenic	58	ug/L	10
04N 05W 21AAB2				11-Aug-97	USGS Trace Element	Arsenic	46	ug/L	10
04N 05W 21AAB2				27-Aug-96	USGS Trace Element	Arsenic	60	ug/L	10
04N 05W 21AAB2				22-Sep-93	USGS Trace Element	Arsenic	62	ug/L	10
04N 06W 11DCA1	Canyon	Domestic	Reg	12-Jun-03	USGS Trace Element	Arsenic	13.1	ug/L	10
04N 06W 11DCA1				12-Jun-03	USGS NUTRIENTS	Nitrate	16.3	mg/L	10
04N 06W 11DCA1				12-Jun-03	GCMS - USGS	Phenol	0.78	ug/l	NE
04N 06W 11DCA1				05-Aug-98	USGS Trace Element	Arsenic	16	ug/L	10
04N 06W 11DCA1				05-Aug-98	USGS NUTRIENTS	Nitrate	4.32	mg/L	10
04N 06W 11DCA1				02-Sep-94	USGS Trace Element	Arsenic	16	ug/L	10
04N 06W 11DCA1				02-Sep-94	USGS NUTRIENTS	Nitrate	2.7	mg/L	10
05N 04W 28CDC1	Canyon	Domestic	Reg	16-Jul-03	USGS ONSITE	Fecal Coliform	2	col/100 ml	0
05N 04W 28CDC1				16-Jun-99	USGS ONSITE	Fecal Coliform	ND	col/100 ml	0
05N 04W 28CDC1				31-Aug-94	USGS ONSITE	Fecal Coliform	19	col/100 ml	0
05N 05W 03BCBC1	Canyon	Domestic	New	12-Jun-03	USGS Trace Element	Arsenic	16	ug/L	10
05N 05W 32CDC1	Canyon	Domestic	Annual	08-Jul-03	GCMS - USGS	1,4-Dichlorobenzene	0.1	ug/l	75
05N 05W 32CDC1				08-Jul-03	USGS Trace Element	Arsenic	20.5	ug/L	10
05N 05W 32CDC1				08-Jul-03	GCMS - USGS	Phenol	0.2	ug/l	NE
05N 05W 32CDC1				24-Jul-02	USGS Trace Element	Arsenic	20.4	ug/L	10
05N 05W 32CDC1				12-Jul-01	USGS Trace Element	Arsenic	17.9	ug/L	10
05N 05W 32CDC1				12-Jul-01	GC - Alpha Analytical	Dichlorobenzene,1,4-	ND	ug/L	75
05N 05W 32CDC1				18-Jul-00	USGS Trace Element	Arsenic	18	ug/L	10
05N 05W 32CDC1				01-Jul-99	USGS Trace Element	Arsenic	19	ug/L	10
05N 05W 32CDC1				01-Jul-99	GC - Alpha Analytical	Dichlorobenzene,1,4-	ND	ug/L	75
05N 05W 32CDC1				17-Aug-98	USGS Trace Element	Arsenic	18	ug/L	10
05N 05W 32CDC1				17-Aug-98	GC - USGS	Atrazine, desethyl	0.01	ug/L	NE
05N 05W 32CDC1				17-Aug-98	GC - Alpha Analytical	Dichlorobenzene,1,4-	ND	ug/L	75
05N 05W 32CDC1				05-Aug-97	USGS Trace Element	Arsenic	37	ug/L	10
05N 05W 32CDC1				05-Aug-97	GC - USGS	Atrazine	0.0037	ug/L	3
05N 05W 32CDC1				05-Aug-97	GC - USGS	Atrazine, desethyl	0.0112	ug/L	NE
05N 05W 32CDC1				05-Aug-97	GC - Alpha Analytical	Dichlorobenzene,1,4-	ND	ug/L	75

Station	County	Water Use	YrCode	Sample Date	Method	Detection of Concern	value	units	MCL
05N 05W 32CDC1				31-Jul-96	USGS Trace Element	Arsenic	18	ug/L	10
05N 05W 32CDC1				31-Jul-96	GC - USGS	Atrazine	0.003	ug/L	3
05N 05W 32CDC1				31-Jul-96	GC - USGS	Atrazine, desethyl	0.012	ug/L	NE
05N 05W 32CDC1				31-Jul-96	GC - Alpha Analytical	Dichlorobenzene,1,4-	ND	ug/L	75
05N 05W 32CDC1				29-Aug-93	USGS Trace Element	Arsenic	18	ug/L	10
05N 05W 32CDC1				07-Aug-90	USGS Trace Element	Arsenic	20	ug/L	10
09S 40E 19BAA1	Caribou	Domestic	Annual	03-Sep-03	GCMS - USGS	DEET	0.004	ug/l	NE
09S 40E 19BAA1				03-Sep-03	GCMS - USGS	Phenol	0.62	ug/l	NE
09S 40E 19BAA1				03-Sep-03	GCMS - USGS	Triphenyl phosphate	0.04	ug/l	NE
09S 40E 19BAA1				24-Jun-99	Immunoassay	Metribuzin	0.06	ug/L	NE
09S 40E 19BAA1				27-Jun-96	Immunoassay	Metribuzin	0.04	ug/L	NE
09S 40E 19BAA1				31-Jul-95	GC - USGS	Atrazine	0.002	ug/L	3
09S 40E 19BAA1				31-Jul-95	GC - USGS	Metribuzin	0.006	ug/L	NE
10S 24E 23AAD1	Cassia	Domestic	Annual	23-Jul-03	Immunoassay	Atrazine	0.05	ug/L	3
10S 24E 23AAD1				23-Jul-03	GCMS - USGS	p-Cresol	0.031	ug/l	NE
10S 24E 23AAD1				23-Jul-03	GCMS - USGS	Phenol	4.1	ug/l	NE
10S 24E 23AAD1				15-Aug-00	Immunoassay	Atrazine	0.3	ug/L	3
10S 24E 23AAD1				07-Sep-99	GC - USGS	Atrazine	0.033	ug/L	3
10S 24E 23AAD1				07-Sep-99	Immunoassay	Atrazine	ND	ug/L	3
10S 24E 23AAD1				07-Sep-99	GC - USGS	Atrazine, desethyl	0.023	ug/L	NE
10S 24E 23AAD1				07-Sep-99	GC - USGS	Simazine	0.0133	ug/L	4
10S 24E 23AAD1				25-Jun-98	Immunoassay	Atrazine	ND	ug/L	3
10S 24E 23AAD1				28-Aug-97	Immunoassay	Atrazine	0.018	ug/L	3
10S 24E 23AAD1				25-Jun-96	GC - USGS	Atrazine	0.052	ug/L	3
10S 24E 23AAD1				25-Jun-96	GC - USGS	Atrazine, desethyl	0.019	ug/L	NE
10S 24E 23AAD1				25-Jun-96	GC - USGS	Simazine	0.01	ug/L	4
10S 24E 23AAD1				24-Jun-96	Immunoassay	Atrazine	0.05	ug/L	3
10S 24E 23AAD1				06-Jul-94	Immunoassay	Atrazine	0.05	ug/L	3
11S 22E 14BAB1	Cassia	Domestic	Annual	24-Jul-03	GCMS - USGS	Bromacil	0.62	ug/l	NE
11S 22E 14BAB1				24-Jul-03	GCMS - USGS	Phenol	0.74	ug/l	NE
11S 22E 14BAB1				24-Jul-03	GCMS - USGS	Tris(2-butoxyethyl) phosphate	0.2	ug/l	NE
11S 22E 14BAB1				24-Jul-03	Immunoassay	Atrazine	ND	ug/L	3
11S 22E 14BAB1				23-Sep-02	Immunoassay	Atrazine	ND	ug/L	3
11S 22E 14BAB1				23-Sep-02	GC - Alchem Lab	Atrazine	ND	ug/l	3
11S 22E 14BAB1				11-Sep-01	Immunoassay	Atrazine	ND	ug/L	3
11S 22E 14BAB1				07-Sep-00	Immunoassay	Atrazine	ND	ug/L	3
11S 22E 14BAB1				11-Aug-99	Immunoassay	Atrazine	ND	ug/L	3
11S 22E 14BAB1				24-Jun-98	Immunoassay	Atrazine	0.06	ug/L	3
11S 22E 14BAB1				26-Aug-97	Immunoassay	Atrazine	ND	ug/L	3

Station	County	Water Use	YrCode	Sample Date	Method	Detection of Concern	value	units	MCL
11S 22E 14BAB1				25-Jul-96	Immunoassay	Atrazine	0.08	ug/L	3
11S 22E 14BAB1				25-Jul-96	GC - USGS	Atrazine	0.037	ug/L	3
11S 22E 14BAB1				25-Jul-96	GC - USGS	Atrazine, desethyl	0.038	ug/L	NE
11S 22E 14BAB1				22-Sep-95	GC - USGS	Atrazine	0.009	ug/L	3
11S 22E 14BAB1				22-Sep-95	Immunoassay	Atrazine	0.07	ug/L	3
11S 22E 14BAB1				22-Sep-95	GC - USGS	Atrazine, desethyl	0.004	ug/L	NE
11S 22E 14BAB1				22-Sep-95	GC - USGS	Triallate	0.02	ug/L	NE
11S 23E 16CCB1	Cassia	Domestic	Reg	03-Sep-03	Immunoassay	Atrazine	0.1	ug/L	3
11S 23E 16CCB1				07-Sep-99	Immunoassay	Atrazine	0.22	ug/L	3
11S 23E 16CCB1				07-Sep-95	Immunoassay	Atrazine	0.31	ug/L	3
11S 23E 16CCB1				07-Sep-95	GC - USGS	Atrazine	0.24	ug/L	3
11S 23E 16CCB1				07-Sep-95	GC - USGS	Atrazine, desethyl	0.045	ug/L	NE
11S 23E 16CCB1				07-Sep-95	GC - USGS	Simazine	0.056	ug/L	4
03S 04E 02AAA2	Elmore	Domestic	Reg	29-Jul-03	Immunoassay	Alachlor	0.08	ug/L	2
03S 04E 02AAA2				06-Jul-98	Immunoassay	Alachlor	ND	ug/L	2
03S 04E 02AAA2				03-Aug-94	Immunoassay	Alachlor	ND	ug/L	2
03S 06E 22AAA1	Elmore	Domestic	Reg	12-Aug-03	Immunoassay	Alachlor	0.06	ug/L	2
03S 06E 22AAA1				12-Aug-03	Immunoassay	Atrazine	0.06	ug/L	3
03S 06E 22AAA1				07-Jul-98	Immunoassay	Alachlor	ND	ug/L	2
03S 06E 22AAA1				07-Jul-98	Immunoassay	Atrazine	ND	ug/L	3
03S 06E 22AAA1				03-Aug-94	Immunoassay	Alachlor	ND	ug/L	2
03S 06E 22AAA1				03-Aug-94	Immunoassay	Atrazine	0.12	ug/L	3
04S 07E 17CAB1	Elmore	Domestic	Annual	25-Jul-03	GCMS - USGS	Phenol	0.2	ug/l	NE
05S 06E 01AAD1	Elmore	Domestic	Reg	13-Aug-03	USGS NUTRIENTS	Nitrate	11.6	mg/L	10
05S 06E 01AAD1				03-Sep-98	USGS NUTRIENTS	Nitrate	1.08	mg/L	10
05S 06E 01AAD1				24-Aug-94	USGS NUTRIENTS	Nitrate	0.86	mg/L	10
05S 10E 30BDA1	Elmore	Domestic	Annual	25-Jul-03	USGS Trace Element	Arsenic	34.6	ug/L	10
05S 10E 30BDA1				24-Jul-02	USGS Trace Element	Arsenic	28.2	ug/L	10
05S 10E 30BDA1				03-Aug-01	USGS Trace Element	Arsenic	33	ug/L	10
05S 10E 30BDA1				06-Sep-00	USGS Trace Element	Arsenic	33.7	ug/L	10
05S 10E 30BDA1				14-Sep-99	USGS Trace Element	Arsenic	32	ug/L	10
05S 10E 30BDA1				03-Sep-98	USGS Trace Element	Arsenic	35	ug/L	10
05S 10E 30BDA1				05-Aug-97	USGS Trace Element	Arsenic	32	ug/L	10
05S 10E 30BDA1				19-Aug-96	USGS Trace Element	Arsenic	33	ug/L	10
05S 10E 30BDA1				04-Aug-95	USGS Trace Element	Arsenic	30	ug/L	10
05S 10E 30BDA1				25-Aug-94	USGS Trace Element	Arsenic	33	ug/L	10

Station	County	Water Use	YrCode	Sample Date	Method	Detection of Concern	value	units	MCL
08N 41E 32ABC1	Fremont	Domestic	Annual	07-Aug-03	GCMS - USGS	Phenol	0.63	ug/l	
08N 41E 32ABC1				29-Aug-02	USGS ONSITE	Fecal Coliform	4	col/100 ml	0
08N 41E 32ABC1				27-Jul-00	USGS ONSITE	Fecal Coliform	42	col/100 ml	0
08N 41E 32ABC1				30-Jul-99	USGS ONSITE	Fecal Coliform	2	col/100 ml	0
08N 41E 32ABC1				07-Aug-97	USGS ONSITE	Fecal Coliform	1	col/100 ml	0
08N 41E 32ABC1				01-Sep-95	GC - USGS	Dipropylthiocarbamate, S-Ethyl (EPTC)	0.01	ug/L	NE
08N 43E 20DCC1	Fremont	Domestic	Reg	07-Aug-03	USGS NUTRIENTS	Nitrate	15.6	mg/L	10
08N 43E 20DCC1				11-Aug-98	USGS NUTRIENTS	Nitrate	15.1	mg/L	10
08N 43E 20DCC1				11-Aug-94	USGS NUTRIENTS	Nitrate	14	mg/L	10
06N 03W 33CBA1	Gem	Domestic	Reg	17-Jul-03	USGS Trace Element	Arsenic	11.4	ug/L	10
06N 03W 33CBA1				17-Jul-03	Immunoassay	Atrazine	0.12	ug/L	3
06N 03W 33CBA1				17-Jul-03	GCMS - USGS	Bromacil	0.57	ug/l	NE
06N 03W 33CBA1				17-Jul-03	GCMS - USGS	Diethoxynonylphenol	2	ug/l	NE
06N 03W 33CBA1				17-Jul-03	GCMS - USGS	Phenol	0.76	ug/l	NE
06N 03W 33CBA1				29-Jun-98	USGS Trace Element	Arsenic	11	ug/L	10
06N 03W 33CBA1				29-Jun-98	Immunoassay	Atrazine	0.14	ug/L	3
06N 03W 33CBA1				29-Jun-98	GC - USGS	Atrazine	0.128	ug/L	3
06N 03W 33CBA1				29-Jun-98	GC - USGS	Atrazine, desethyl	0.11	ug/L	NE
06N 03W 33CBA1				04-Aug-94	USGS Trace Element	Arsenic	13	ug/L	10
06N 03W 33CBA1				04-Aug-94	Immunoassay	Atrazine	0.18	ug/L	3
07N 01W 27BCB1	Gem	Domestic	Reg	05-Aug-03	USGS Trace Element	Arsenic	42.1	ug/L	10
07N 01W 27BCB1				05-Aug-03	USGS ONSITE	Fecal Coliform	33	col/100 ml	0
07N 01W 27BCB1				30-Jun-98	USGS Trace Element	Arsenic	51	ug/L	10
07N 01W 27BCB1				30-Jun-98	USGS ONSITE	Fecal Coliform	44	col/100 ml	0
07N 01W 27BCB1				11-Aug-94	USGS Trace Element	Arsenic	58	ug/L	10
07N 01W 27BCB1				11-Aug-94	USGS ONSITE	Fecal Coliform	5	col/100 ml	0
07N 01W 31CAB1	Gem	Domestic	Reg	25-Jul-03	USGS Trace Element	Arsenic	20	ug/L	10
07N 01W 31CAB1				25-Jul-03	GCMS - USGS	Phenol	0.97	ug/l	NE
07N 01W 31CAB1				25-Jul-03	GCMS - USGS	Tris(2-butoxyethyl) phosphate	1.2	ug/l	NE
07N 01W 31CAB1				25-Jul-03	Immunoassay	Atrazine	ND	ug/L	3
07N 01W 31CAB1				25-Jul-03	GCMS - USGS	Prometon	ND	ug/l	NE
07N 01W 31CAB1				24-Aug-99	GC - USGS	Atrazine	0.024	ug/L	3
07N 01W 31CAB1				24-Aug-99	GC - USGS	Atrazine, desethyl	0.024	ug/L	NE
07N 01W 31CAB1				24-Aug-99	GC - USGS	DDE,4,4'-	0.002	ug/L	NE
07N 01W 31CAB1				24-Aug-99	GC - USGS	Prometon	0.016	ug/L	NE
07N 01W 31CAB1				24-Aug-99	GC - USGS	Simazine	0.008	ug/L	4
07N 01W 31CAB1				25-Jun-98	USGS Trace Element	Arsenic	20	ug/L	10

Station	County	Water Use	YrCode	Sample Date	Method	Detection of Concern	value	units	MCL
07N 01W 31CAB1				25-Jun-98	GC - USGS	Atrazine	0.027	ug/L	3
07N 01W 31CAB1				25-Jun-98	GC - USGS	Atrazine, desethyl	0.02	ug/L	NE
07N 01W 31CAB1				25-Jun-98	GC - USGS	Prometon	0.01	ug/L	NE
07N 01W 31CAB1				11-Aug-94	USGS Trace Element	Arsenic	21	ug/L	10
07N 01W 31CAB1				11-Aug-94	Immunoassay	Atrazine	0.2	ug/L	3
07N 02W 34ACC1	Gem	Domestic	Reg	25-Jul-03	USGS NUTRIENTS	Nitrate	12.3	mg/L	10
07N 02W 34ACC1				25-Jul-03	GCMS - USGS	Phenol	0.2	ug/l	NE
07N 02W 34ACC1				25-Jul-03	GCMS - USGS	Tris(2-butoxyethyl) phosphate	0.2	ug/l	NE
07N 02W 34ACC1				25-Jul-03	Immunoassay	Atrazine	ND	ug/L	3
07N 02W 34ACC1				30-Jun-98	GC - USGS	Atrazine	0.008	ug/L	3
07N 02W 34ACC1				30-Jun-98	USGS NUTRIENTS	Nitrate	10.6	mg/L	10
07N 02W 34ACC1				30-Jun-98	Immunoassay	Simazine	ND	ug/L	4
07N 02W 34ACC1				30-Jun-98	GC - USGS	Simazine	0.007	ug/L	4
07N 02W 34ACC1				07-Sep-94	USGS NUTRIENTS	Nitrate	7.1	mg/L	10
05S 15E 35DBD3	Gooding	Domestic	Annual	17-Jul-03	Immunoassay	Atrazine	0.07	ug/L	3
05S 15E 35DBD3				12-Aug-02	Immunoassay	Atrazine	ND	ug/L	3
05S 15E 35DBD3				18-Jul-01	Immunoassay	Atrazine	0.07	ug/L	3
05S 15E 35DBD3				23-Jun-99	Immunoassay	Atrazine	0.22	ug/L	3
05N 37E 21CCC1	Jefferson	Domestic	Reg	19-Aug-03	USGS Trace Element	Arsenic	17.8	ug/L	10
05N 37E 21CCC1				05-Aug-98	USGS Trace Element	Arsenic	19	ug/L	10
05N 37E 21CCC1				16-Aug-94	USGS Trace Element	Arsenic	20	ug/L	10
06N 35E 14CCC1	Jefferson	Domestic	Annual	10-Jul-03	GCMS - USGS	Phenol	0.3	ug/l	NE
08S 17E 30CBD1	Jerome	Industrial	Annual	07-Aug-03	GCMS - USGS	Bisphenol A	0.099	ug/l	NE
08S 17E 30CBD1				07-Aug-03	GCMS - USGS	Phenol	0.89	ug/l	NE
09S 18E 04BBB1	Jerome	Domestic	Reg	07-Aug-03	USGS ONSITE	Fecal Coliform	2	col/100 ml	0
09S 18E 04BBB1				05-Aug-98	USGS ONSITE	Fecal Coliform	ND	col/100 ml	0
09S 18E 04BBB1				27-Jul-94	USGS ONSITE	Fecal Coliform	ND	col/100 ml	0
40N 05W 20BBA1	Latah	Domestic	Reg	29-Jul-03	USGS Trace Element	Arsenic	14.6	ug/L	10
40N 05W 20BBA1				11-Aug-98	USGS Trace Element	Arsenic	12	ug/L	10
40N 05W 20BBA1				25-Aug-94	USGS Trace Element	Arsenic	17	ug/L	10
33N 02E 11BAA1	Lewis	Domestic	Reg	05-Aug-03	USGS NUTRIENTS	Nitrate	61.3	mg/L	10
33N 02E 11BAA1				05-Aug-03	USGS NUTRIENTS	Nitrite	0.01	mg/L	1
33N 02E 11BAA1				19-Aug-98	USGS NUTRIENTS	Nitrate	79.5	mg/L	10
33N 02E 11BAA1				19-Aug-98	USGS NUTRIENTS	Nitrite	0.051	mg/L	1

Station	County	Water Use	YrCode	Sample Date	Method	Detection of Concern	value	units	MCL
33N 02E 11BAA1				23-Jul-98	Immunoassay	Carbofuran	0.29	ug/L	40
33N 02E 11BAA1				23-Jul-98	USGS NUTRIENTS	Nitrate	65.3	mg/L	10
33N 02E 11BAA1				23-Jul-98	USGS NUTRIENTS	Nitrite	1.75	mg/L	1
33N 02E 11BAA1				23-Aug-94	USGS NUTRIENTS	Nitrate	8.5	mg/L	10
33N 02E 11BAA1				23-Aug-94	Immunoassay	Nitrate	61.6	mg/L	10
33N 02E 11BAA1				23-Aug-94	USGS NUTRIENTS	Nitrite	0.85	mg/L	1
06N 39E 20DCC1	Madison	Institution	Annual	20-Aug-03	GCMS - USGS	Phenol	0.5	ug/l	NE
07N 40E 32CBCC1	Madison	Domestic	Reg.	20-Aug-03	GCMS - USGS	Naphthalene	0.1	ug/l	NE
07N 40E 32CBCC1				20-Aug-03	GCMS - USGS	Phenol	1.5	ug/l	NE
07N 40E 32CBCC1				11-Sep-98	GC - USGS	Naphthalene	ND	ug/L	NE
09S 23E 14CCC2	Minidoka	Domestic	Annual	07-Jul-03	GCMS - USGS	Phenol	1.1	ug/l	NE
09S 23E 14CCC2				07-Jul-03	Immunoassay	2,4-D	ND	ug/l	70
09S 23E 14CCC2				07-Jul-03	GCMS - USGS	Chlorpyrifos	ND	ug/l	NE
09S 23E 14CCC2				11-Aug-98	Immunoassay	2,4-D	0.83	ug/L	70
09S 23E 14CCC2				11-Aug-98	Immunoassay	Carbofuran	0.14	ug/L	40
09S 23E 14CCC2				11-Aug-98	Immunoassay	Chloropyrifos	0.12	ug/L	NE
09S 23E 14CCC2				27-Jun-96	GC - USGS	Atrazine, desethyl	0.002	ug/L	NE
10S 23E 14CCB1	Minidoka	Domestic	Annual	18-Jul-03	USGS Trace Element	Arsenic	10.6	ug/L	10
10S 23E 14CCB1				18-Jul-03	Immunoassay	Atrazine	0.11	ug/L	3
10S 23E 14CCB1				02-Oct-02	USGS Trace Element	Arsenic	10.1	ug/L	10
10S 23E 14CCB1				02-Oct-02	Immunoassay	Atrazine	0.15	ug/L	3
10S 23E 14CCB1				13-Aug-01	USGS Trace Element	Arsenic	10.3	ug/L	10
10S 23E 14CCB1				13-Aug-01	Immunoassay	Atrazine	0.1	ug/L	3
10S 23E 14CCB1				17-Aug-00	USGS Trace Element	Arsenic	10.9	ug/L	10
10S 23E 14CCB1				17-Aug-00	Immunoassay	Atrazine	0.14	ug/L	3
10S 23E 14CCB1				07-Sep-99	USGS Trace Element	Arsenic	12	ug/L	10
10S 23E 14CCB1				07-Sep-99	Immunoassay	Atrazine	0.16	ug/L	3
10S 23E 14CCB1				12-Aug-98	USGS Trace Element	Arsenic	11	ug/L	10
10S 23E 14CCB1				12-Aug-98	Immunoassay	Atrazine	0.17	ug/L	3
10S 23E 14CCB1				12-Aug-98	Immunoassay	Cyanazine	0.05	ug/L	NE
10S 23E 14CCB1				12-Aug-98	Immunoassay	Simazine	0.58	ug/L	4
10S 23E 14CCB1				03-Sep-97	USGS Trace Element	Arsenic	11	ug/L	10
10S 23E 14CCB1				03-Sep-97	Immunoassay	Atrazine	0.066	ug/L	3
10S 23E 14CCB1				03-Sep-97	Immunoassay	Simazine	0.56	ug/L	4
10S 23E 14CCB1				16-Jul-96	Immunoassay	2,4-D	20.17	ug/L	70
10S 23E 14CCB1				16-Jul-96	USGS Trace Element	Arsenic	11	ug/L	10
10S 23E 14CCB1				16-Jul-96	GC - USGS	Atrazine	0.073	ug/L	3
10S 23E 14CCB1				16-Jul-96	Immunoassay	Atrazine	0.19	ug/L	3

Station	County	Water Use	YrCode	Sample Date	Method	Detection of Concern	value	units	MCL
10S 23E 14CCB1				16-Jul-96	GC - USGS	Atrazine, desethyl	0.021	ug/L	NE
10S 23E 14CCB1				16-Jul-96	GC - USGS	Simazine	0.39	ug/L	4
10S 23E 14CCB1				16-Jul-96	Immunoassay	Simazine	0.48	ug/L	4
10S 23E 14CCB1				29-Aug-95	USGS Trace Element	Arsenic	12	ug/L	10
10S 23E 14CCB1				29-Aug-95	Immunoassay	Cyanazine	0.07	ug/L	NE
10S 23E 14CCB1				30-Aug-94	USGS Trace Element	Arsenic	14	ug/L	10
33N 04W 18DDB1	Nez Perce	Domestic	Reg	04-Aug-03	USGS ONSITE	Fecal Coliform	145	col/100 ml	0
33N 04W 18DDB1				13-Aug-98	USGS ONSITE	Fecal Coliform	0	col/100 ml	0
33N 04W 18DDB1				11-Aug-94	USGS ONSITE	Fecal Coliform	0	col/100 ml	0
35N 04W 02ABD1	Nez Perce	Domestic	Reg	05-Aug-03	Immunoassay	Metolachlor	0.1	ug/L	NE
35N 04W 02ABD1				18-Aug-98	Immunoassay	Metolachlor	0	ug/L	NE
35N 04W 02ABD1				08-Aug-94	Immunoassay	Metolachlor	0	ug/L	NE
15S 30E 10BBB1	Oneida	Domestic	Reg	13-Jun-03	USGS ONSITE	Fecal Coliform	9	col/100 ml	0
15S 30E 10BBB1				24-Jun-98	USGS ONSITE	Fecal Coliform	0	col/100 ml	0
15S 30E 10BBB1				18-Aug-94	USGS ONSITE	Fecal Coliform	0	col/100 ml	0
15S 32E 33DCD1	Oneida	Irrigation	Reg	12-Jun-03	Immunoassay	Atrazine	0.1	ug/L	3
15S 32E 33DCD1				18-Jun-98	Immunoassay	Atrazine	0.09	ug/L	3
15S 32E 33DCD1				20-Aug-94	Immunoassay	Atrazine	0.18	ug/L	3
01N 04W 12BAA1	Owyhee	Stock	Reg	27-Jun-03	USGS Common Ion	Fluoride	9.73	mg/L	4
01N 04W 12BAA1				08-Sep-98	USGS Common Ion	Fluoride	8.3	mg/L	4
01N 04W 12BAA1				13-Sep-94	USGS Common Ion	Fluoride	9.8	mg/L	4
03N 05W 28ACB1	Owyhee	Domestic	Reg	27-Jun-03	USGS Trace Element	Arsenic	62.1	ug/L	10
03N 05W 28ACB1				13-Aug-98	USGS Trace Element	Arsenic	54	ug/L	10
03N 05W 28ACB1				13-Sep-94	USGS Trace Element	Arsenic	58	ug/L	10
04S 02E 06CDA1	Owyhee	Domestic	Reg	21-Jul-03	USGS Trace Element	Arsenic	12.5	ug/L	10
04S 02E 06CDA1				14-Aug-98	RadChem	Adjusted Alpha Activity	17.5	pCi/L	15
04S 02E 06CDA1				14-Aug-98	USGS Trace Element	Arsenic	12	ug/L	10
04S 02E 06CDA1				15-Sep-94	USGS Trace Element	Arsenic	16	ug/L	10
05S 03E 22BBB2	Owyhee	Public Supply	Annual	21-Jul-03	USGS Trace Element	Arsenic	17.4	ug/L	10
05S 03E 22BBB2				26-Jul-02	USGS Trace Element	Arsenic	16.9	ug/L	10
05S 03E 22BBB2				08-Aug-01	USGS Trace Element	Arsenic	15.4	ug/L	10
05S 03E 22BBB2				23-Aug-00	USGS Trace Element	Arsenic	16.4	ug/L	10
05S 03E 22BBB2				23-Aug-00	Immunoassay	Atrazine	0.05	ug/L	3
05S 03E 22BBB2				27-Jul-99	USGS Trace Element	Arsenic	15	ug/L	10

Station	County	Water Use	YrCode	Sample Date	Method	Detection of Concern	value	units	MCL
05S 03E 22BBB2				28-Aug-98	USGS Trace Element	Arsenic	17	ug/L	10
05S 03E 22BBB2				06-Aug-97	USGS Trace Element	Arsenic	17	ug/L	10
05S 03E 22BBB2				06-Aug-97	Immunoassay	Atrazine	0.024	ug/L	3
05S 03E 22BBB2				06-Aug-96	USGS Trace Element	Arsenic	18	ug/L	10
05S 03E 22BBB2				21-Aug-95	USGS Trace Element	Arsenic	16	ug/L	10
05S 03E 22BBB2				21-Aug-95	GC - USGS	Atrazine	0.015	ug/L	3
05S 03E 22BBB2				21-Aug-95	GC - USGS	Atrazine, desethyl	0.012	ug/L	NE
05S 03E 22BBB2				20-Aug-91	USGS Trace Element	Arsenic	16	ug/L	10
06S 04E 04BDA1	Owyhee	Domestic	Reg	23-Jul-03	USGS Trace Element	Arsenic	13.7	ug/L	10
06S 04E 04BDA1				04-Sep-98	USGS Trace Element	Arsenic	12	ug/L	10
06S 04E 04BDA1				15-Sep-94	USGS Trace Element	Arsenic	15	ug/L	10
07S 05E 07DDC1	Owyhee	Domestic	Reg	24-Jul-03	USGS Trace Element	Arsenic	23.9	ug/L	10
07S 05E 07DDC1				24-Jul-03	USGS Trace Element	Fluoride	8.43	mg/L	4
07S 05E 07DDC1				27-Aug-98	USGS Trace Element	Arsenic	24	ug/L	10
07S 05E 07DDC1				27-Aug-98	USGS Trace Element	Fluoride	7.2	mg/L	4
07S 05E 07DDC1				26-Aug-94	USGS Trace Element	Arsenic	24	ug/L	10
07S 05E 07DDC1				26-Aug-94	USGS Trace Element	Fluoride	8.6	mg/L	4
07S 06E 16ABB2	Owyhee	Domestic	New	23-Jul-03	USGS Trace Element	Arsenic	24.3	ug/L	10
07S 06E 16ABB2				23-Jul-03	USGS Common Ion	Fluoride	7.16	mg/L	4
06N 03W 31CBD1	Payette	Domestic	Reg	18-Jul-03	GCMS - USGS	4-Nonylphenol	1	ug/l	NE
06N 03W 31CBD1				18-Jul-03	GCMS - USGS	Phenol	0.61	ug/l	NE
06N 03W 31CBD1				23-Jul-98	RadChem	Adjusted Alpha Activity	21.2	pCi/L	15
06N 03W 31CBD1				23-Jul-98	GC - USGS	Atrazine	0.013	ug/L	3
06N 04W 34ACB1	Payette	Irrigation	Reg	28-Aug-03	USGS Trace Element	Arsenic	10.3	ug/L	10
06N 04W 34ACB1				24-Jul-98	USGS Trace Element	Arsenic	10	ug/L	10
06N 04W 34ACB1				11-Aug-94	USGS Trace Element	Arsenic	11	ug/L	10
07N 05W 15CDC1	Payette	Domestic	Reg	15-Aug-03	USGS Trace Element	Arsenic	13.3	ug/L	10
07N 05W 15CDC1				12-Aug-98	USGS Trace Element	Arsenic	13	ug/L	10
07N 05W 15CDC1				12-Aug-94	USGS Trace Element	Arsenic	13	ug/L	10
07N 05W 33CDB1	Payette	Domestic	Reg	13-Aug-03	USGS Trace Element	Arsenic	22.4	ug/L	10
07N 05W 33CDB1				13-Aug-03	Immunoassay	Atrazine	0.05	ug/L	3
07N 05W 33CDB1				12-Aug-98	USGS Trace Element	Arsenic	23	ug/L	10
07N 05W 33CDB1				12-Aug-98	GC - USGS	Atrazine	0.02	ug/L	3
07N 05W 33CDB1				12-Aug-98	Immunoassay	Atrazine	0	ug/L	3
07N 05W 33CDB1				12-Aug-98	GC - USGS	Atrazine, desethyl	0.02	ug/L	NE

Station	County	Water Use	YrCode	Sample Date	Method	Detection of Concern	value	units	MCL
07N 05W 33CDB1				12-Aug-98	GC - USGS	Simazine	0.0065	ug/L	4
07N 05W 33CDB1				12-Aug-94	USGS Trace Element	Arsenic	23	ug/L	10
07N 05W 33CDB1				12-Aug-94	Immunoassay	Atrazine	0	ug/L	3
08N 05W 26ABB1	Payette	Domestic	Reg	12-Aug-03	Immunoassay	Alachlor	0.81	ug/L	2
08N 05W 26ABB1				12-Aug-03	USGS Trace Element	Arsenic	36.9	ug/L	10
08N 05W 26ABB1				12-Aug-03	USGS NUTRIENTS	Nitrate	10.7	mg/L	10
08N 05W 26ABB1				12-Aug-03	GCMS - USGS	Phenol	0.5	ug/l	NE
08N 05W 26ABB1				11-Aug-98	USGS Trace Element	Arsenic	36	ug/L	10
08N 05W 26ABB1				11-Aug-98	GC - USGS	Atrazine	0.014	ug/L	3
08N 05W 26ABB1				11-Aug-98	GC - USGS	Atrazine, desethyl	0.01	ug/L	NE
08N 05W 26ABB1				11-Aug-98	USGS NUTRIENTS	Nitrate	10.6	mg/L	10
08N 05W 26ABB1				04-Aug-94	USGS Trace Element	Arsenic	41	ug/L	10
08N 05W 26ABB1				04-Aug-94	USGS NUTRIENTS	Nitrate	3.8	mg/L	10
09N 03W 30BAC1	Payette	Domestic	Reg	15-Aug-03	USGS Trace Element	Arsenic	16.5	ug/L	10
09N 03W 30BAC1				15-Aug-03	USGS NUTRIENTS	Nitrate	8.98	mg/L	10
09N 03W 30BAC1				12-Aug-98	USGS Trace Element	Arsenic	14	ug/L	10
09N 03W 30BAC1				12-Aug-98	USGS NUTRIENTS	Nitrate	45.2	mg/L	10
09N 03W 30BAC1				04-Aug-94	USGS Trace Element	Arsenic	22	ug/L	10
09N 03W 30BAC1				04-Aug-94	USGS NUTRIENTS	Nitrate	8.5	mg/L	10
09N 05W 01ACD1	Payette	Domestic	Reg	07-Aug-03	Immunoassay	Atrazine	0.12	ug/L	3
09N 05W 01ACD1				07-Aug-03	GCMS - USGS	Phenol	0.73	ug/l	NE
09N 05W 01ACD1				27-Aug-99	GC - USGS	Atrazine	0.196	ug/L	3
09N 05W 01ACD1				27-Aug-99	GC - USGS	Atrazine, desethyl	0.053	ug/L	NE
09N 05W 01ACD1				27-Aug-99	GC - USGS	Prometon	0.005	ug/L	NE
09N 05W 01ACD1				27-Aug-99	GC - USGS	Simazine	0.114	ug/L	4
09N 05W 01ACD1				11-Aug-98	GC - USGS	Atrazine	0.135	ug/L	3
09N 05W 01ACD1				11-Aug-98	Immunoassay	Atrazine	0.21	ug/L	3
09N 05W 01ACD1				11-Aug-98	GC - USGS	Atrazine, desethyl	0.05	ug/L	NE
09N 05W 01ACD1				11-Aug-98	Immunoassay	Cyanazine	0.04	ug/L	NE
09N 05W 01ACD1				11-Aug-98	GC - USGS	Simazine	0.094	ug/L	4
09N 05W 01ACD1				11-Aug-98	Immunoassay	Simazine	0.22	ug/L	4
09N 05W 01ACD1				10-Aug-94	Immunoassay	Atrazine	0.24	ug/L	3
09N 05W 01ACD1				10-Aug-94	Immunoassay	Metolachlor	0.28	ug/L	NE
09N 05W 26CBB1	Payette	Domestic	Annual	07-Aug-03	Immunoassay	Atrazine	0.09	ug/L	3
09N 05W 26CBB1				07-Aug-03	GCMS - USGS	Tetrachloroethylene	0.1	ug/l	5
09N 05W 26CBB1				21-Aug-02	Immunoassay	Atrazine	0.07	ug/L	3
09N 05W 26CBB1				20-Aug-01	Immunoassay	Atrazine	0.11	ug/L	3
09N 05W 26CBB1				20-Aug-01	GC - Alpha Analytical	Tetrachloroethylene	ND	ug/L	5

Station	County	Water Use	YrCode	Sample Date	Method	Detection of Concern	value	units	MCL
09N 05W 26CBB1				19-Jul-00	Immunoassay	Atrazine	0.09	ug/L	3
09N 05W 26CBB1				04-Aug-99	Immunoassay	Atrazine	0.07	ug/L	3
09N 05W 26CBB1				04-Aug-99	GC - Alpha Analytical	Tetrachloroethylene	ND	ug/L	5
09N 05W 26CBB1				11-Aug-98	RadChem	Adjusted Alpha Activity	15.5	pCi/L	15
09N 05W 26CBB1				11-Aug-98	Immunoassay	Atrazine	0.17	ug/L	3
09N 05W 26CBB1				11-Aug-98	GC - USGS	Atrazine	0.061	ug/L	3
09N 05W 26CBB1				11-Aug-98	GC - USGS	Atrazine, desethyl	0.08	ug/L	NE
09N 05W 26CBB1				11-Aug-98	GC - USGS	Simazine	0.0096	ug/L	4
09N 05W 26CBB1				11-Aug-98	Immunoassay	Simazine	0.07	ug/L	4
09N 05W 26CBB1				11-Aug-98	GC - Alpha Analytical	Tetrachloroethylene	ND	ug/L	5
09N 05W 26CBB1				31-Jul-97	Immunoassay	Atrazine	0.037	ug/L	3
09N 05W 26CBB1				31-Jul-97	GC - Alpha Analytical	Tetrachloroethylene	ND	ug/L	5
09N 05W 26CBB1				22-Jul-96	Immunoassay	Atrazine	0.07	ug/L	3
09N 05W 26CBB1				22-Jul-96	GC - USGS	Atrazine	0.056	ug/L	3
09N 05W 26CBB1				22-Jul-96	GC - USGS	Atrazine, desethyl	0.03	ug/L	NE
09N 05W 26CBB1				22-Jul-96	GC - USGS	Simazine	0.006	ug/L	4
09N 05W 26CBB1				09-Aug-93	Immunoassay	Atrazine	0.09	ug/L	3
08S 33E 05DCD1	Power	Domestic	Reg	09-Sep-03	USGS Trace Element	Arsenic	16.3	ug/L	10
08S 33E 05DCD1				16-Sep-98	USGS Trace Element	Arsenic	16	ug/L	10
08S 33E 05DCD1				22-Aug-94	USGS Trace Element	Arsenic	16	ug/L	10
09S 14E 07ABC1	Twin Falls	Domestic	New	01-Aug-03	RadChem	Adjusted Alpha Activity	15	pCi/l	15
09S 14E 07ABC1				01-Aug-03	USGS Trace Element	Arsenic	10.6	ug/L	10
09S 15E 25BAC1	Twin Falls	Domestic	Reg	06-Aug-03	USGS Trace Element	Arsenic	15.1	ug/L	10
09S 15E 25BAC1				23-Jun-98	USGS Trace Element	Arsenic	14	ug/L	10
09S 15E 25BAC1				25-Jul-94	USGS Trace Element	Arsenic	12	ug/L	10
09S 16E 20BDD1	Twin Falls	Domestic	Annual	06-Aug-03	USGS Trace Element	Arsenic	19.5	ug/L	10
09S 16E 20BDD1				16-Jul-02	USGS Trace Element	Arsenic	21.5	ug/L	10
09S 16E 20BDD1				15-Aug-01	USGS Trace Element	Arsenic	18.2	ug/L	10
09S 16E 20BDD1				28-Aug-00	USGS Trace Element	Arsenic	18.9	ug/L	10
09S 16E 20BDD1				04-Aug-99	USGS Trace Element	Arsenic	19	ug/L	10
09S 16E 20BDD1				04-Aug-99	Immunoassay	Metolachlor	0.14	ug/L	NE
09S 16E 20BDD1				17-Jun-98	USGS Trace Element	Arsenic	18	ug/L	10
09S 16E 20BDD1				27-Jun-97	USGS Trace Element	Arsenic	10	ug/L	10
09S 16E 20BDD1				29-Jul-96	USGS Trace Element	Arsenic	20	ug/L	10
09S 16E 20BDD1				29-Jul-96	GC - USGS	Atrazine	0.005	ug/L	3
09S 16E 20BDD1				29-Jul-96	GC - USGS	Atrazine, desethyl	0.015	ug/L	NE
09S 16E 20BDD1				20-Sep-95	USGS Trace Element	Arsenic	20	ug/L	10
09S 16E 20BDD1				28-Aug-92	USGS Trace Element	Arsenic	20	ug/L	10

Station	County	Water Use	YrCode	Sample Date	Method	Detection of Concern	value	units	MCL
10S 13E 25DDC1	Twin Falls	Public Supply	Annual	22-Jul-03	Immunoassay	Alachlor	0.17	ug/L	2
10S 13E 25DDC1				22-Jul-03	USGS Trace Element	Arsenic	21.5	ug/L	10
10S 13E 25DDC1				22-Jul-03	Immunoassay	Atrazine	0.17	ug/L	3
10S 13E 25DDC1				22-Jul-03	Immunoassay_H	Estradiol	2.98	ug/L	NE
10S 13E 25DDC1				22-Jul-03	GCMS - USGS	Phenol	0.3	ug/l	NE
10S 13E 25DDC1				20-Jun-02	Immunoassay	Alachlor	0.16	ug/L	2
10S 13E 25DDC1				20-Jun-02	USGS Trace Element	Arsenic	22.3	ug/L	10
10S 13E 25DDC1				20-Jun-02	Immunoassay	Atrazine	0.14	ug/L	3
10S 13E 25DDC1				20-Jun-02	Immunoassay_H	Estradiol	ND	ug/L	NE
10S 13E 25DDC1				20-Jun-02	USGS Trace Element	Mercury	0.01	ug/L	2
10S 13E 25DDC1				25-Jul-01	USGS Trace Element	Arsenic	20	ug/L	10
10S 13E 25DDC1				25-Jul-01	Immunoassay	Atrazine	0.12	ug/L	3
10S 13E 25DDC1				25-Jul-01	GC - USGS	Atrazine	0.098	ug/L	3
10S 13E 25DDC1				25-Jul-01	GC - USGS	Atrazine, desethyl	0.016	ug/L	NE
10S 13E 25DDC1				25-Jul-01	GC - USGS	Metolachlor	0.005	ug/L	NE
10S 13E 25DDC1				25-Jul-01	GC - USGS	Prometone	0.004	ug/L	NE
10S 13E 25DDC1				23-Aug-00	Immunoassay	Alachlor	0.09	ug/L	2
10S 13E 25DDC1				23-Aug-00	USGS Trace Element	Arsenic	21.7	ug/L	10
10S 13E 25DDC1				23-Aug-00	Immunoassay	Atrazine	0.14	ug/L	3
10S 13E 25DDC1				26-Jul-99	Immunoassay	Alachlor	0.06	ug/L	2
10S 13E 25DDC1				26-Jul-99	USGS Trace Element	Arsenic	20	ug/L	10
10S 13E 25DDC1				26-Jul-99	Immunoassay	Atrazine	0.15	ug/L	3
10S 13E 25DDC1				22-Jun-98	USGS Trace Element	Arsenic	17	ug/L	10
10S 13E 25DDC1				22-Jun-98	Immunoassay	Atrazine	0.13	ug/L	3
10S 13E 25DDC1				22-Jun-98	GC - Alpha Analytical	Chloroform	7.4	ug/L	100*
10S 13E 25DDC1				22-Jun-98	GC - Alpha Analytical	Dibromochloromethane	3.4	ug/L	100*
10S 13E 25DDC1				22-Jun-98	GC - Alpha Analytical	Dichlorobromomethane	7.14	ug/L	100*
10S 13E 25DDC1				22-Jun-98	Immunoassay	Simazine	0.05	ug/L	4
10S 13E 25DDC1				05-Sep-97	Immunoassay	Alachlor	0.11	ug/L	2
10S 13E 25DDC1				05-Sep-97	USGS Trace Element	Arsenic	24	ug/L	10
10S 13E 25DDC1				05-Sep-97	Immunoassay	Atrazine	0.146	ug/L	3
10S 13E 25DDC1				05-Sep-97	Immunoassay	Simazine	0.1	ug/L	4
10S 13E 25DDC1				18-Jun-96	USGS Trace Element	Arsenic	21	ug/L	10
10S 13E 25DDC1				18-Jun-96	Immunoassay	Atrazine	0.22	ug/L	3
10S 13E 25DDC1				18-Jun-96	GC - USGS	Atrazine	0.15	ug/L	3
10S 13E 25DDC1				18-Jun-96	GC - USGS	Atrazine, desethyl	0.028	ug/L	NE
10S 13E 25DDC1				18-Jun-96	GC - USGS	Simazine	0.003	ug/L	4
10S 13E 25DDC1				18-Jun-96	Immunoassay	Simazine	0.09	ug/L	4
10S 13E 25DDC1				26-Jul-95	USGS Trace Element	Arsenic	19	ug/L	10
10S 13E 25DDC1				26-Jul-95	Immunoassay	Atrazine	0.21	ug/L	3
10S 13E 25DDC1				26-Jul-95	GC - USGS	Atrazine	0.18	ug/L	3

Station	County	Water Use	YrCode	Sample Date	Method	Detection of Concern	value	units	MCL
10S 13E 25DDC1				26-Jul-95	GC - USGS	Atrazine, desethyl	0.096	ug/L	NE
10S 13E 25DDC1				26-Jul-95	GC - USGS	Simazine	0.006	ug/L	4
10S 13E 25DDC1				25-Jul-91	USGS Trace Element	Arsenic	23	ug/L	10
10S 13E 25DDC1				25-Jul-91	GC - State Lab	Dichlorobromomethane	0.66	ug/L	100*
10S 16E 24DDD1	Twin Falls	Domestic	Annual	13-Jun-03	USGS Trace Element	Arsenic	13.5	ug/L	10
10S 16E 24DDD1				13-Jun-03	Immunoassay_H	Estradiol	2.89	ug/L	NE
10S 16E 24DDD1				13-Jun-03	GCMS - USGS	Phenol	0.67	ug/l	NE
10S 16E 24DDD1				17-Jul-02	USGS Trace Element	Arsenic	14.7	ug/L	10
10S 16E 24DDD1				17-Jul-02	USGS Trace Element	Mercury	0.01	ug/L	2
10S 16E 24DDD1				01-Aug-01	USGS Trace Element	Arsenic	12.1	ug/L	10
10S 16E 24DDD1				29-Aug-00	USGS Trace Element	Arsenic	13	ug/L	10
10S 16E 24DDD1				24-Jun-99	USGS Trace Element	Arsenic	14	ug/L	10
10S 16E 24DDD1				16-Jun-98	USGS Trace Element	Arsenic	13	ug/L	10
10S 16E 24DDD1				16-Jun-98	GC - Alpha Analytical	Dichlorodifluoromethane	0.65	ug/L	NE
10S 16E 24DDD1				18-Jul-97	USGS Trace Element	Arsenic	13	ug/L	10
10S 16E 24DDD1				08-Jul-96	USGS Trace Element	Arsenic	14	ug/L	10
10S 16E 24DDD1				08-Jul-96	GC - USGS	Atrazine	0.003	ug/L	3
10S 16E 24DDD1				08-Jul-96	GC - USGS	Atrazine, desethyl	0.003	ug/L	NE
10S 16E 24DDD1				15-Aug-94	USGS Trace Element	Arsenic	15	ug/L	10
10S 16E 32DCD1	Twin Falls	Domestic	Annual	26-Jun-03	USGS Trace Element	Arsenic	11.1	ug/L	10
10S 16E 32DCD1				25-Jun-02	USGS Trace Element	Arsenic	10.8	ug/L	10
10S 16E 32DCD1				02-Aug-01	USGS Trace Element	Arsenic	10.3	ug/L	10
10S 16E 32DCD1				29-Aug-00	USGS Trace Element	Arsenic	10.5	ug/L	10
10S 16E 32DCD1				20-Jul-99	USGS Trace Element	Arsenic	11	ug/L	10
10S 16E 32DCD1				18-Jun-98	USGS Trace Element	Arsenic	10	ug/L	10
10S 16E 32DCD1				22-Aug-97	USGS Trace Element	Arsenic	10	ug/L	10
10S 16E 32DCD1				19-Jul-96	USGS Trace Element	Arsenic	10	ug/L	10
10S 16E 32DCD1				19-Jul-96	GC - USGS	Atrazine	0.003	ug/L	3
10S 16E 32DCD1				19-Jul-96	GC - USGS	Atrazine, desethyl	0.003	ug/L	NE
10S 16E 32DCD1				05-Jul-94	USGS Trace Element	Arsenic	10	ug/L	10
10S 17E 33BAB1	Twin Falls	Public Supply	Annual	08-Jul-03	USGS Trace Element	Arsenic	12.5	ug/L	10
10S 17E 33BAB1				24-Sep-02	USGS Trace Element	Arsenic	13.1	ug/L	10
10S 17E 33BAB1				02-Aug-01	USGS Trace Element	Arsenic	11.9	ug/L	10
10S 17E 33BAB1				06-Sep-00	USGS Trace Element	Arsenic	12.1	ug/L	10
10S 17E 33BAB1				03-Aug-99	USGS Trace Element	Arsenic	12	ug/L	10
10S 17E 33BAB1				03-Aug-99	GC - USGS	Atrazine, desethyl	0.007	ug/L	NE
10S 17E 33BAB1				13-Jul-98	USGS Trace Element	Arsenic	12	ug/L	10
10S 17E 33BAB1				29-Aug-97	USGS Trace Element	Arsenic	5	ug/L	10
10S 17E 33BAB1				30-Jul-96	USGS Trace Element	Arsenic	11	ug/L	10

Station	County	Water Use	YrCode	Sample Date	Method	Detection of Concern	value	units	MCL
10S 17E 33BAB1				03-Aug-93	USGS Trace Element	Arsenic	13	ug/L	10
10S 17E 33BAB1				14-Aug-90	USGS Trace Element	Arsenic	12	ug/L	10
10S 18E 04CDA1	Twin Falls	Domestic	Reg	30-Jun-03	Immunoassay	Alachlor	0.08	ug/L	2
10S 18E 04CDA1				04-Jun-98	Immunoassay	Alachlor	ND	ug/L	2
10S 18E 04CDA1				09-Aug-94	Immunoassay	Alachlor	ND	ug/L	2
11S 13E 01DDD1	Twin Falls	Domestic	Reg	04-Aug-03	USGS Trace Element	Arsenic	11.7	ug/L	10
11S 13E 01DDD1				04-Aug-03	Immunoassay	Atrazine	0.05	ug/L	3
11S 13E 01DDD1				22-Jun-98	USGS Trace Element	Arsenic	11	ug/L	10
11S 13E 01DDD1				22-Jun-98	Immunoassay	Atrazine	0	ug/L	3
11S 13E 01DDD1				23-Aug-94	USGS Trace Element	Arsenic	19	ug/L	10
11S 13E 01DDD1				23-Aug-94	Immunoassay	Atrazine	0.25	ug/L	3
11S 14E 12ADD1	Twin Falls	Domestic	Reg	04-Aug-03	USGS Trace Element	Arsenic	14.1	ug/L	10
11S 14E 12ADD1				04-Aug-98	USGS Trace Element	Arsenic	14	ug/L	10
11S 14E 12ADD1				23-Aug-94	USGS Trace Element	Arsenic	14	ug/L	10
11S 16E 27CCC1	Twin Falls	Domestic	Reg	22-Jul-03	USGS NUTRIENTS	Nitrate	10.1	mg/L	10
11S 16E 27CCC1				13-Sep-99	GC - USGS	Atrazine	0.002	ug/L	3
11S 16E 27CCC1				13-Sep-99	GC - USGS	DDE,4,4'-	0.001	ug/L	NE
11S 16E 27CCC1				13-Sep-99	USGS NUTRIENTS	Nitrate	8.73	mg/L	10
11S 16E 27CCC1				13-Sep-99	GC - USGS	Simazine	0.003	ug/L	4
11S 16E 27CCC1				17-Aug-94	USGS NUTRIENTS	Nitrate	5.7	mg/L	10
11S 17E 02ABB1	Twin Falls	Irrigation	Reg	02-Jul-03	USGS Trace Element	Arsenic	21.4	ug/L	10
11S 17E 02ABB1				02-Jul-03	GCMS - USGS	Phenol	1.2	ug/l	NE
11S 17E 02ABB1				05-Aug-98	USGS Trace Element	Arsenic	18	ug/L	10
11S 17E 02ABB1				05-Aug-98	Immunoassay	Atrazine	0	ug/L	3
11S 17E 02ABB1				05-Aug-98	GC - Alpha Analytical	Trichloroethane,1,1,1-	1.6	ug/L	200
11S 17E 02ABB1				22-Jul-94	USGS Trace Element	Arsenic	21	ug/L	10
11S 17E 02ABB1				22-Jul-94	Immunoassay	Atrazine	0	ug/L	3
11S 17E 02ABB1				22-Jul-94	GC - USGS	Atrazine	0.012	ug/L	3
11S 17E 02ABB1				22-Jul-94	GC - USGS	Atrazine, desethyl	0.005	ug/L	NE
13S 16E 08BBAC1	Twin Falls	Domestic	Reg	21-Jul-03	USGS Trace Element	Arsenic	27.2	ug/L	10
13S 16E 08BBAC1				18-Jun-98	USGS Trace Element	Arsenic	32	ug/L	10
13S 16E 08BBAC1				11-Aug-94	USGS Trace Element	Arsenic	24	ug/L	10
10N 04W 07AAA1	Washington	Domestic	Reg	28-Aug-03	GCMS - USGS	1,4-Dichlorobenzene	0.1	ug/l	NE
10N 04W 07AAA1				28-Aug-03	USGS Trace Element	Arsenic	11.7	ug/L	10
10N 04W 07AAA1				28-Aug-03	GCMS - USGS	Bisphenol A	0.11	ug/l	NE

Station	County	Water Use	YrCode	Sample Date	Method	Detection of Concern	value	units	MCL
10N 04W 07AAA1				28-Aug-03	GCMS - USGS	Phenol	0.68	ug/l	NE
10N 04W 07AAA1				08-Jul-99	USGS Trace Element	Arsenic	11	ug/L	10
10N 04W 07AAA1				08-Jul-99	GC - Alpha Analytical	Dichlorobenzene,1,4-	0	ug/L	75
10N 04W 07AAA1				04-Aug-95	USGS Trace Element	Arsenic	8	ug/L	10
10N 04W 07AAA1				04-Aug-95	GC - Alpha Analytical	Dichlorobenzene,1,4-	0	ug/L	75
10N 04W 07AAA1				04-Aug-95	GC - USGS	Sevin	0.015	ug/L	NE
10N 04W 07AAA1				11-Sep-91	USGS Trace Element	Arsenic	15	ug/L	10
10N 04W 07AAA1				11-Sep-91	GC - State Lab	Dichlorobenzene,1,4-	0	ug/L	75
11N 05W 29CBB1	Washington	Irrigation	Annual	27-Aug-03	USGS Trace Element	Arsenic	20.3	ug/L	10
11N 05W 29CBB1				27-Aug-03	GCMS - USGS	Bisphenol A	0.098	ug/l	NE
11N 05W 29CBB1				27-Aug-03	USGS NUTRIENTS	Nitrate	10	mg/L	10
11N 05W 29CBB1				27-Aug-03	GCMS - USGS	Phenol	0.2	ug/l	NE
11N 05W 29CBB1				09-Sep-02	USGS Trace Element	Arsenic	20.3	ug/L	10
11N 05W 29CBB1				09-Sep-02	GC - Alchem Lab	Dacthal (DCPA)	0.57	ug/l	NE
11N 05W 29CBB1				13-Aug-01	USGS Trace Element	Arsenic	19.3	ug/L	10
11N 05W 29CBB1				09-Aug-00	USGS Trace Element	Arsenic	20.4	ug/L	10
11N 05W 29CBB1				09-Aug-00	USGS NUTRIENTS	Nitrate	12.3	mg/L	10
11N 05W 29CBB1				09-Aug-99	USGS Trace Element	Arsenic	20	ug/L	10
11N 05W 29CBB1				09-Aug-99	USGS NUTRIENTS	Nitrate	11.3	mg/L	10
11N 05W 29CBB1				29-Jul-98	USGS Trace Element	Arsenic	21	ug/L	10
11N 05W 29CBB1				30-Jul-97	USGS Trace Element	Arsenic	24	ug/L	10
11N 05W 29CBB1				25-Jul-96	USGS Trace Element	Arsenic	21	ug/L	10
11N 05W 29CBB1				25-Jul-96	USGS NUTRIENTS	Nitrate	9	mg/L	10
11N 05W 29CBB1				27-Jul-95	USGS Trace Element	Arsenic	20	ug/L	10
11N 05W 29CBB1				27-Jul-95	GC - USGS	Atrazine	0.003	ug/L	3
11N 05W 29CBB1				27-Jul-95	GC - USGS	Atrazine, desethyl	0.006	ug/L	NE
11N 05W 29CBB1				04-Aug-94	USGS Trace Element	Arsenic	24	ug/L	10
11N 06W 13DDA1	Washington	Domestic	Reg	27-Aug-03	USGS Trace Element	Arsenic	18.6	ug/L	10
11N 06W 13DDA1				27-Aug-03	Immunoassay	Atrazine	0.16	ug/L	3
11N 06W 13DDA1				27-Aug-03	USGS NUTRIENTS	Nitrate	13	mg/L	10
11N 06W 13DDA1				29-Jul-98	USGS Trace Element	Arsenic	15	ug/L	10
11N 06W 13DDA1				29-Jul-98	Immunoassay	Atrazine	0.28	ug/L	3
11N 06W 13DDA1				29-Jul-98	USGS NUTRIENTS	Nitrate	13.2	mg/L	10
11N 06W 13DDA1				29-Jul-98	Immunoassay	Simazine	0.15	ug/L	4
11N 06W 13DDA1				05-Aug-94	Immunoassay	Alachlor	0.08	ug/L	2
11N 06W 13DDA1				05-Aug-94	USGS Trace Element	Arsenic	17	ug/L	10
11N 06W 13DDA1				05-Aug-94	Immunoassay	Atrazine	0.4	ug/L	3
11N 06W 13DDA1				05-Aug-94	USGS NUTRIENTS	Nitrate	17	mg/L	10
12N 04W 31CAC1	Washington	Domestic	Reg	26-Aug-03	USGS Trace Element	Arsenic	858	ug/L	10

Station	County	Water Use	YrCode	Sample Date	Method	Detection of Concern	value	units	MCL
12N 04W 31CAC1				29-Jul-98	USGS Trace Element	Arsenic	770	ug/L	10
12N 04W 31CAC1				10-Aug-94	USGS Trace Element	Arsenic	950	ug/L	10
12N 05W 24DCD1	Washington	Domestic	Annual	26-Aug-03	USGS Trace Element	Arsenic	11.8	ug/L	10
12N 05W 24DCD1				12-Sep-02	USGS Trace Element	Arsenic	13	ug/L	10
12N 05W 24DCD1				15-Aug-01	USGS Trace Element	Arsenic	10.8	ug/L	10
12N 05W 24DCD1				08-Aug-00	USGS Trace Element	Arsenic	10.8	ug/L	10
12N 05W 24DCD1				10-Aug-99	USGS Trace Element	Arsenic	12	ug/L	10
12N 05W 24DCD1				30-Jul-98	USGS Trace Element	Arsenic	14	ug/L	10
12N 05W 24DCD1				30-Jul-97	USGS Trace Element	Arsenic	16	ug/L	10
12N 05W 24DCD1				12-Aug-96	USGS Trace Element	Arsenic	13	ug/L	10
12N 05W 24DCD1				08-Jul-92	USGS Trace Element	Arsenic	15	ug/L	10

Year Codes **Annual = site sampled every year, Reg = site sampled once every 4 to 5 years, New = new Statewide Program site**
Test Method **GC = Gas Chromatography, GCMS = Gas Chromatography & Mass Spectrometry**
NE = MCL not established
Adjusted alpha activity =
100* = MCL is for total trihalomethanes