


Oakley Fan Critical Ground Water Area


Ground Water Hydrographs

IDWR March 2016

11S 21E 25AAA1

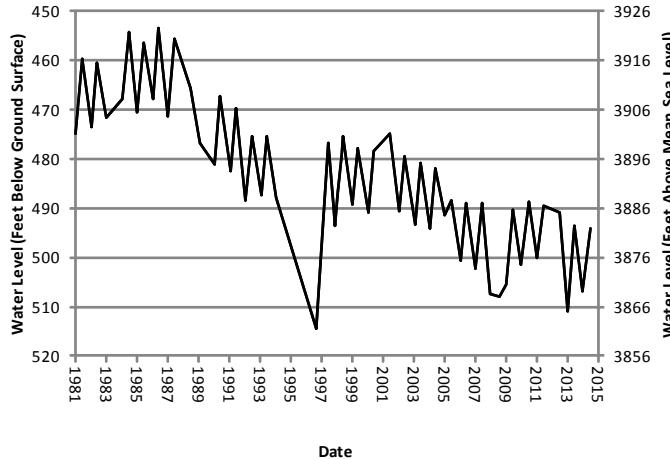


11S 21E 11DAA1

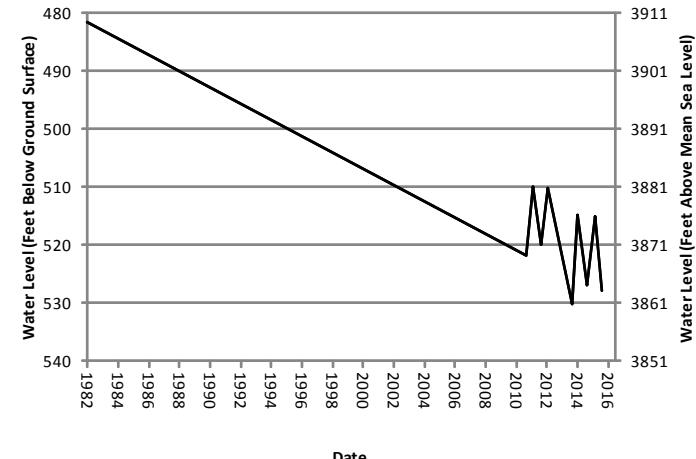

11S 21E 33BBB1



12S 21E 02DAA1

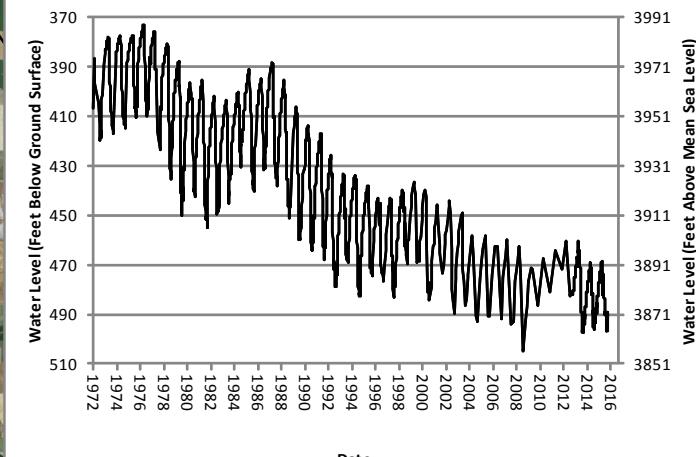

Legend

▲ IDWR Monitoring Wells

■ Oakley Fan CGWA Boundary




0 1 2 4 6 8 Miles

Oakley Fan Critical Ground Water Area


Ground Water Hydrographs

IDWR March 2016


12S 21E 08CCC2

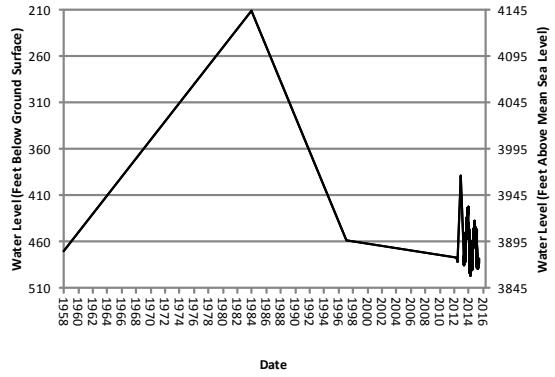


12S 21E 15ACD1

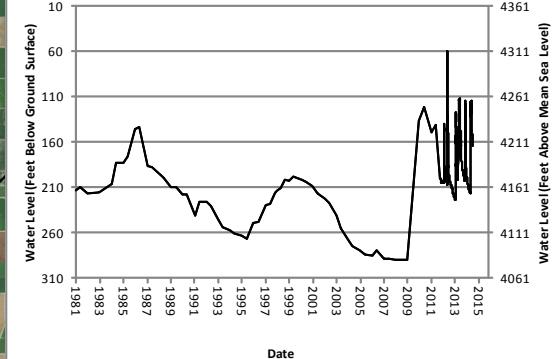


12S 21E 16DCC1

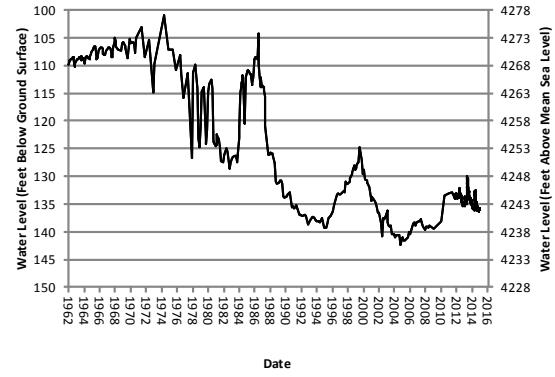

12S 21E 25CCC1

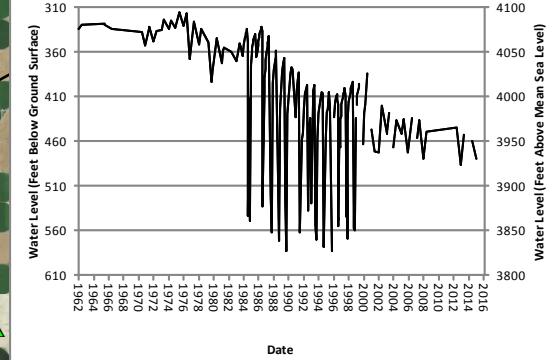

12S 21E 26CCD2

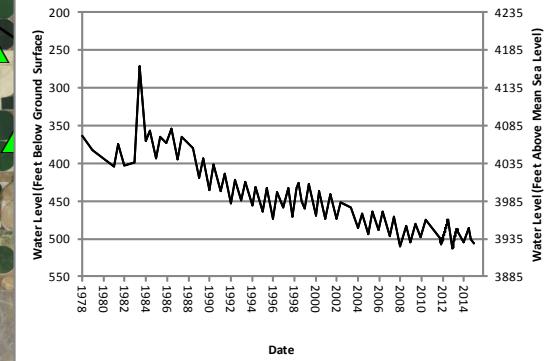

Legend

- ▲ IDWR Monitoring Wells
- Oakley Fan CGWA Boundary

N

0 1 2 4 6 8 Miles