


0 0.5 1 Miles




**CJ Strike Cutoff  
Roadway**

**Mountain  
Home AFB**

**Eastern Water Intake/  
Pump Station**



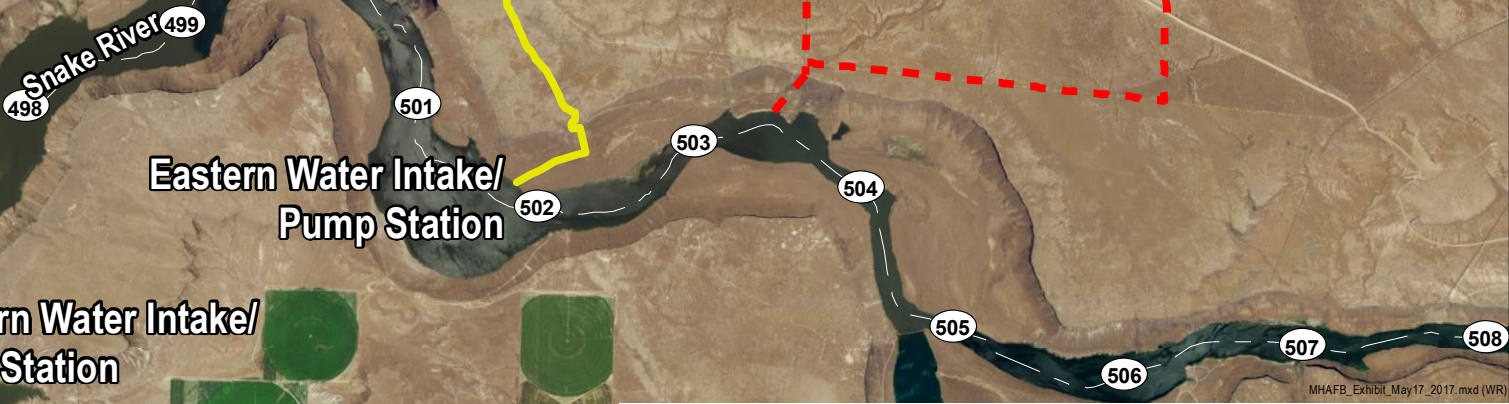

**Western Water Intake/  
Pump Station**

**CJ Strike  
Reservoir**



MHAFB\_Exhibit\_May17\_2017.mxd (WR)

**Alignment Alternatives**

-  Water Treatment Facility
-  Alternative B: Proposed Action (Eastern Alignment)
-  Alternative C: BLM Preferred Alternative (Western Alignment)
-  Alignments Considered but dismissed



prepared by:  
 **GLS/Remote Sensing**  
 Idaho Department of Water Resources  
 322 East Front Street  
 Boise, Idaho 83702  
 208.287.4800

Data used to create this product was derived from multiple sources. Neither the Department of Water Resources nor the State of Idaho assumes any legal responsibility for the accuracy or completeness of aggregated information.