

RECLAMATION

Managing Water in the West

Idaho Water Supply Committee Meeting

Southwest Idaho Report
January 12, 2017




U.S. Department of the Interior
Bureau of Reclamation




Arrowrock Dam – February, 2009


RECLAMATION

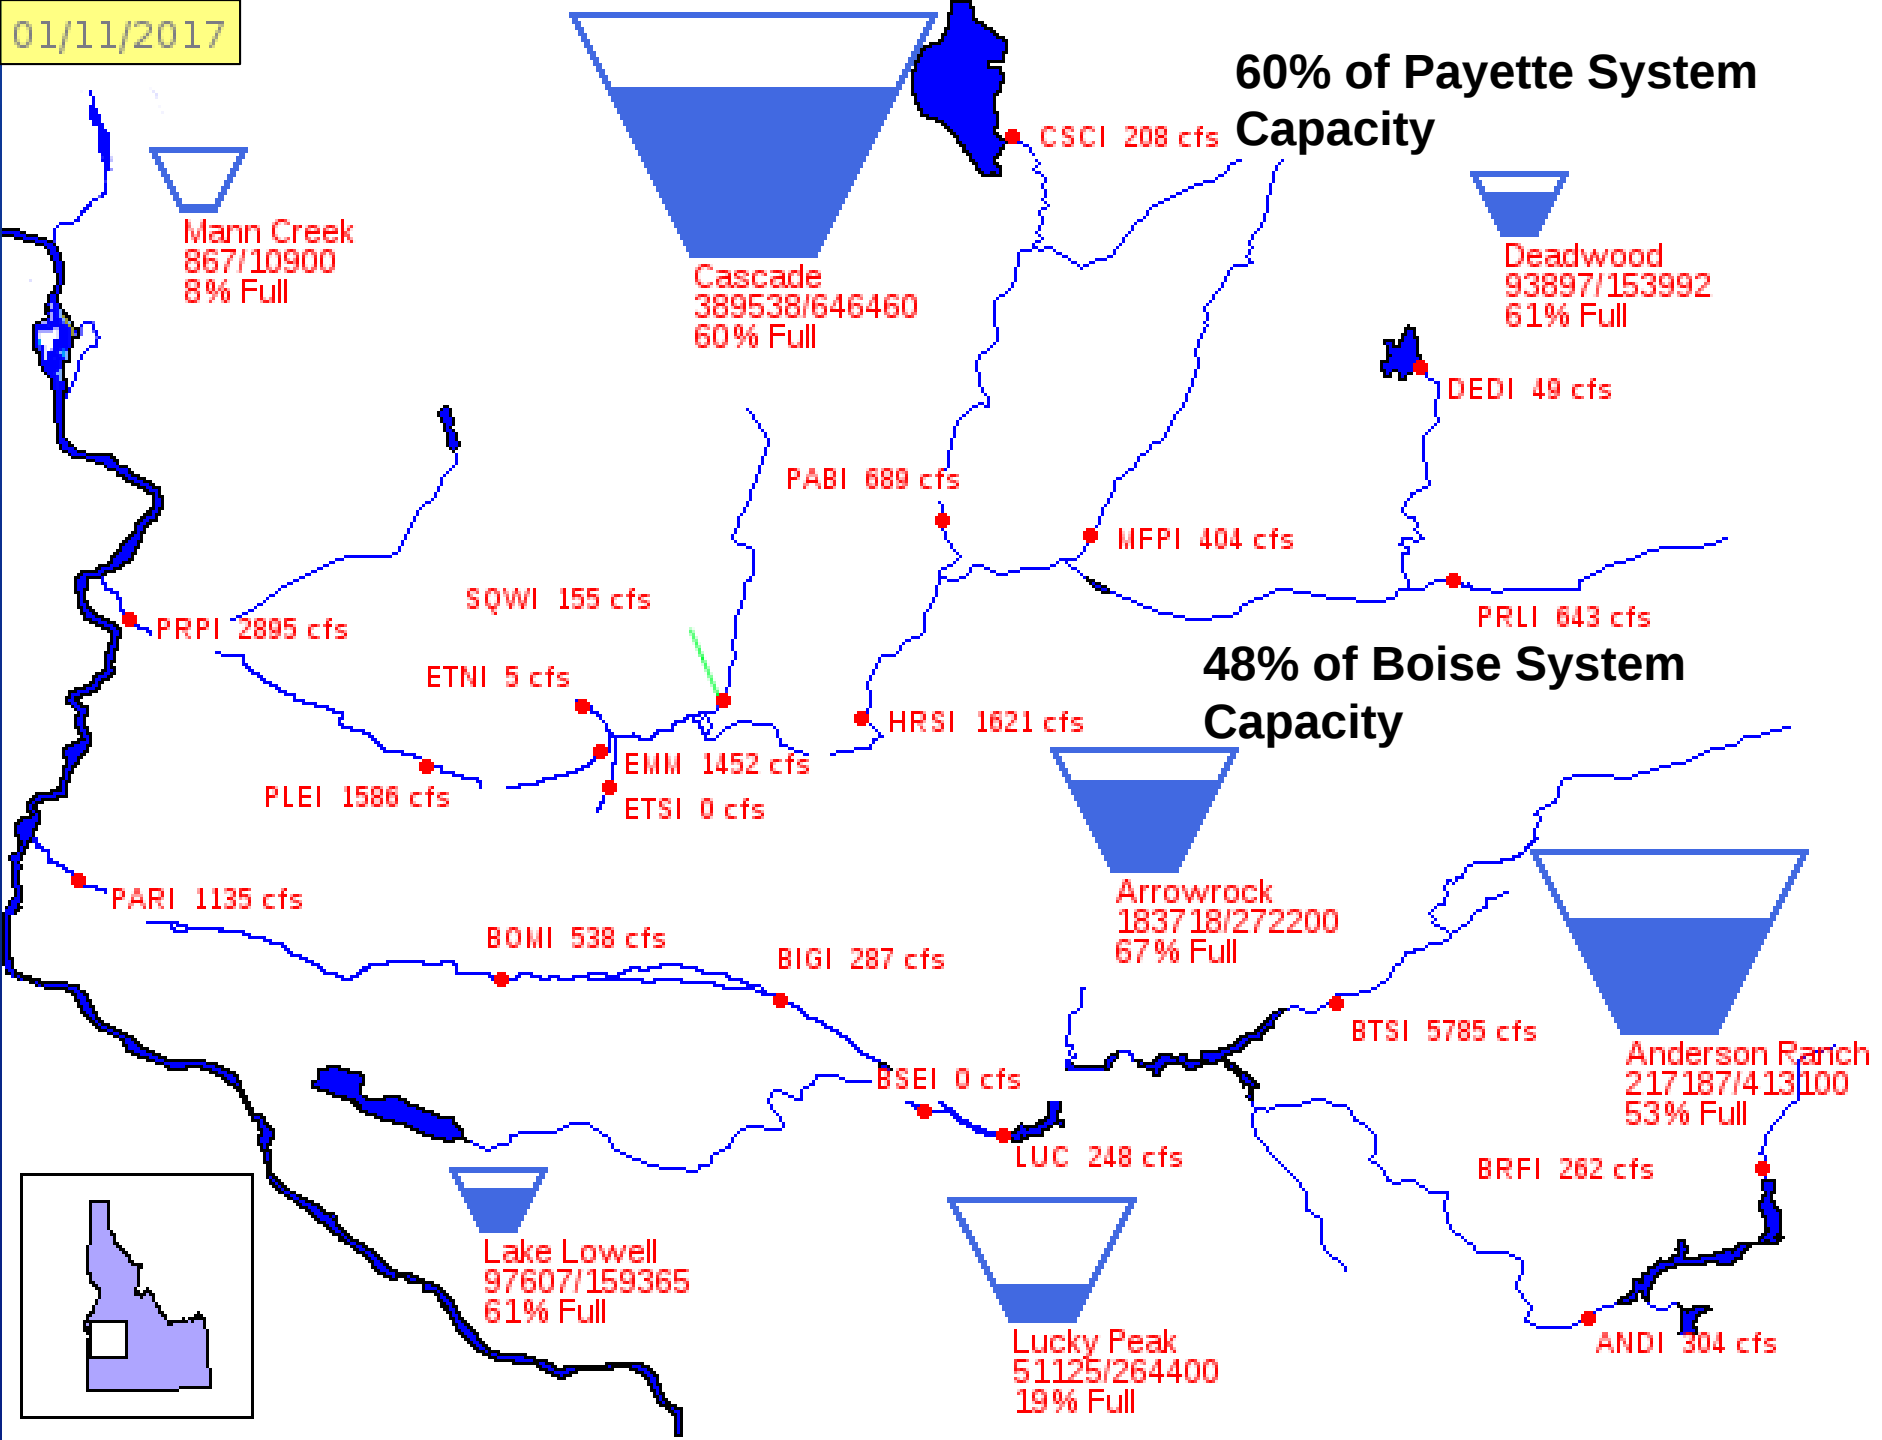

01/14/2016

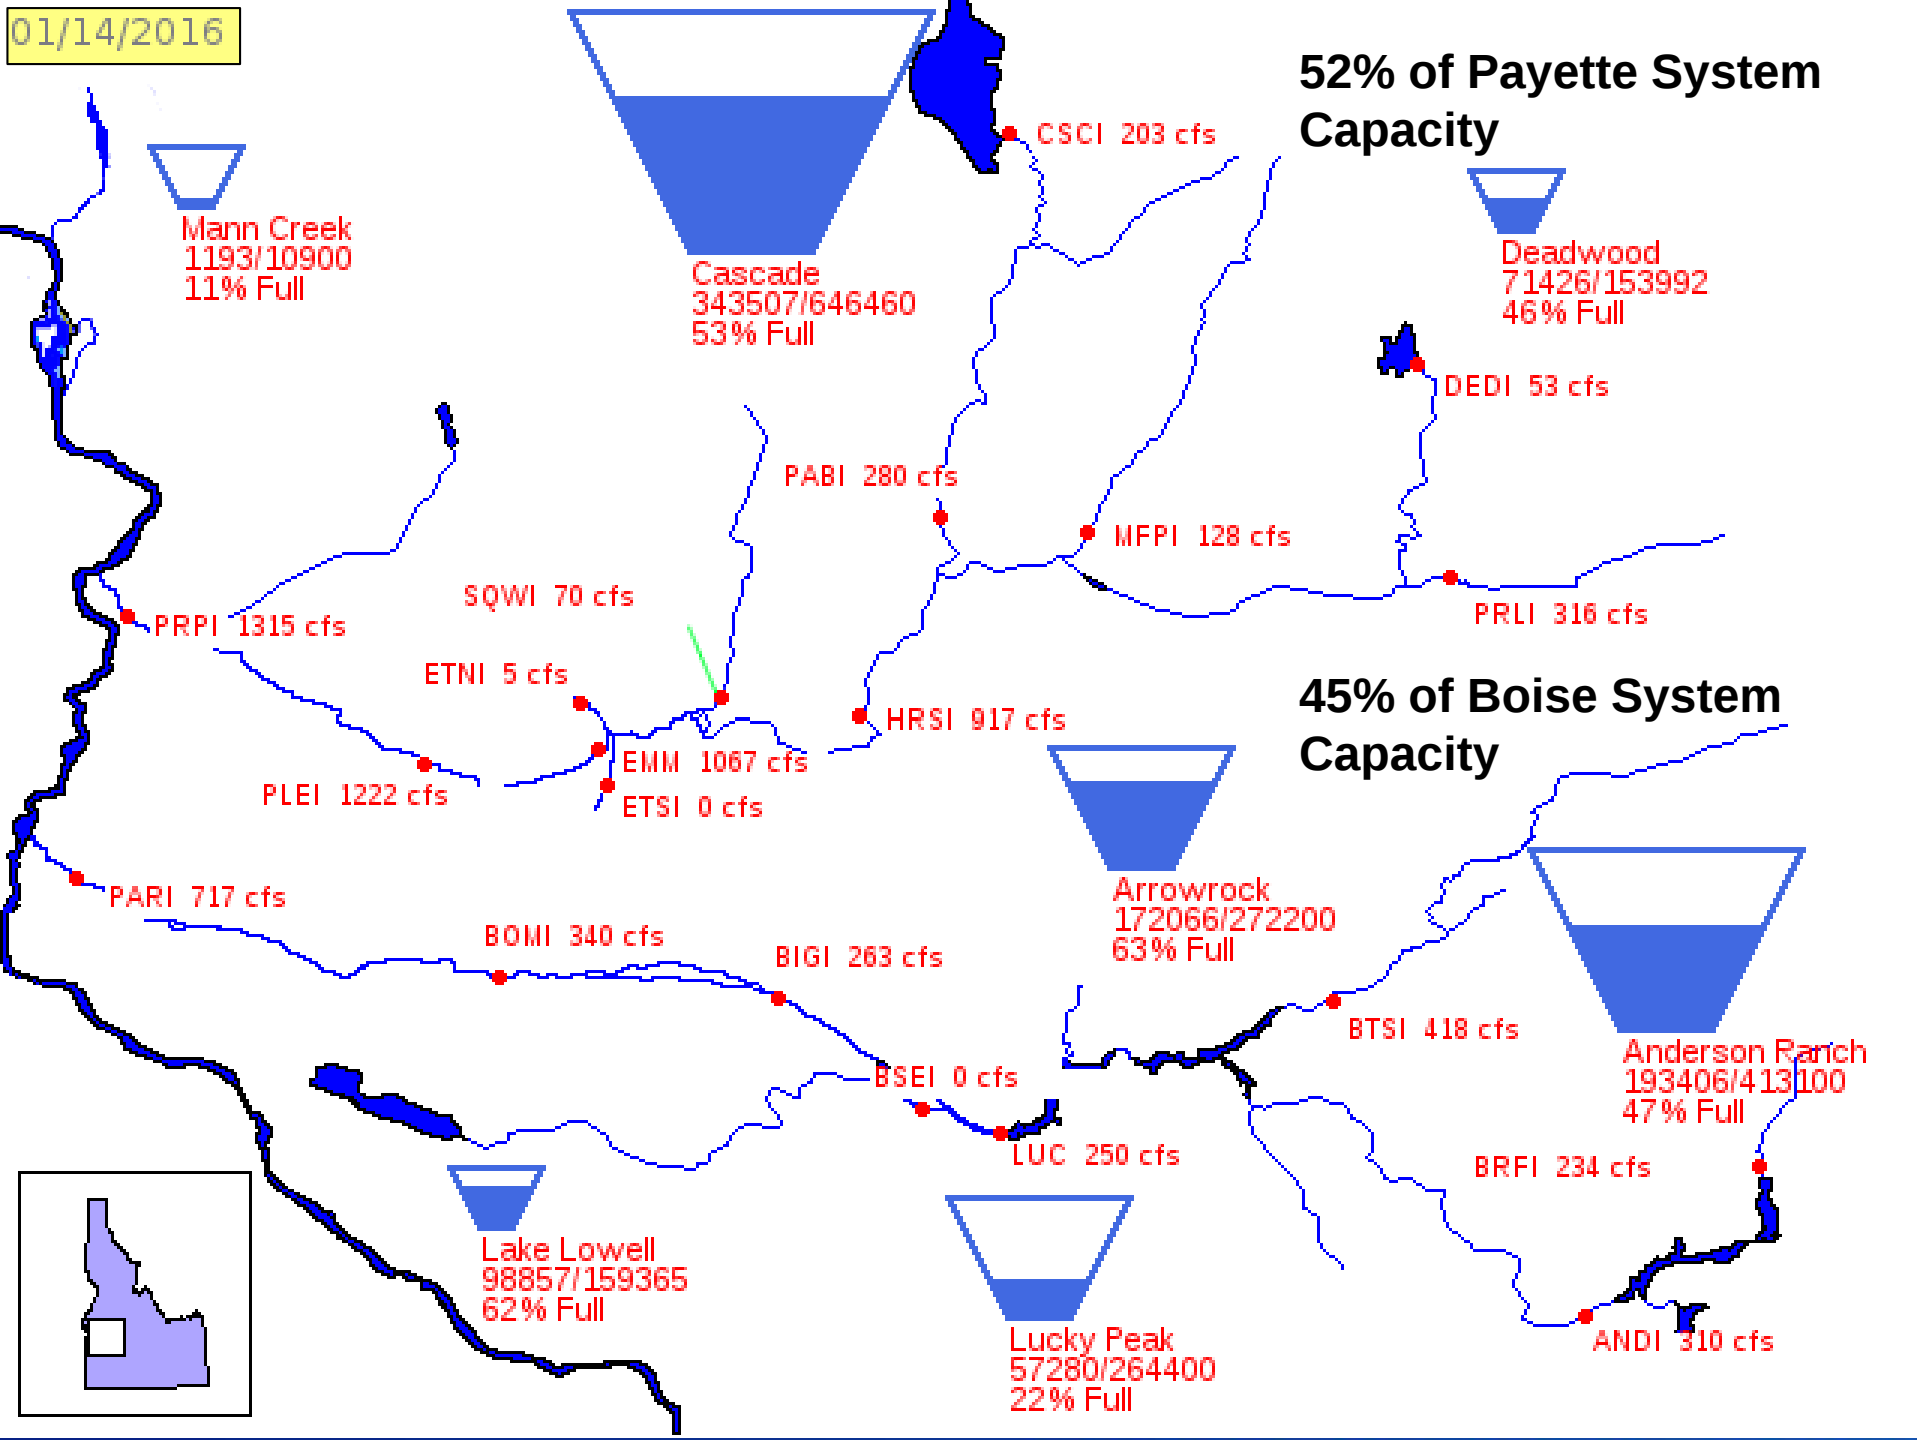


January 1 Boise Reservoir System Carryover (average = 455,000 ac-ft)

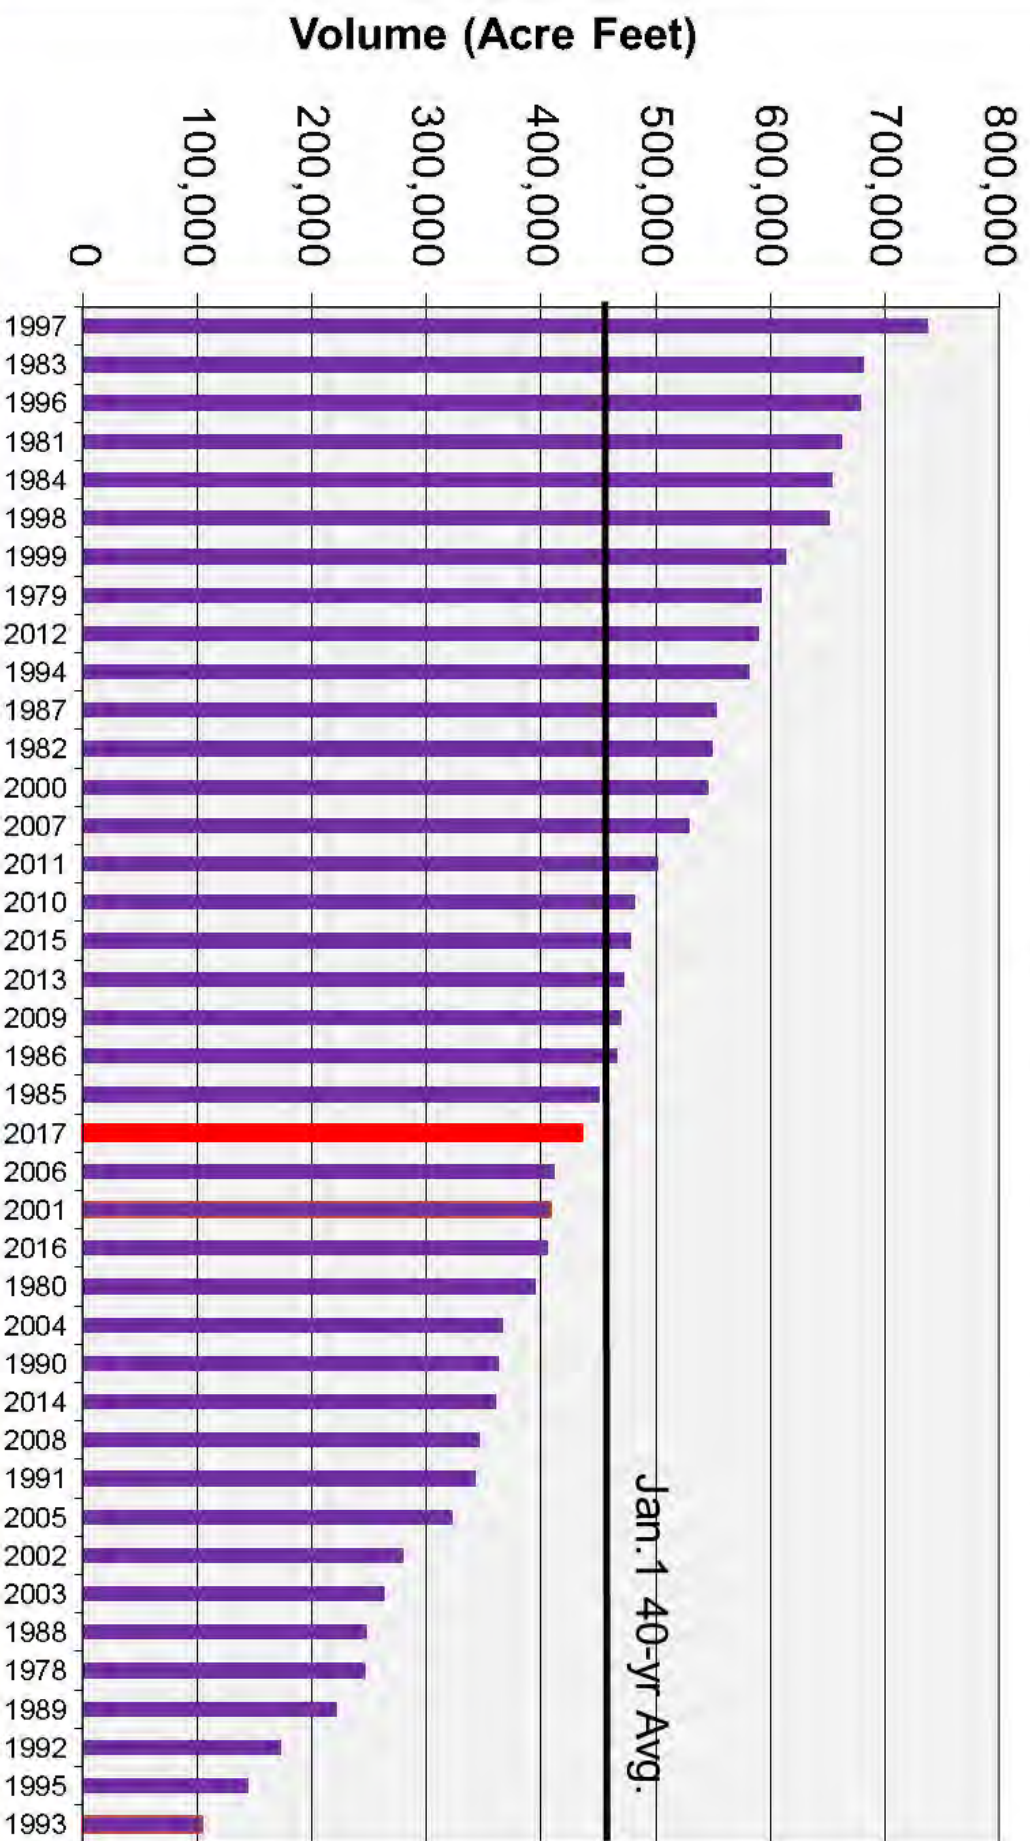

Boise River Reservoir System Storage (capacity = 949,600 ac-ft)


2017 2016 2014 2013 30-yr Avg.

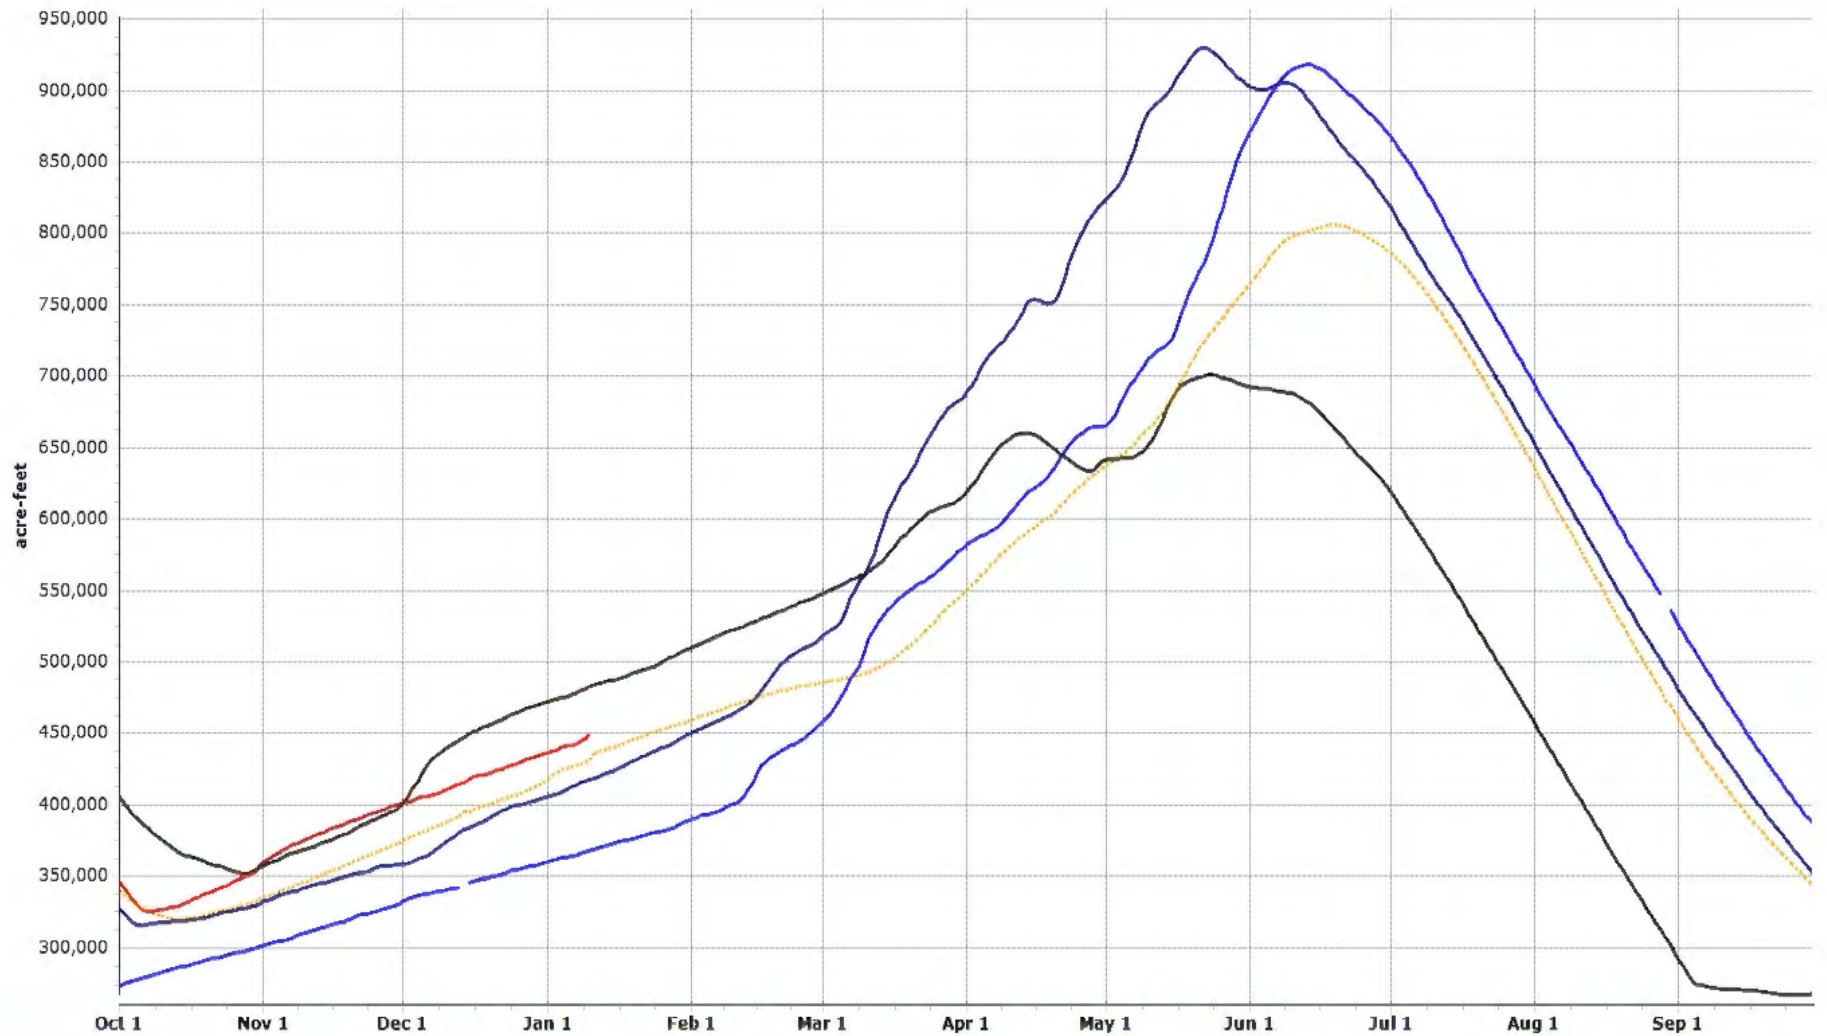

RECLAMATION

Boise Basin Runoff

January-July

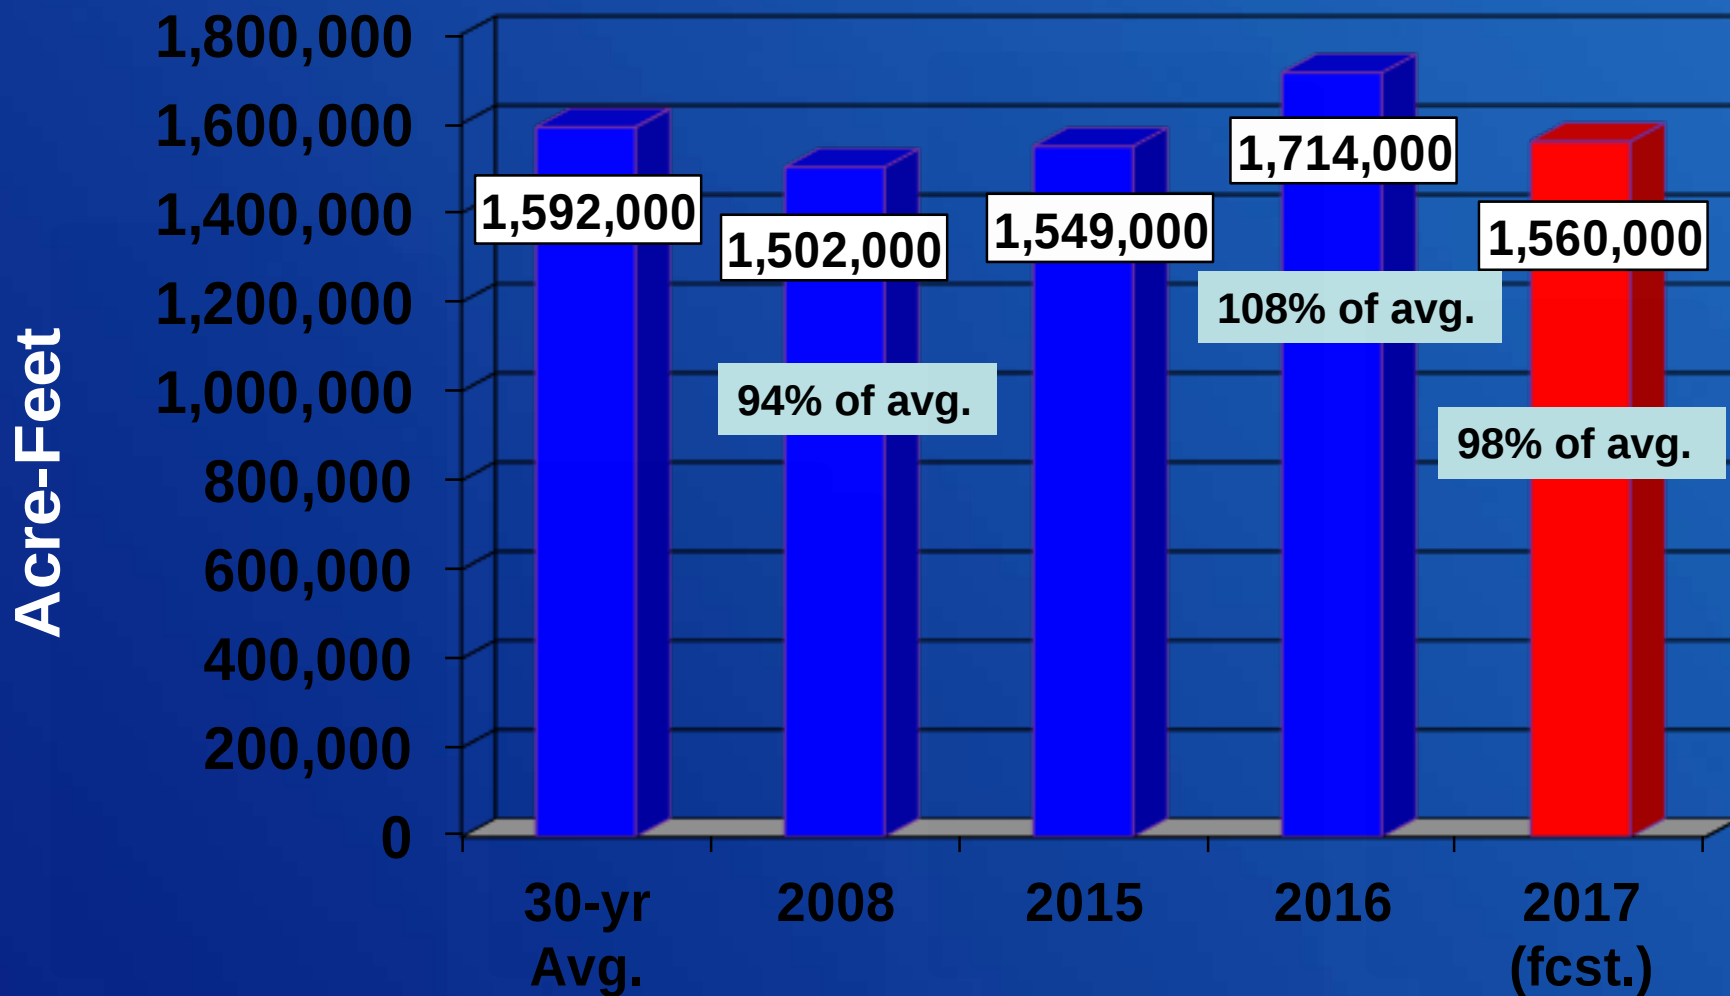

RECLAMATION


Payette Basin






Payette Basin Runoff

January – July

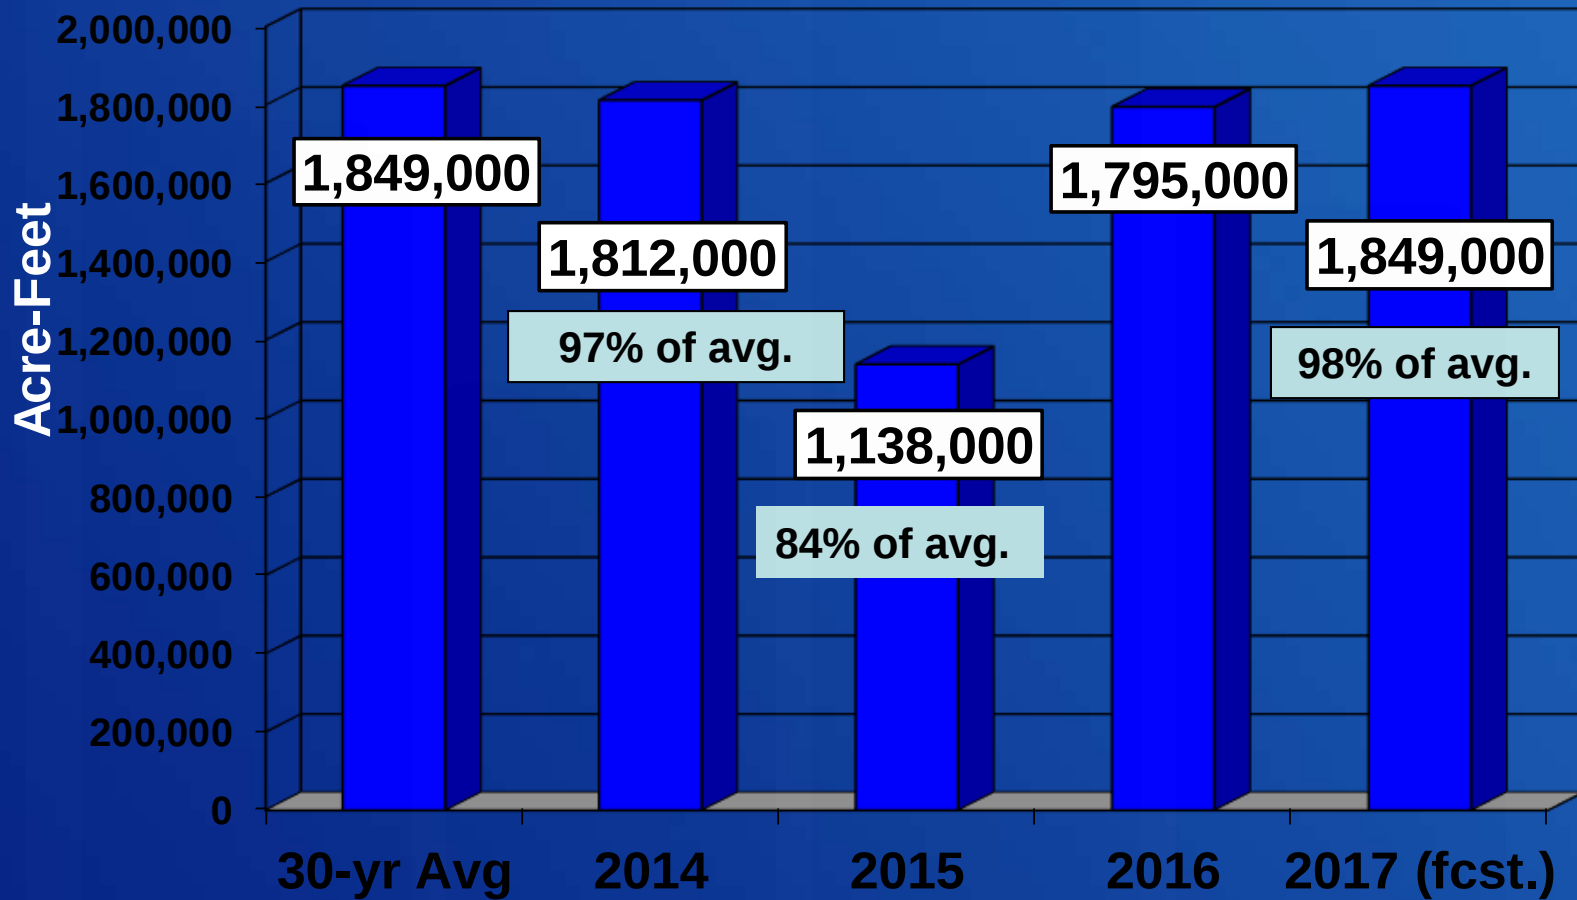


RECLAMATION

January 1 Payette River Reservoir System Carryover (average = 475,200 af)

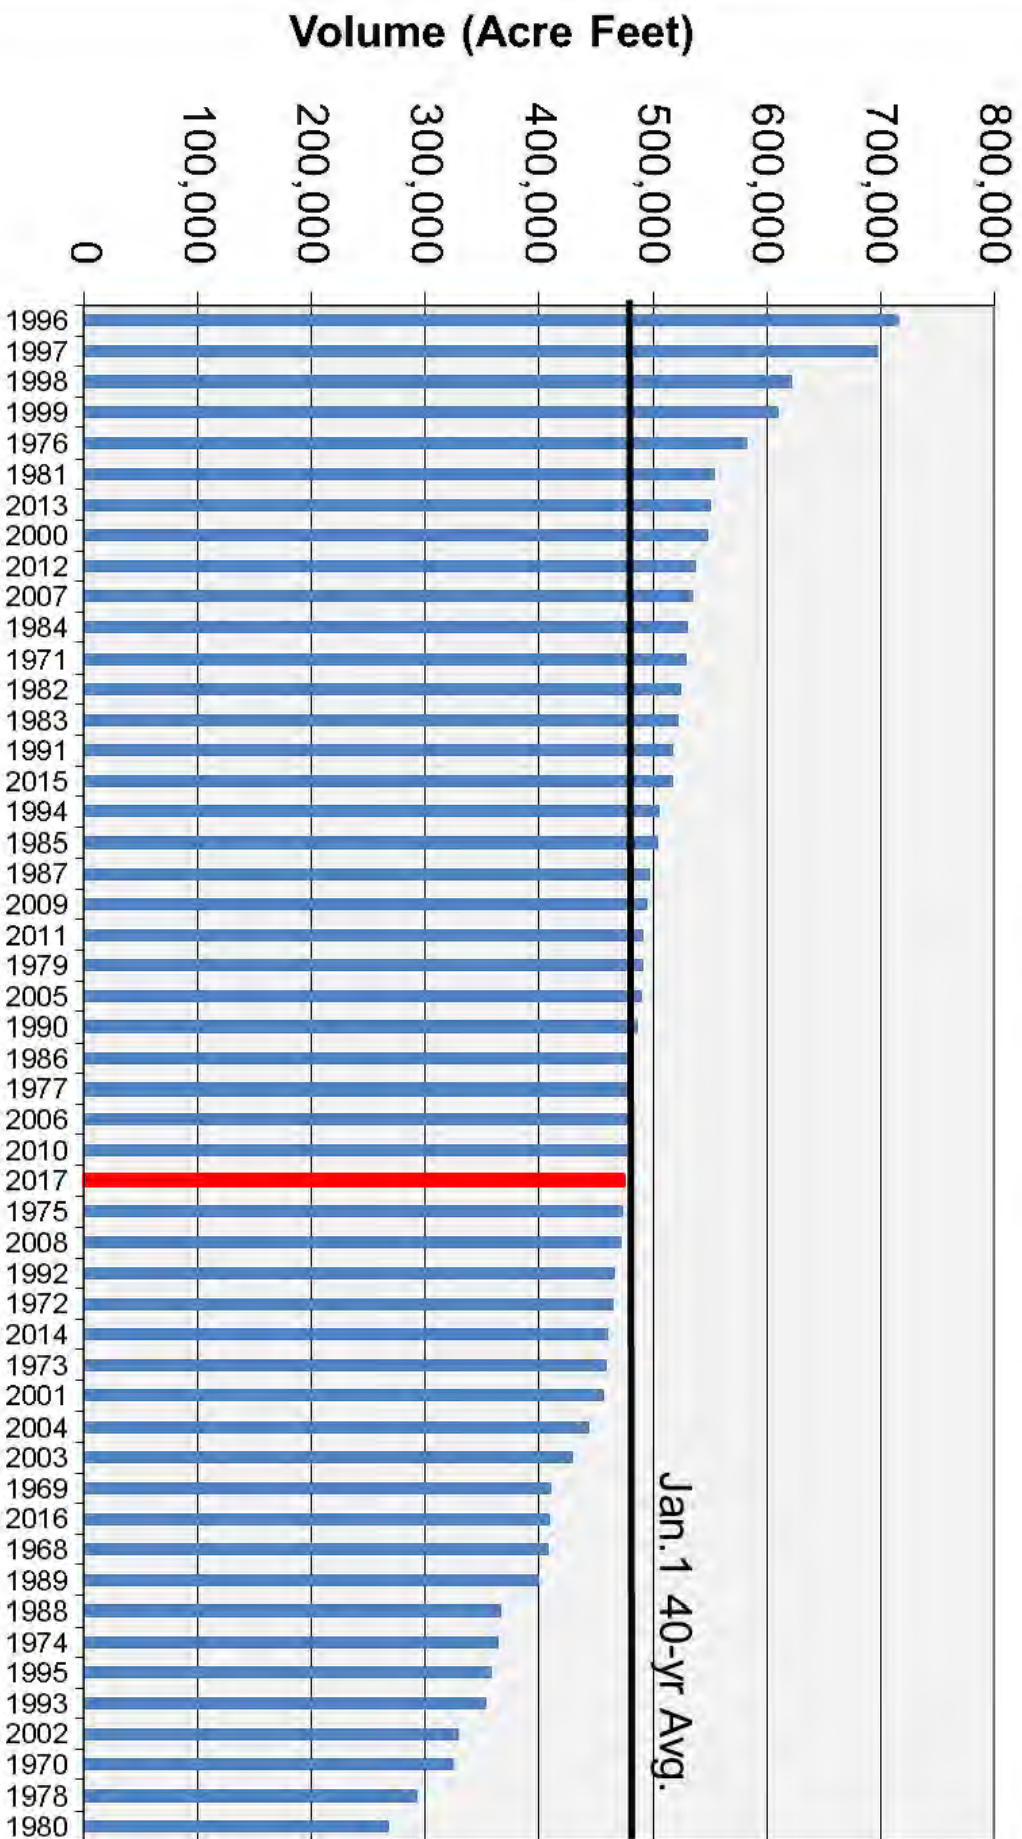

Cascade Reservoir Storage (capacity = 646,460 af)


2017 2016 2014 2013 30-yr avg.

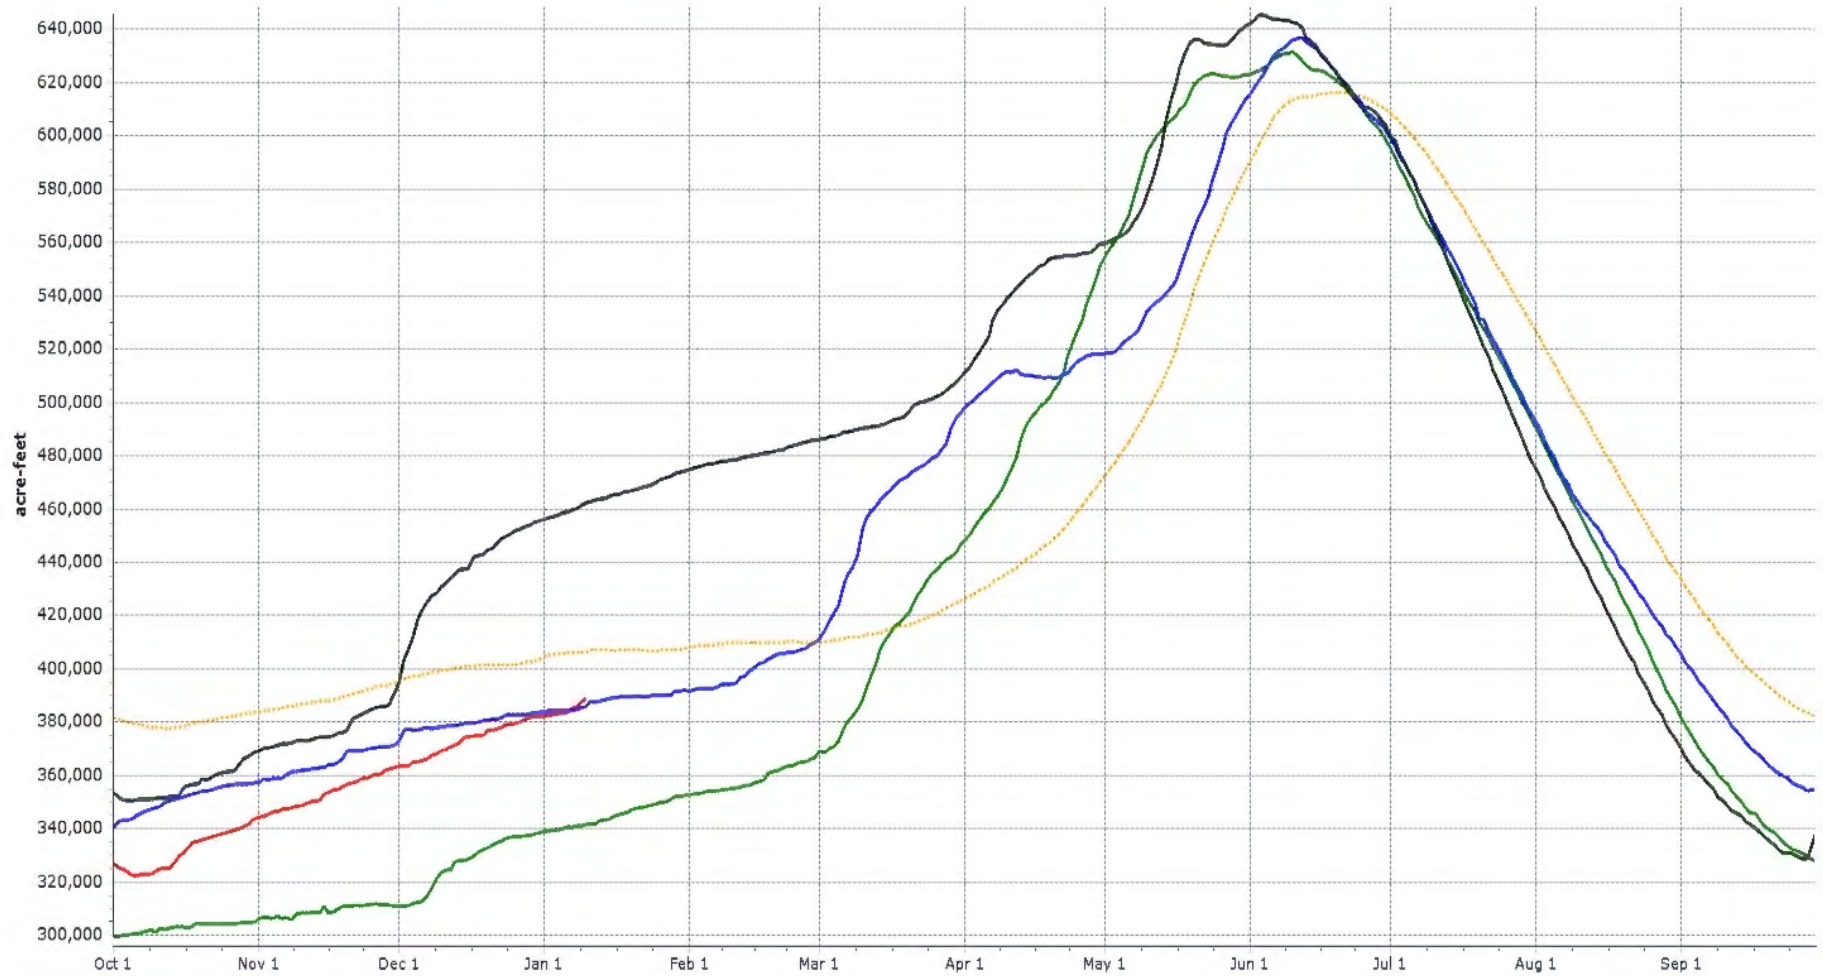

RECLAMATION

Deadwood Reservoir Storage (capacity = 154,000 ac-ft)


2017 2016 2014 2013 30-yr Avg.

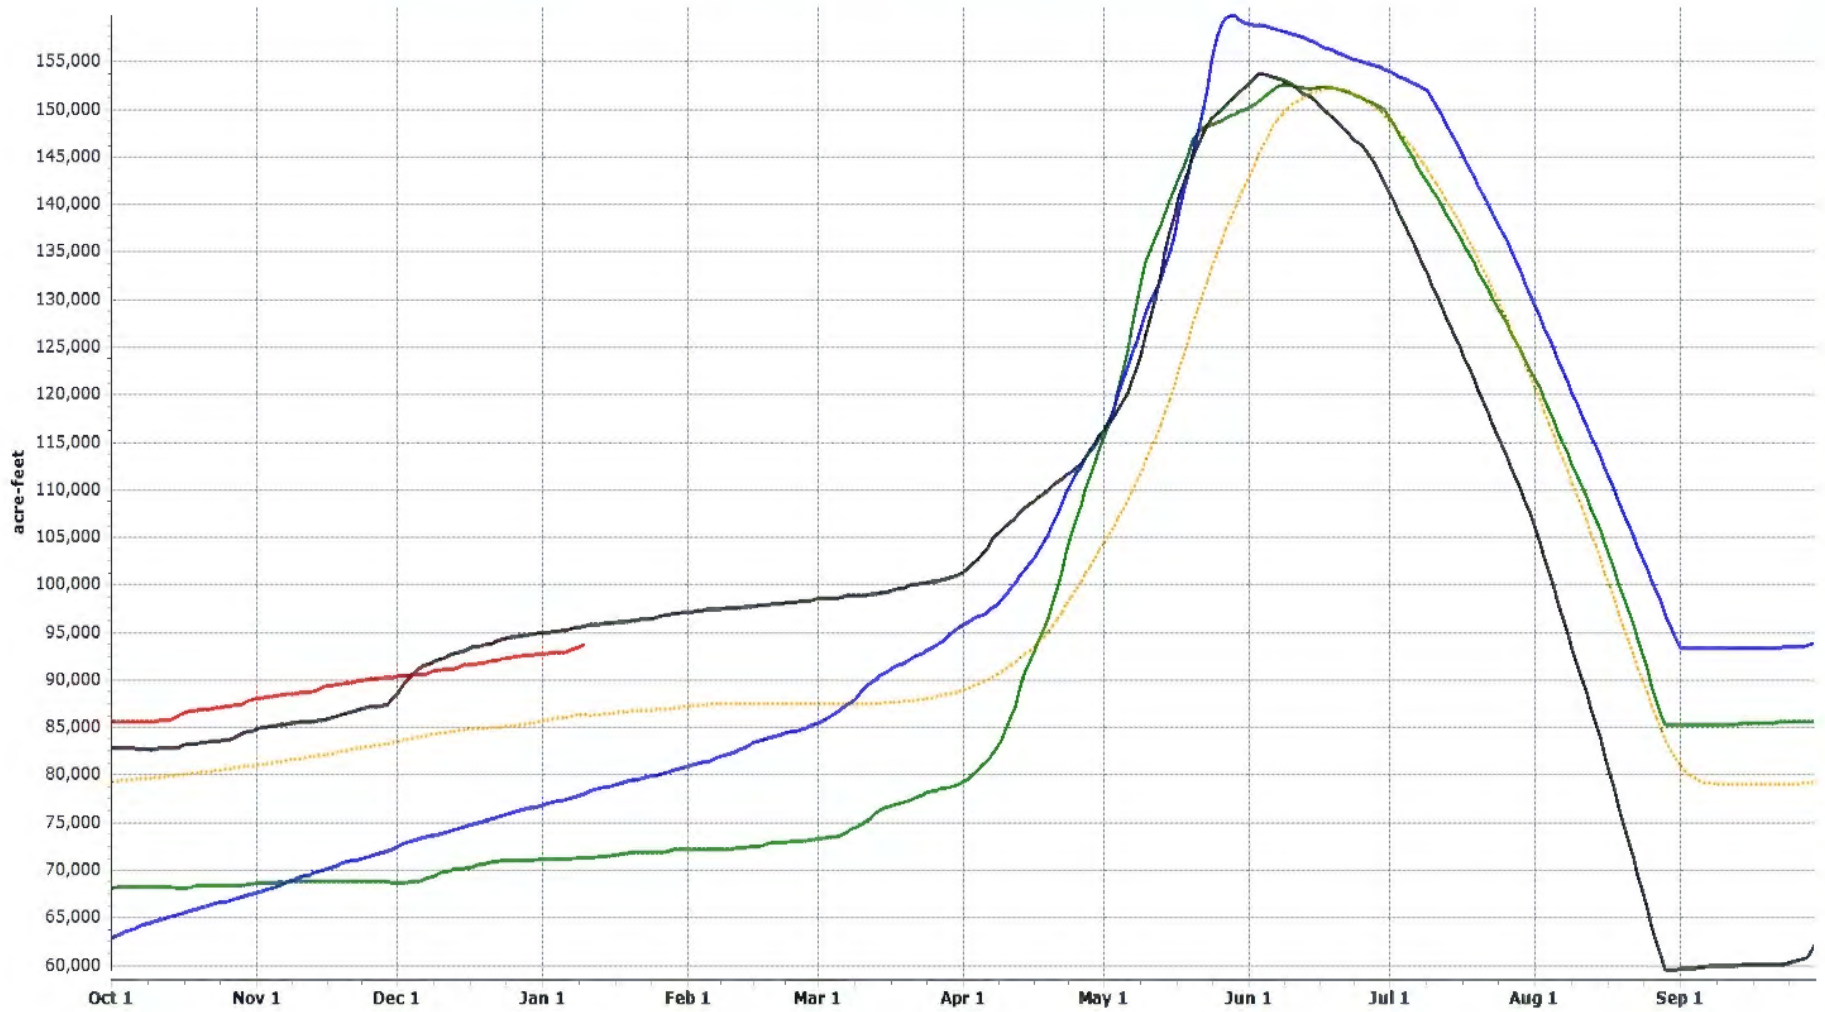



RECLAMATION

Owyhee River Basin




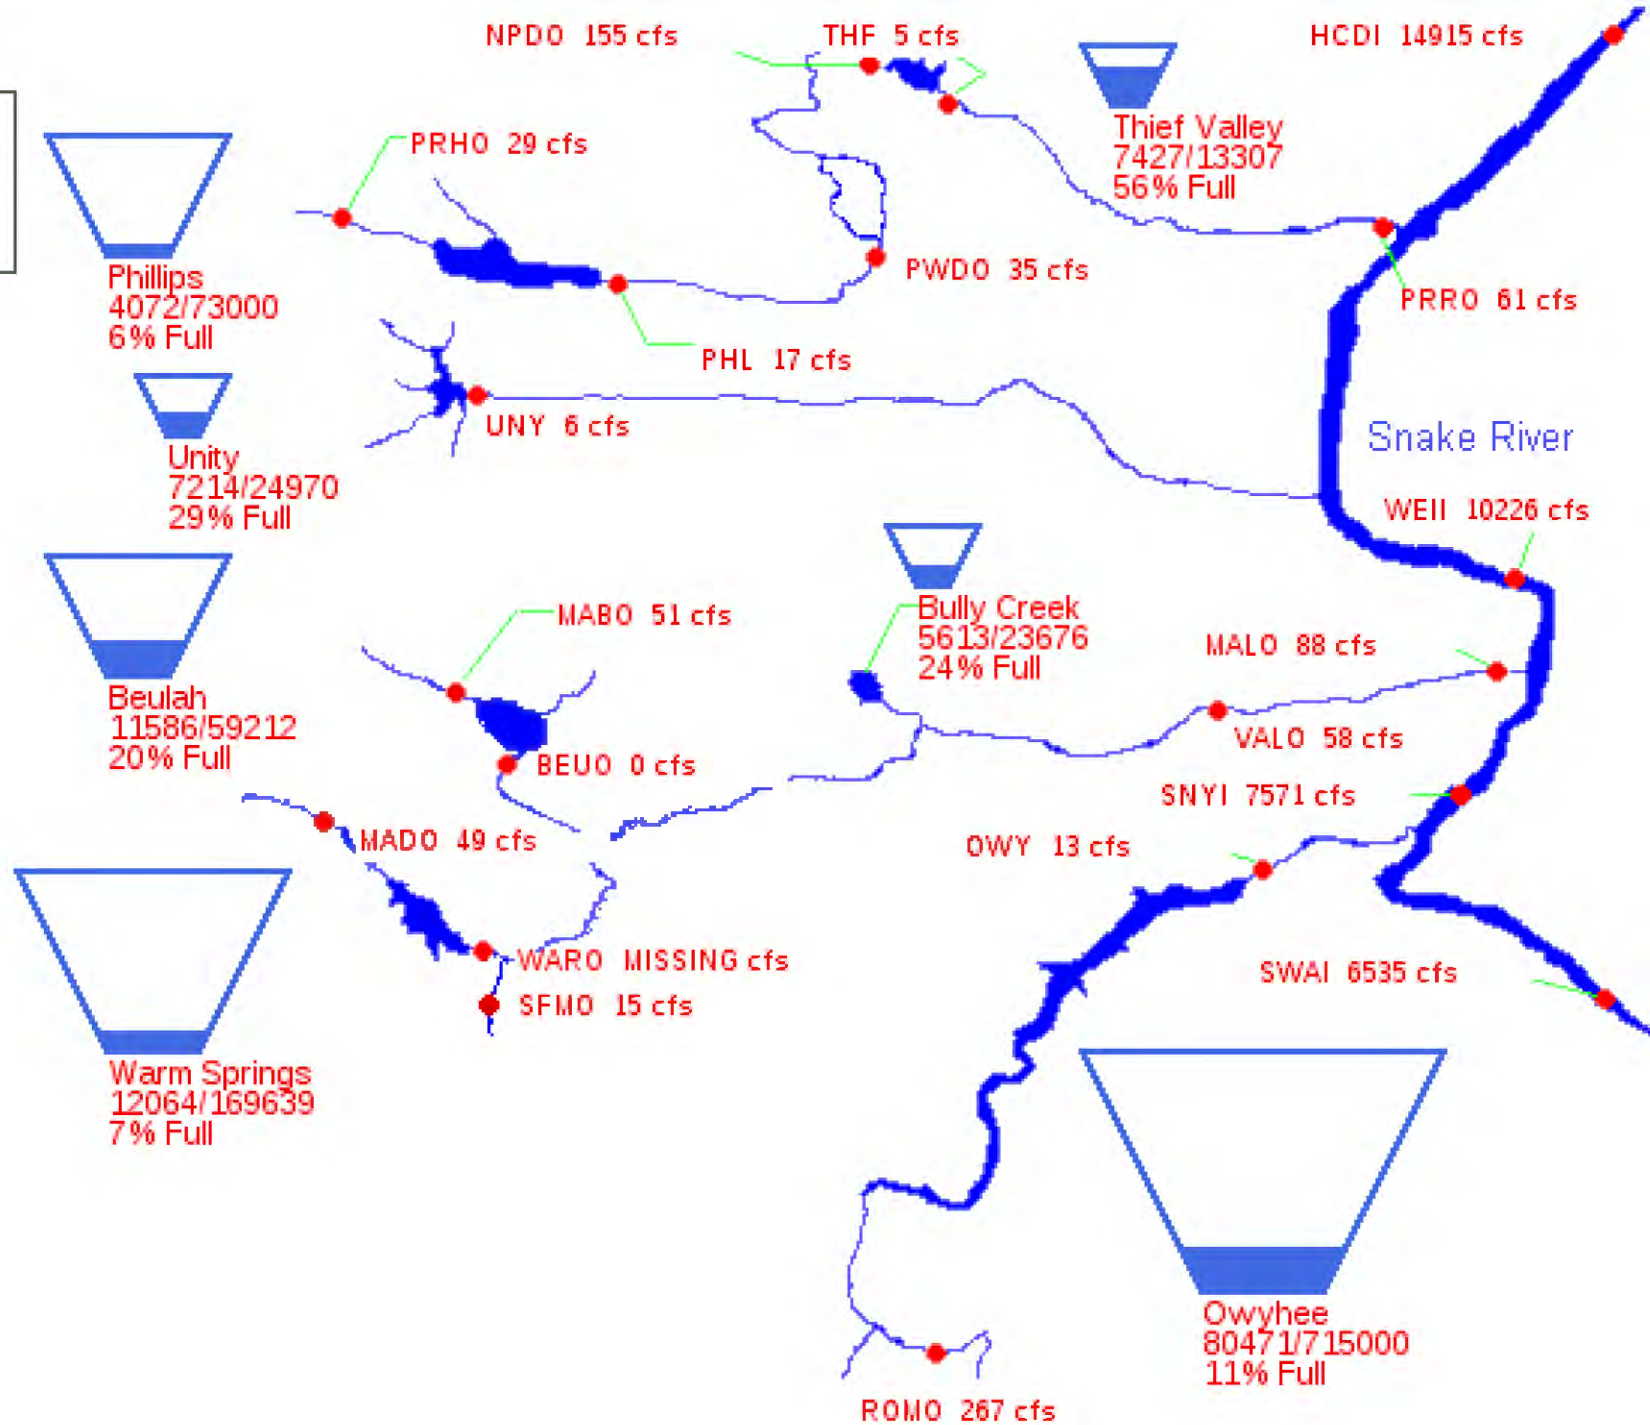

01/11/2017

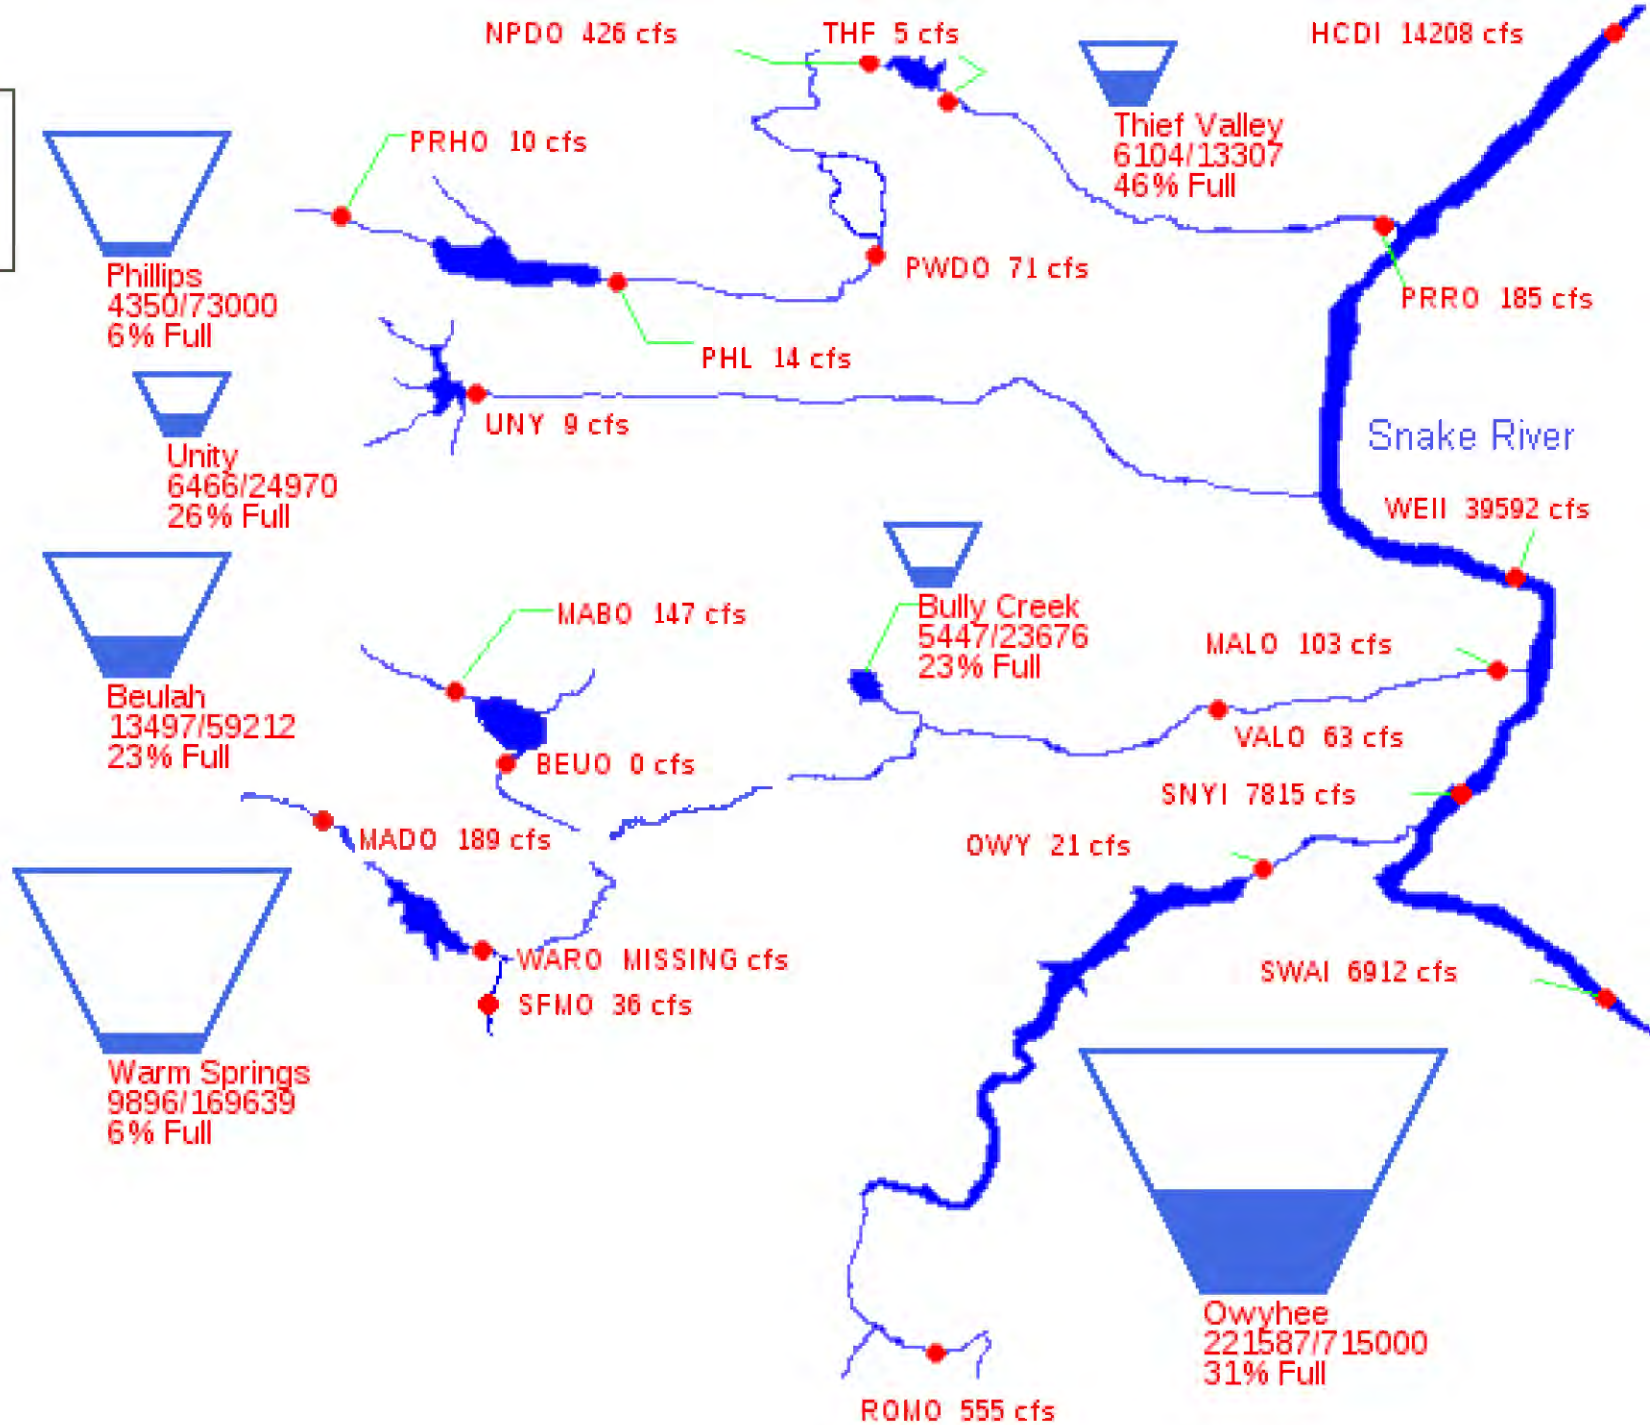


Owyhee Reservoir Storage (capacity = 715,000 af)

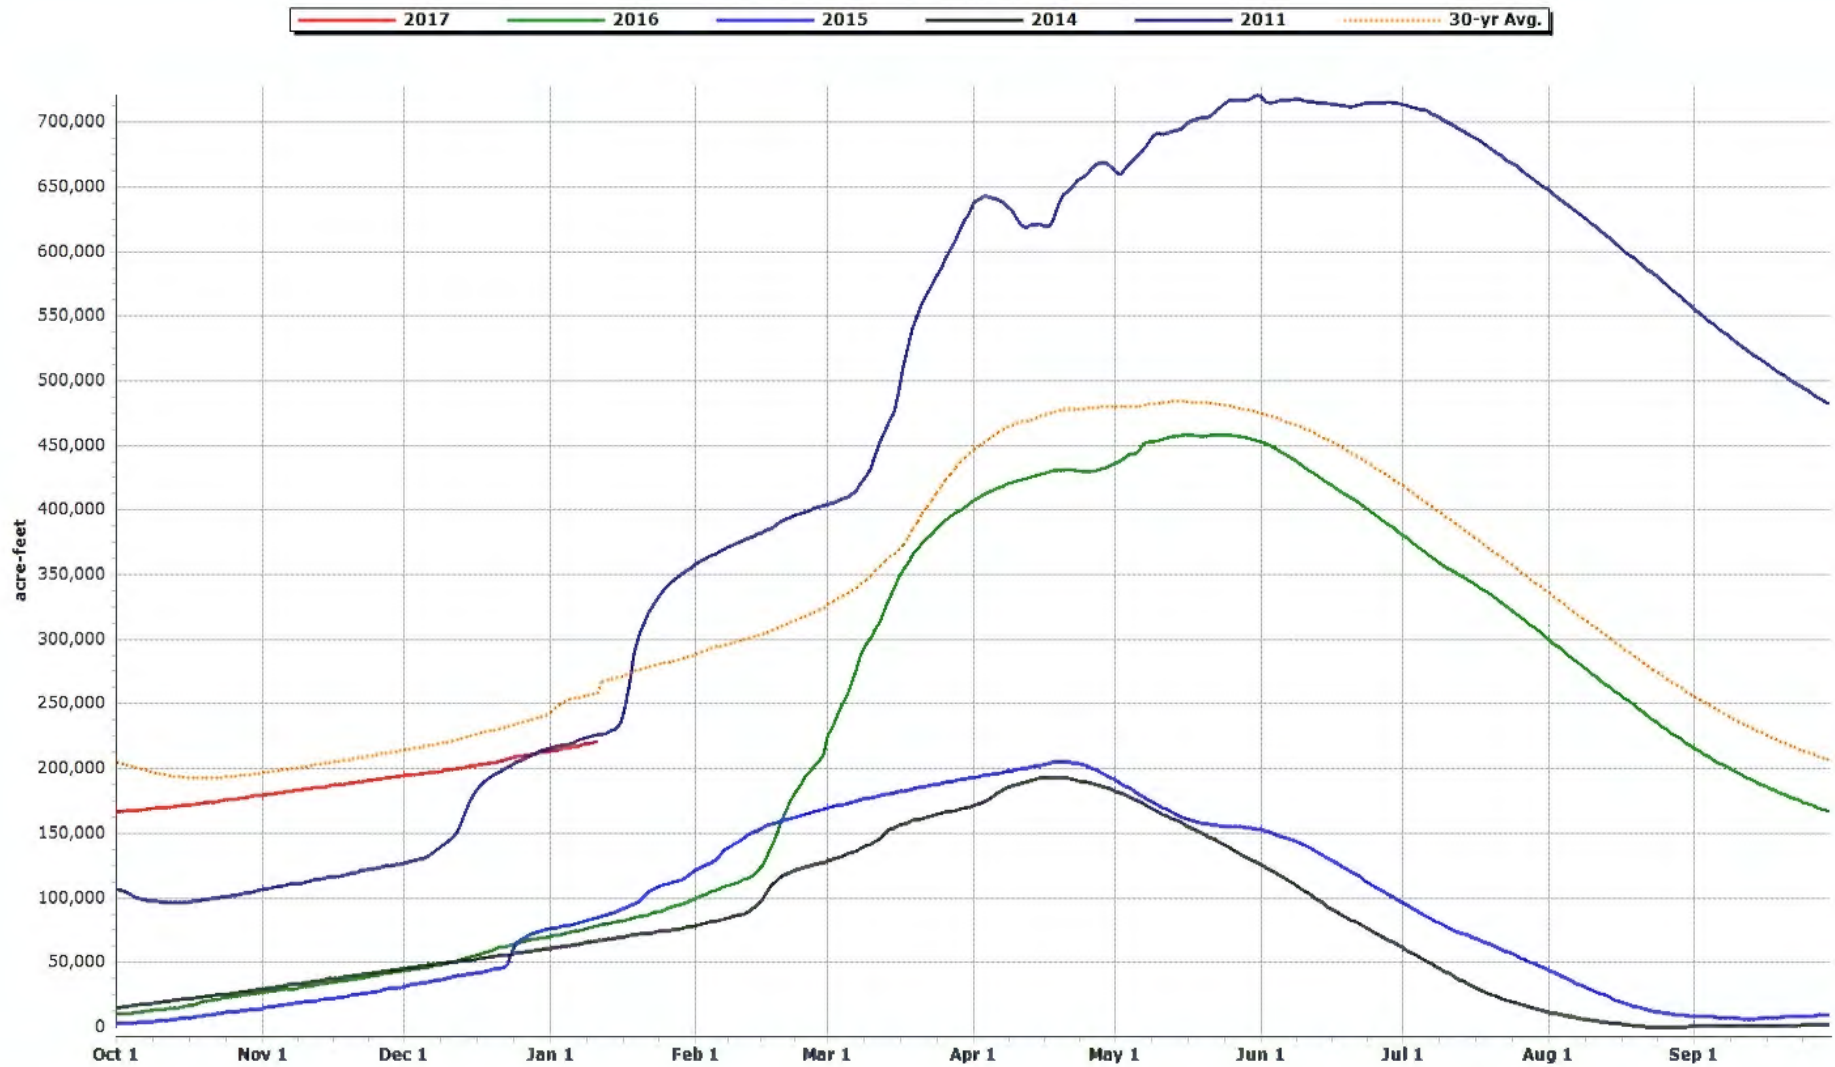

RECLAMATION


January 1 Owyhee Reservoir Carryover

(average = 299,000 ac-ft)

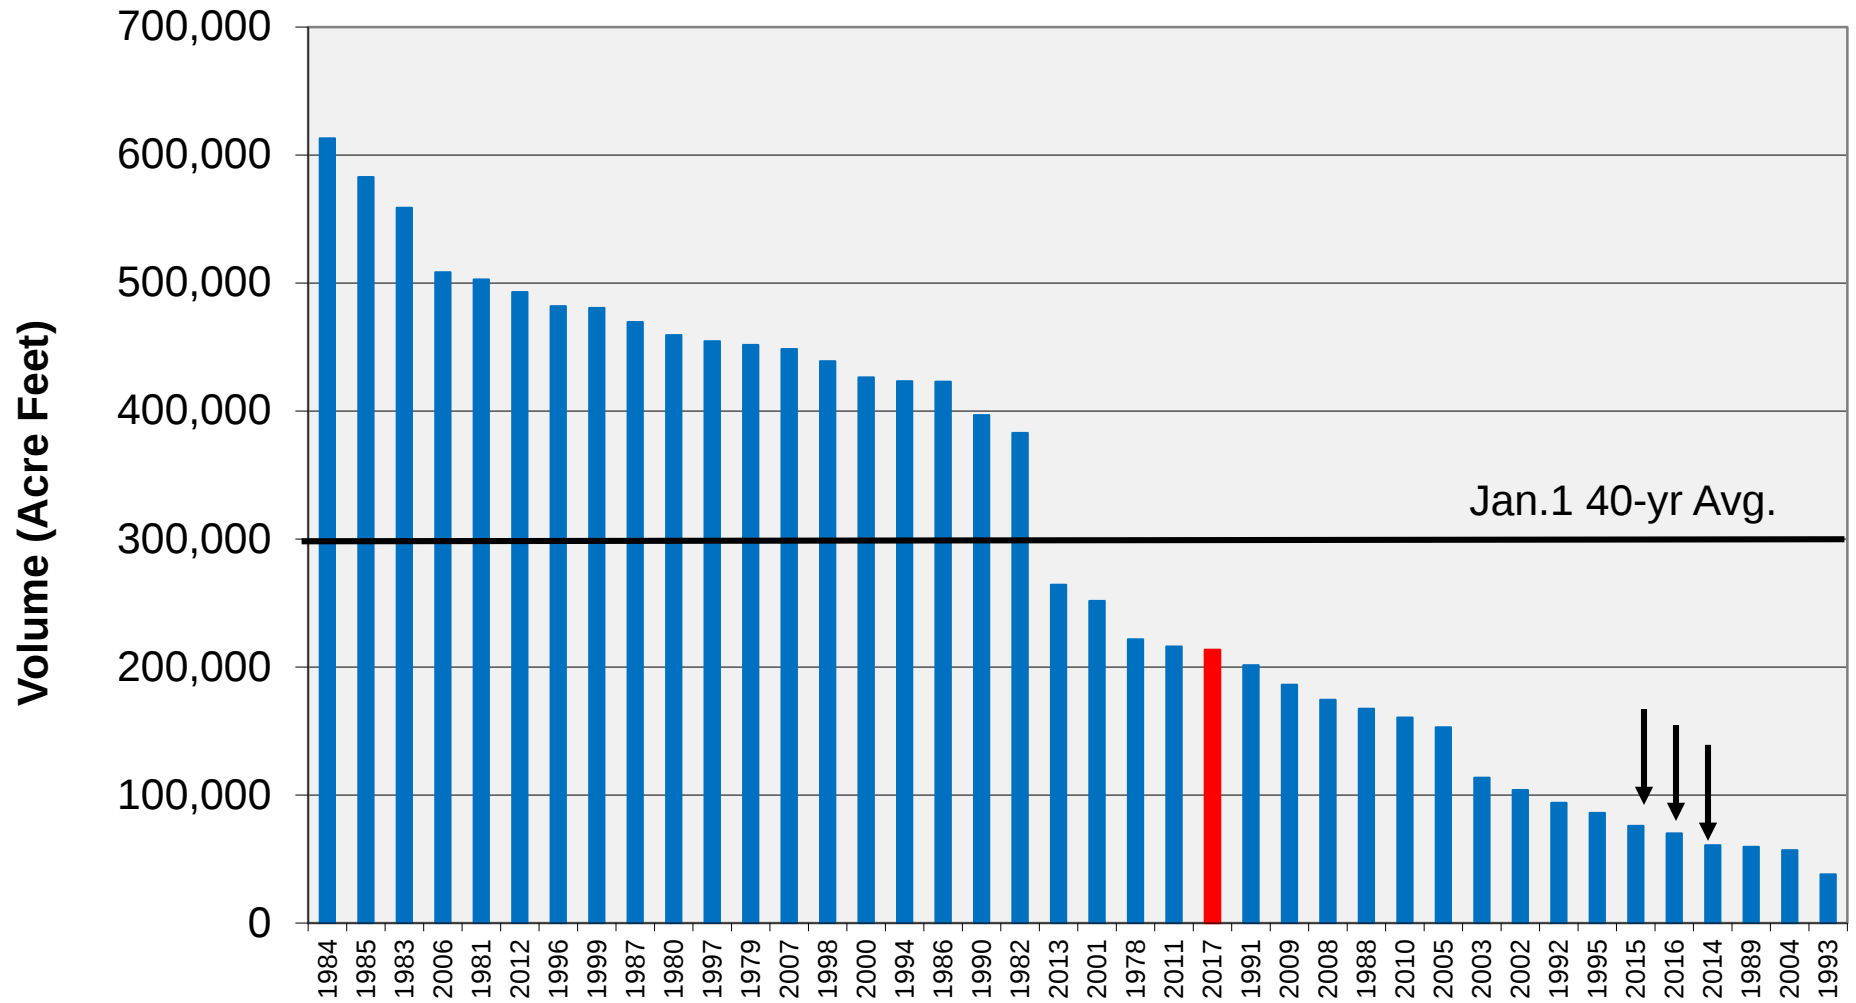

Owyhee Basin Runoff

January -June

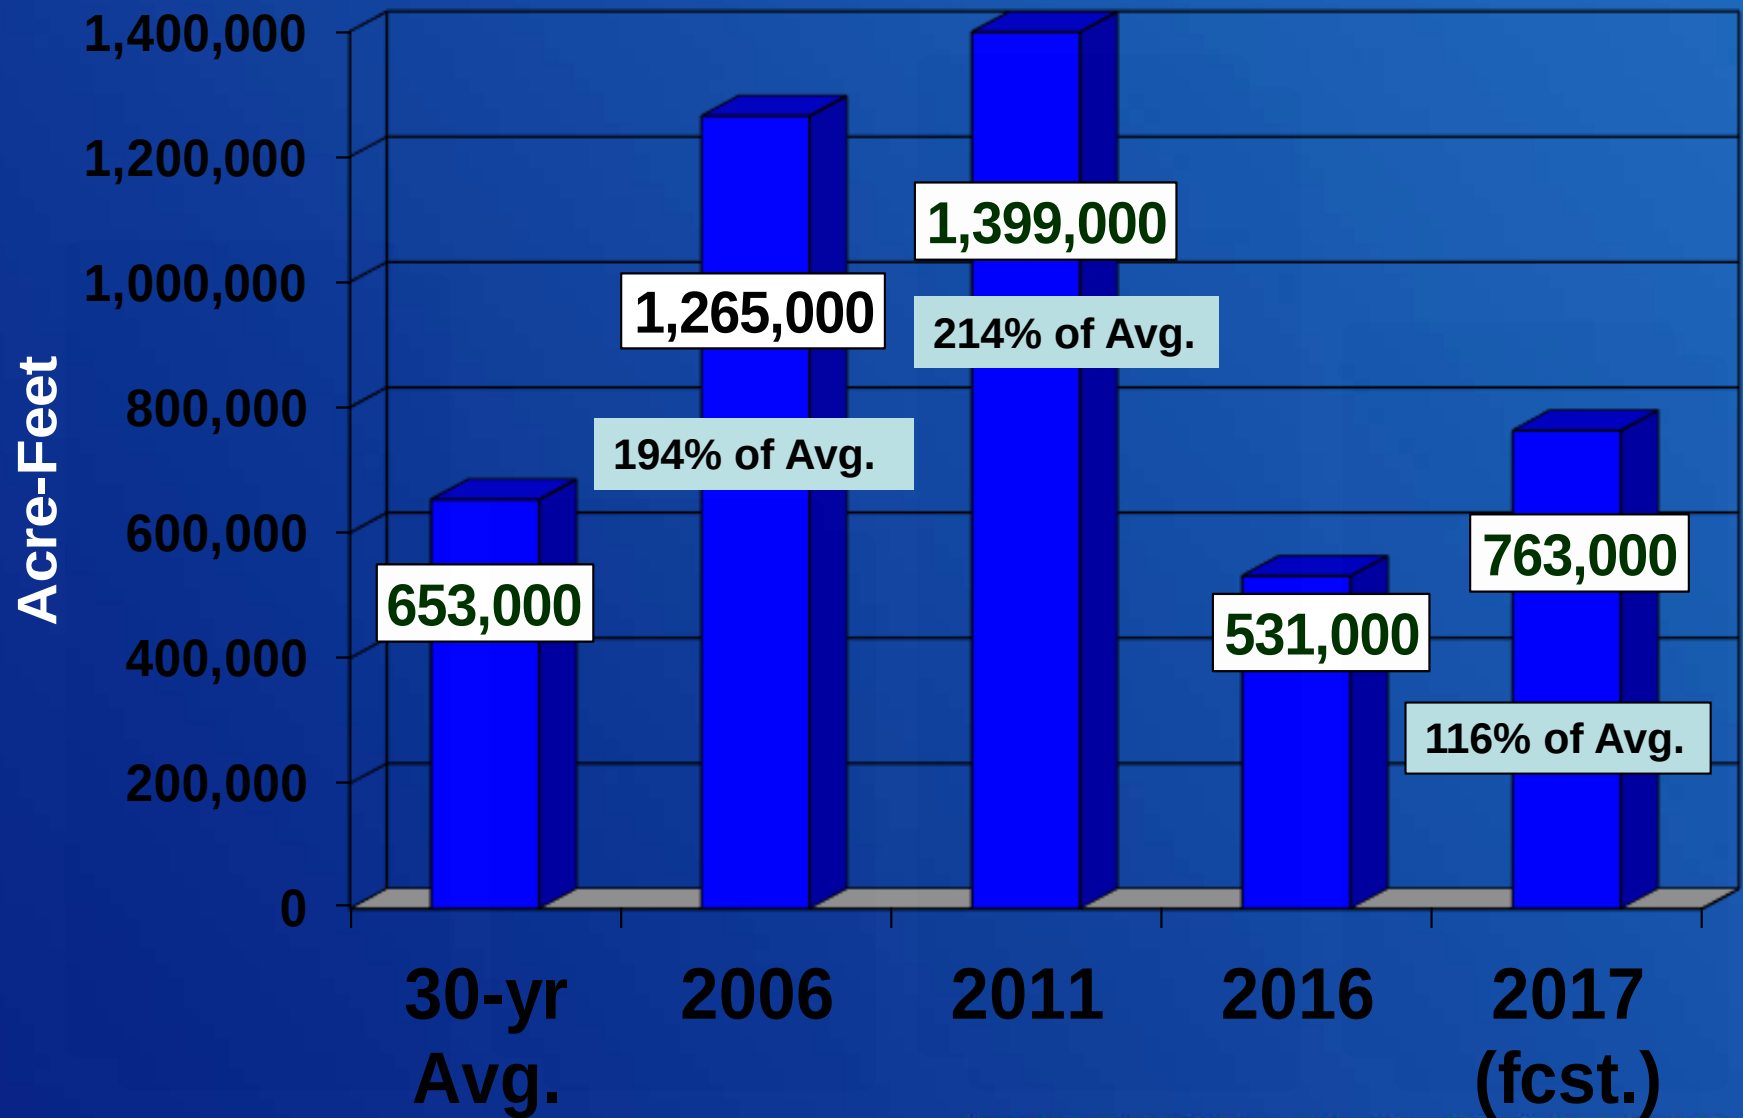

RECLAMATION





