

RECLAMATION

Managing Water in the West

Idaho Water Supply Committee Meeting

Southwest Idaho Report
February 8, 2017





U.S. Department of the Interior
Bureau of Reclamation

Boise River Basin




02/11/2016

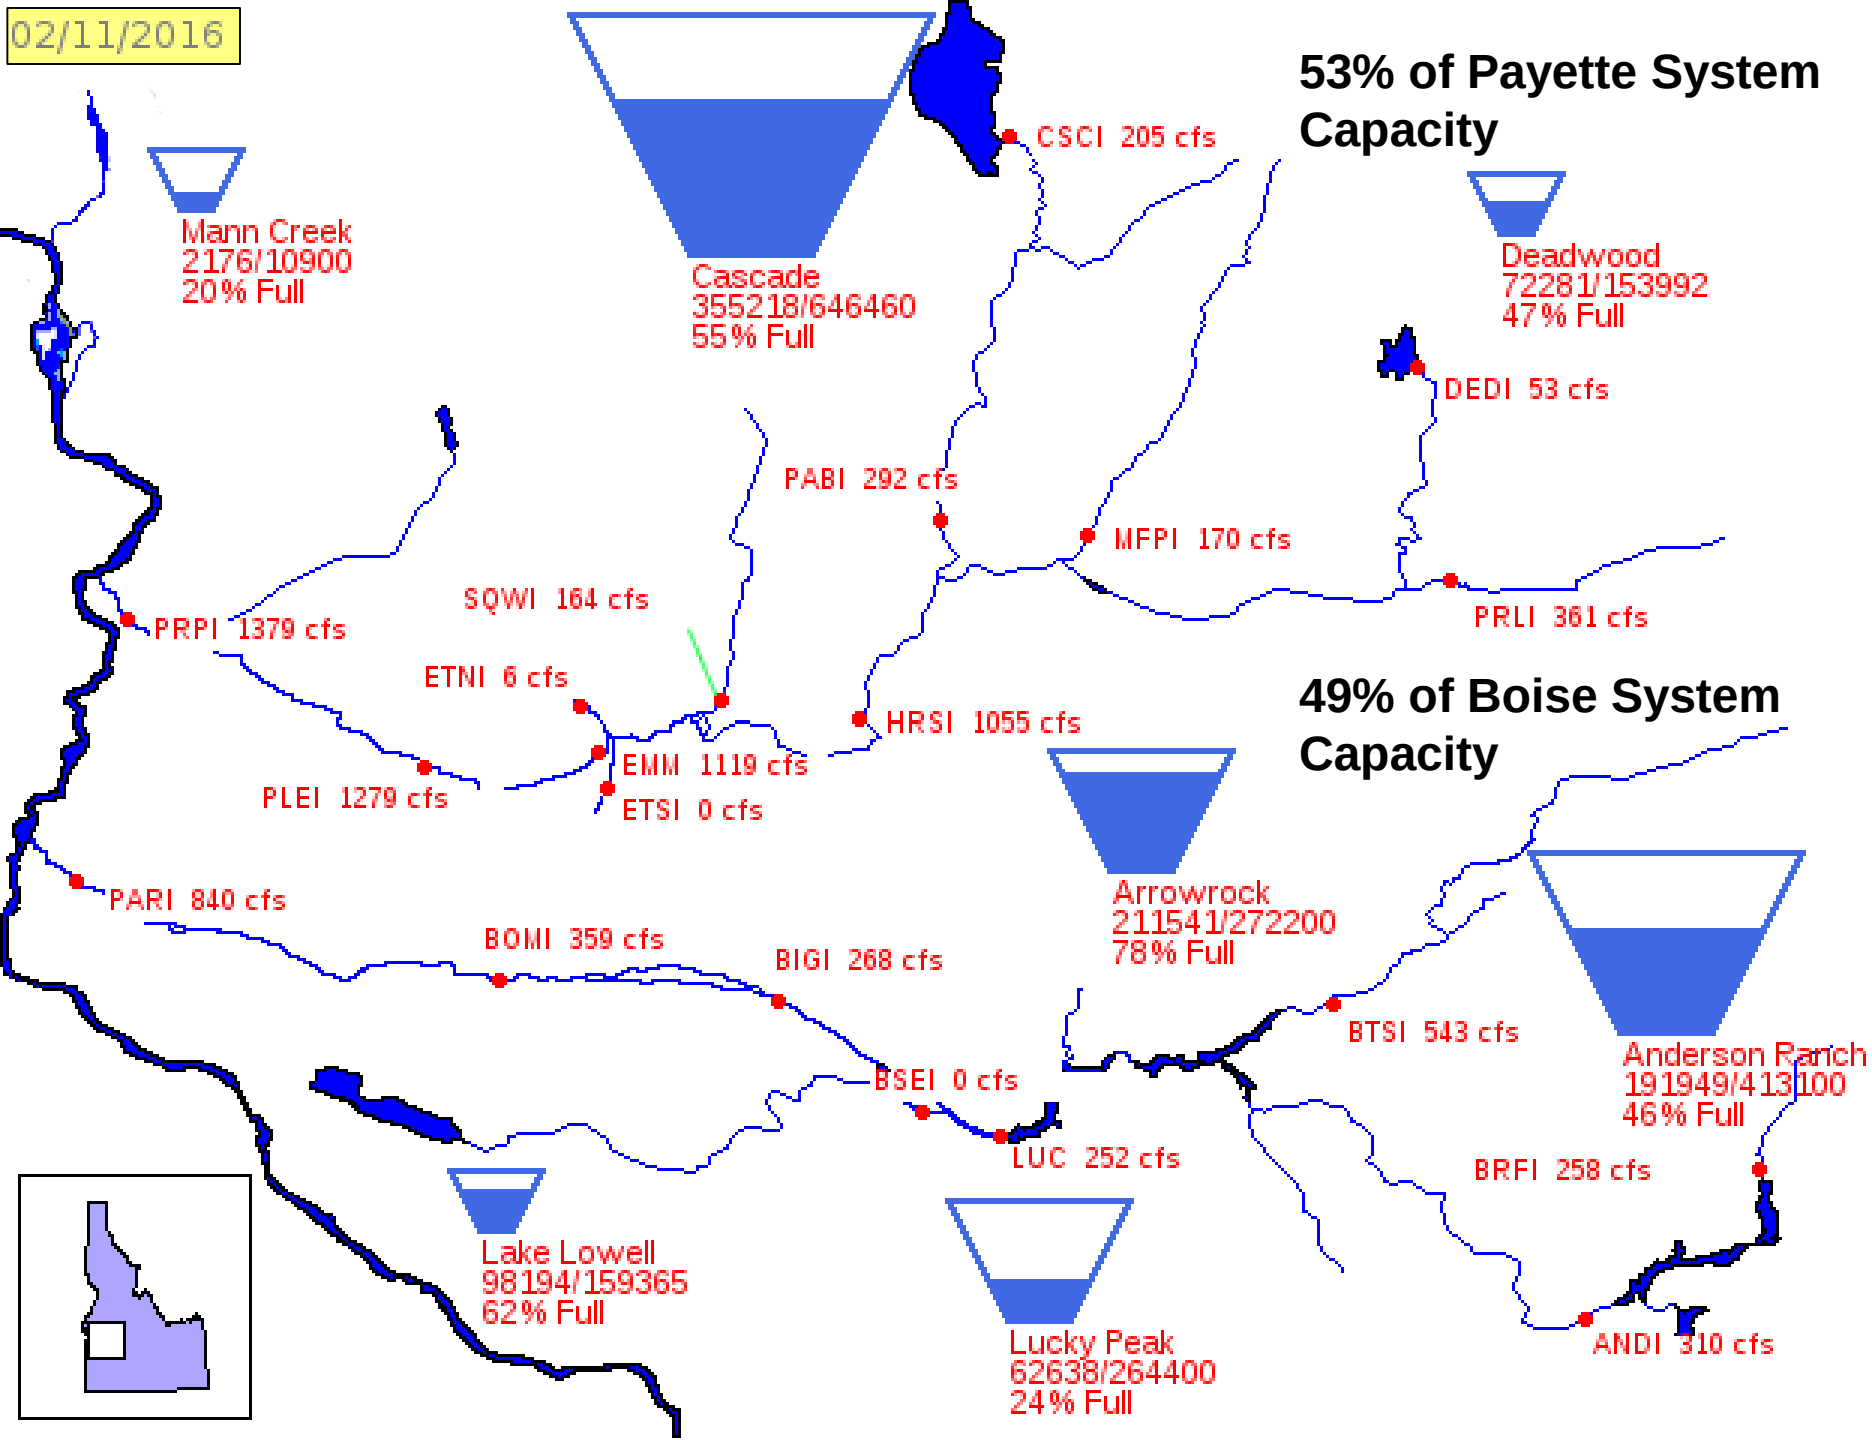

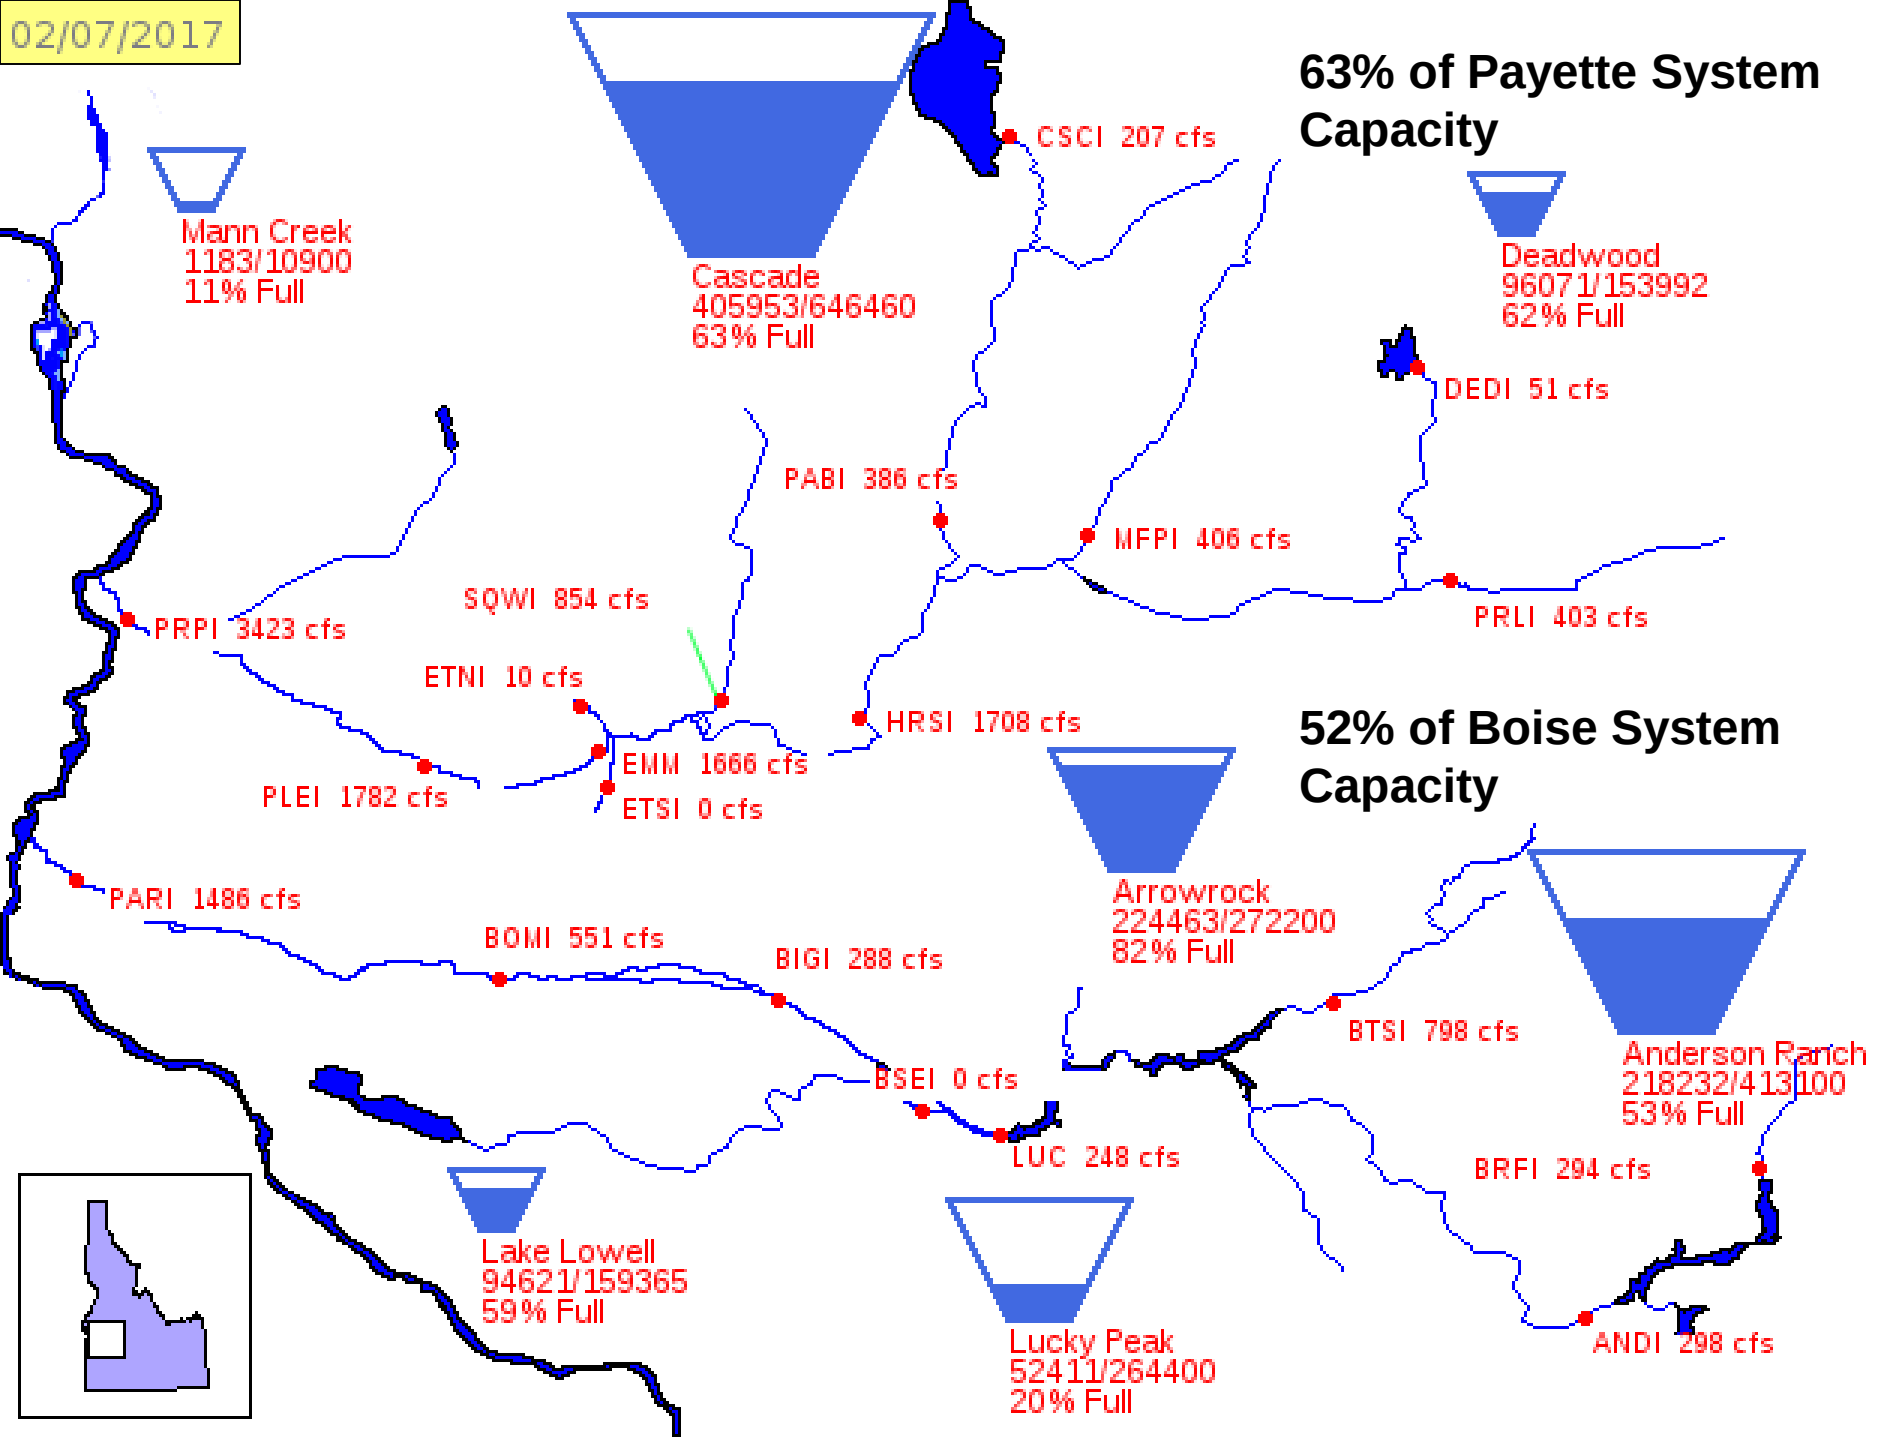

Boise Basin Runoff


February-July

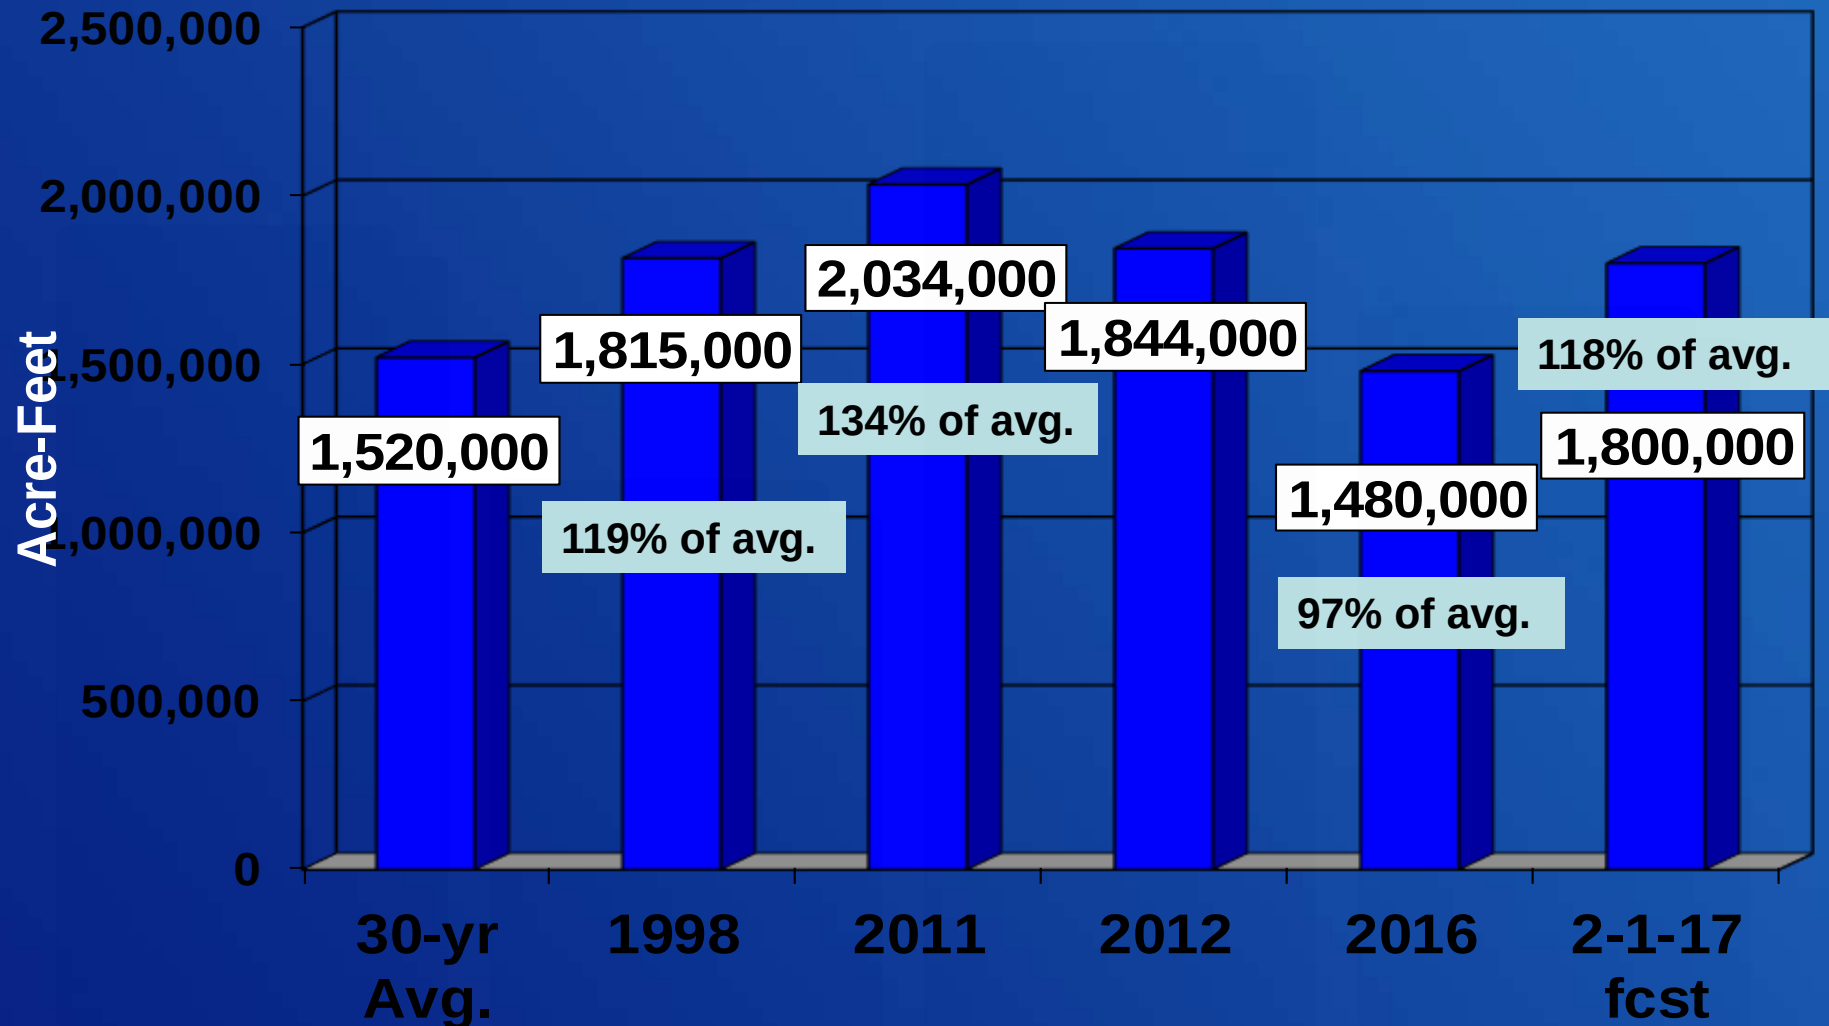

RECLAMATION

Boise Reservoir System Storage
Capacity = 950,000 ac-ft

2017 2016 2012 2011 1998 1999 30yr. Avg.

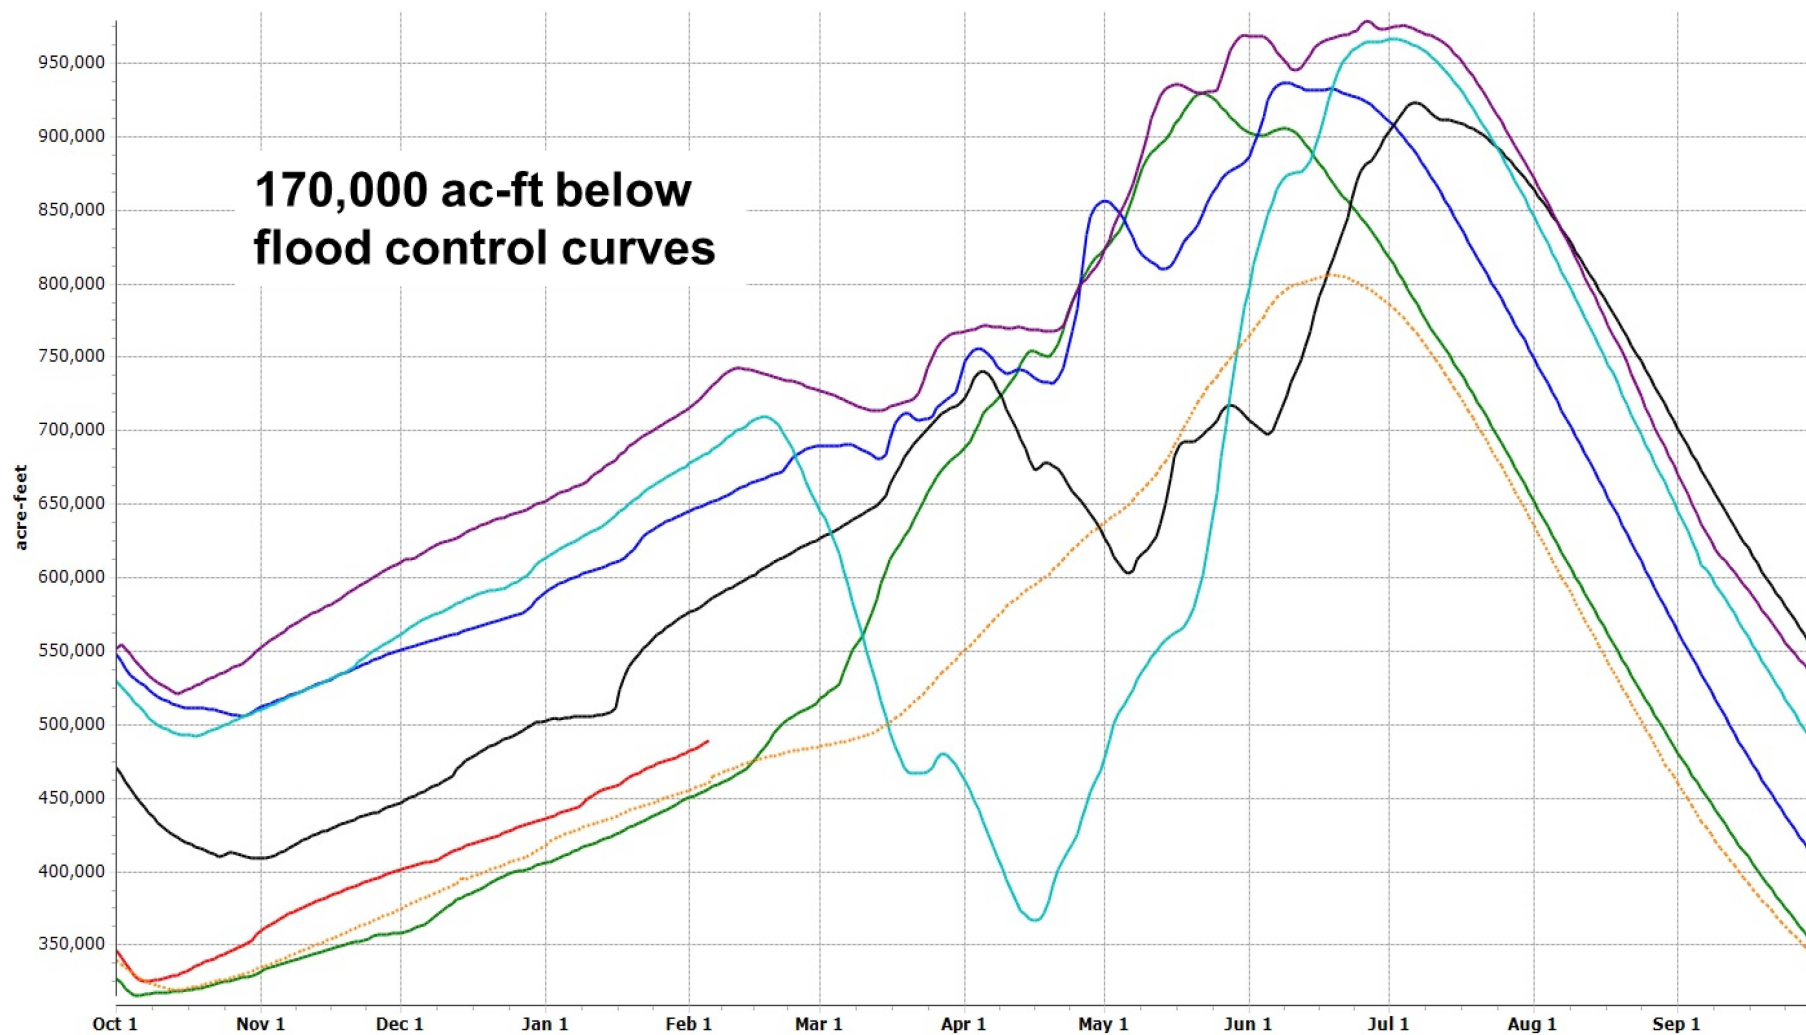


RECLAMATION

Payette Basin



Payette Basin Runoff


February – July

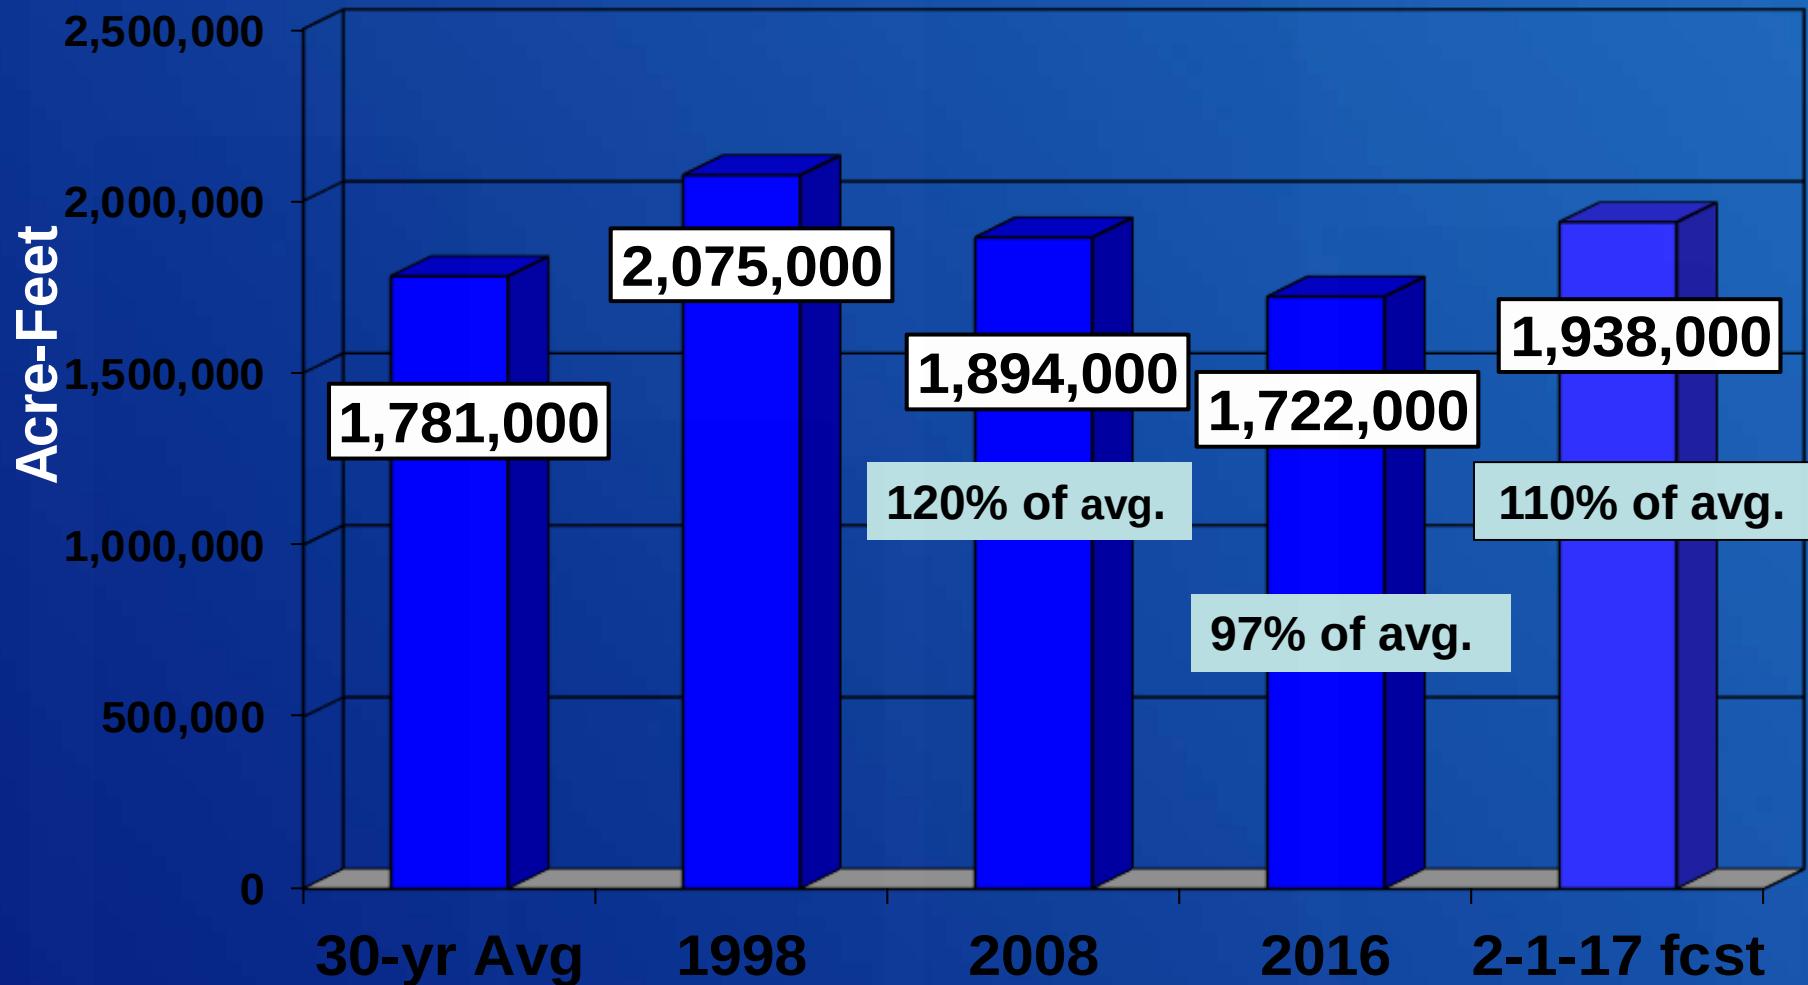

RECLAMATION

Payette System Storage (Cascade + Deadwood)


Total Capacity = 800,000 ac-ft

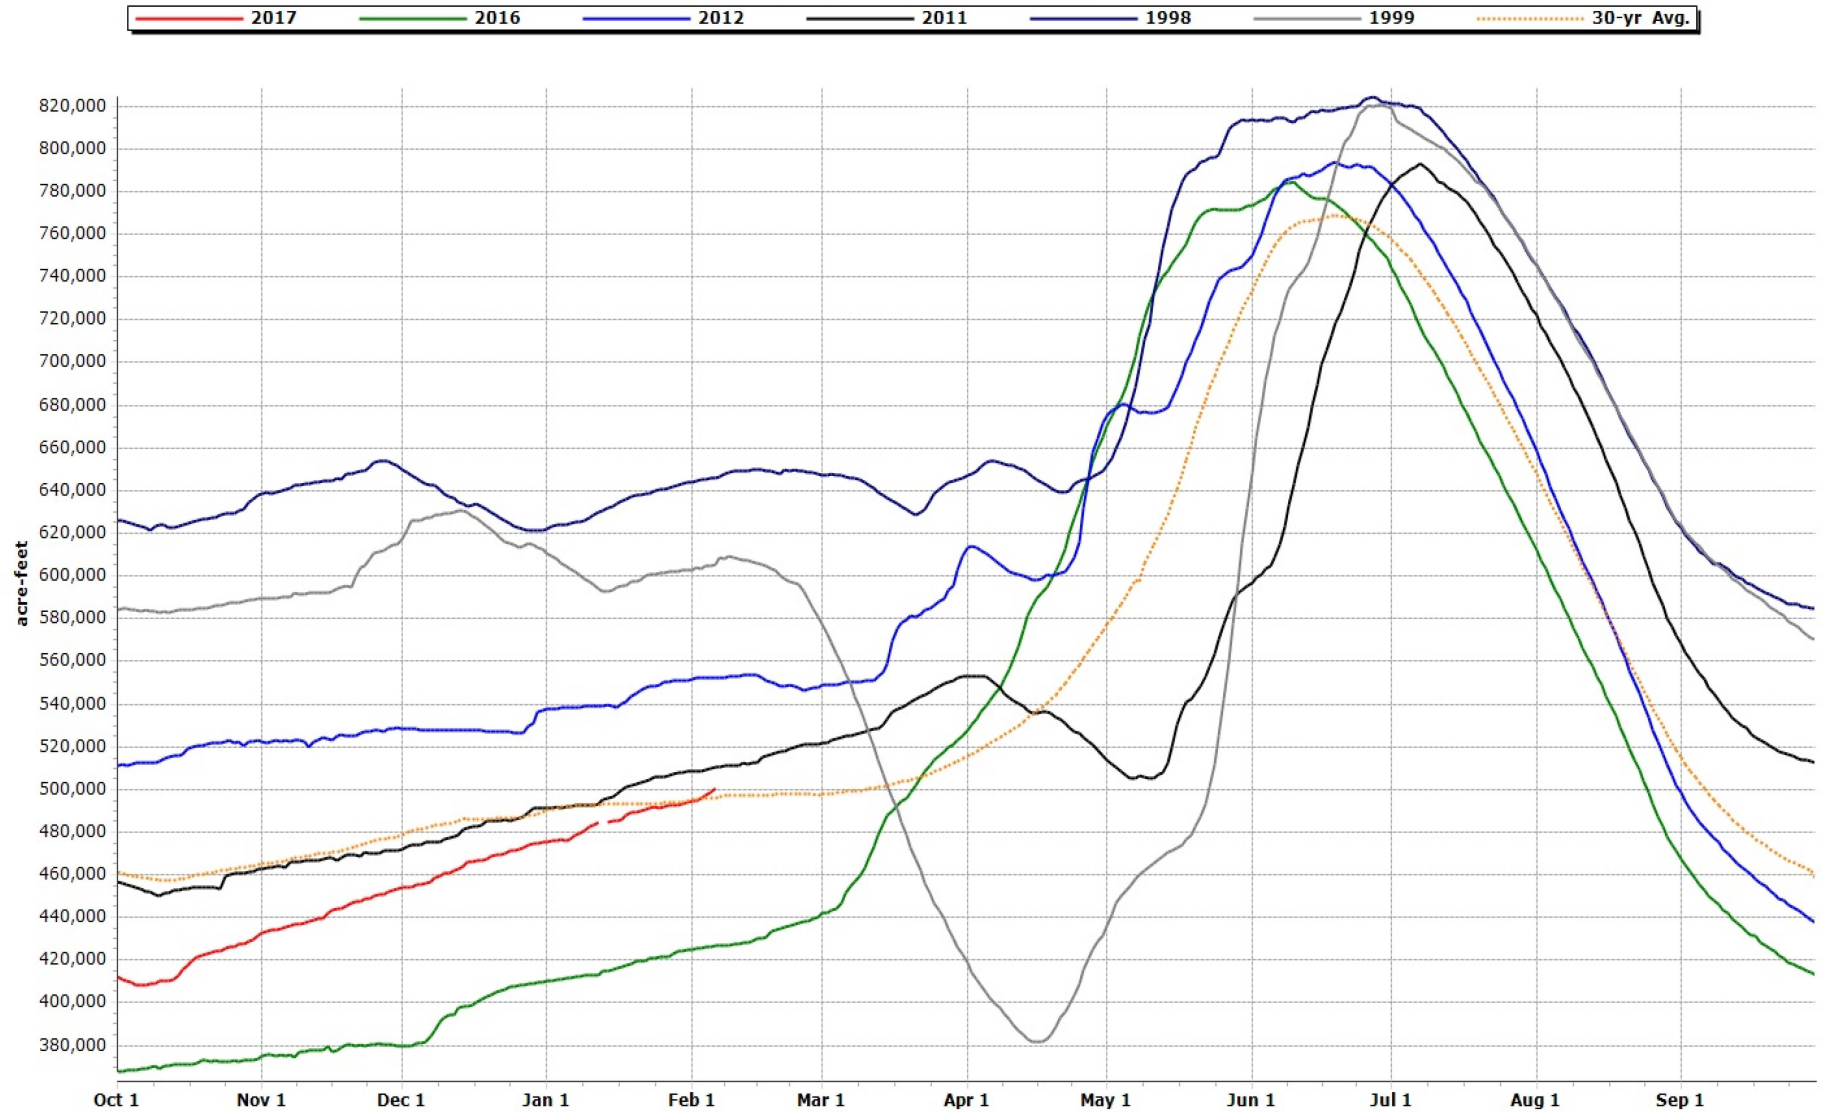

RECLAMATION

Cascade Reservoir Runoff


February – July

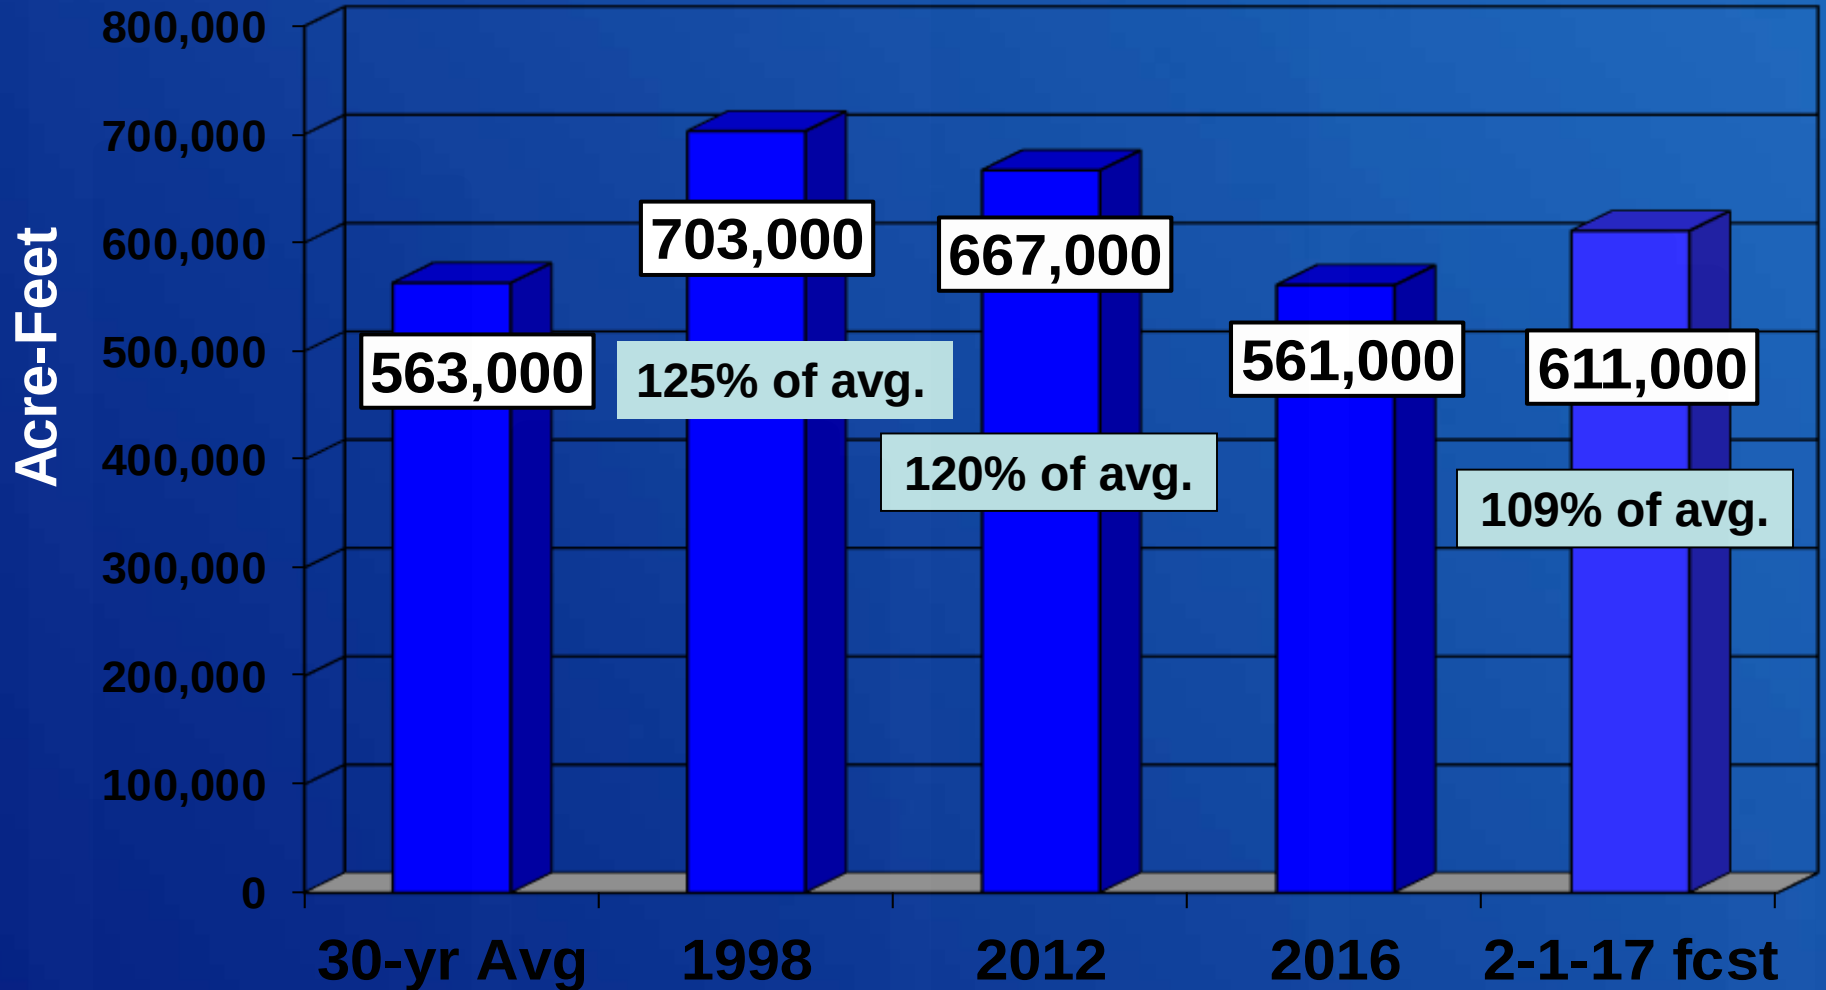

RECLAMATION

Deadwood Reservoir Runoff

February – July

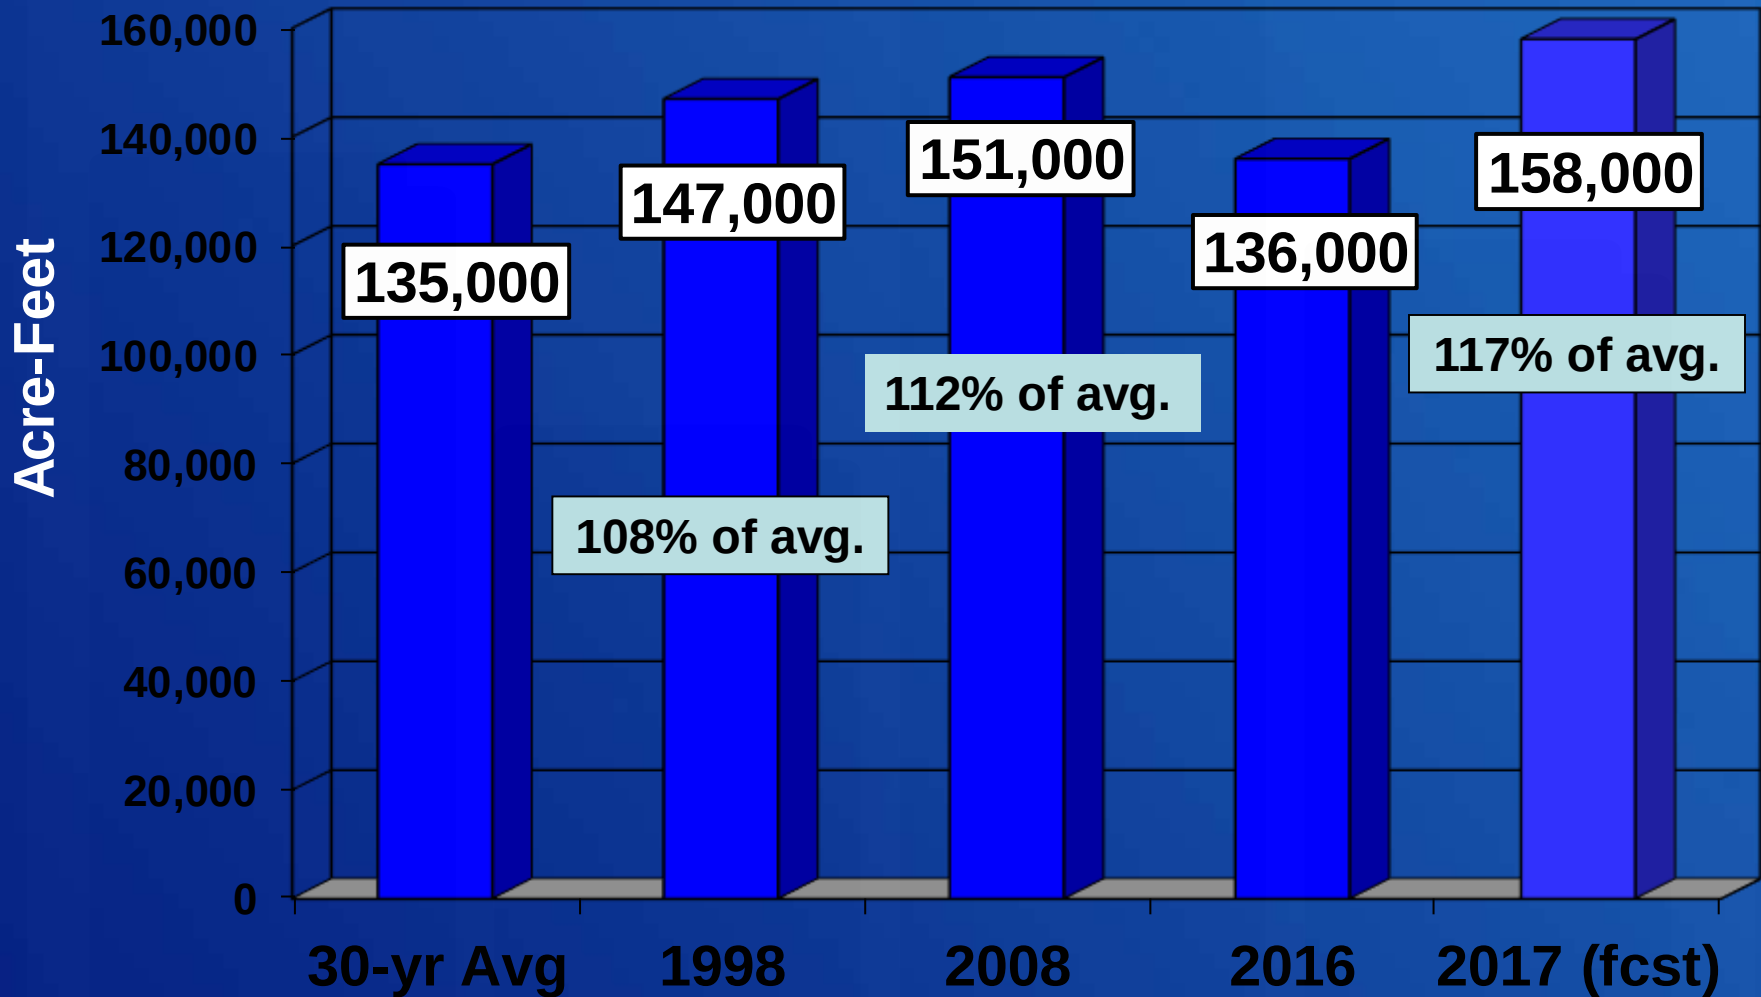



RECLAMATION

Owyhee River Basin





RECLAMATION

02/11/2016

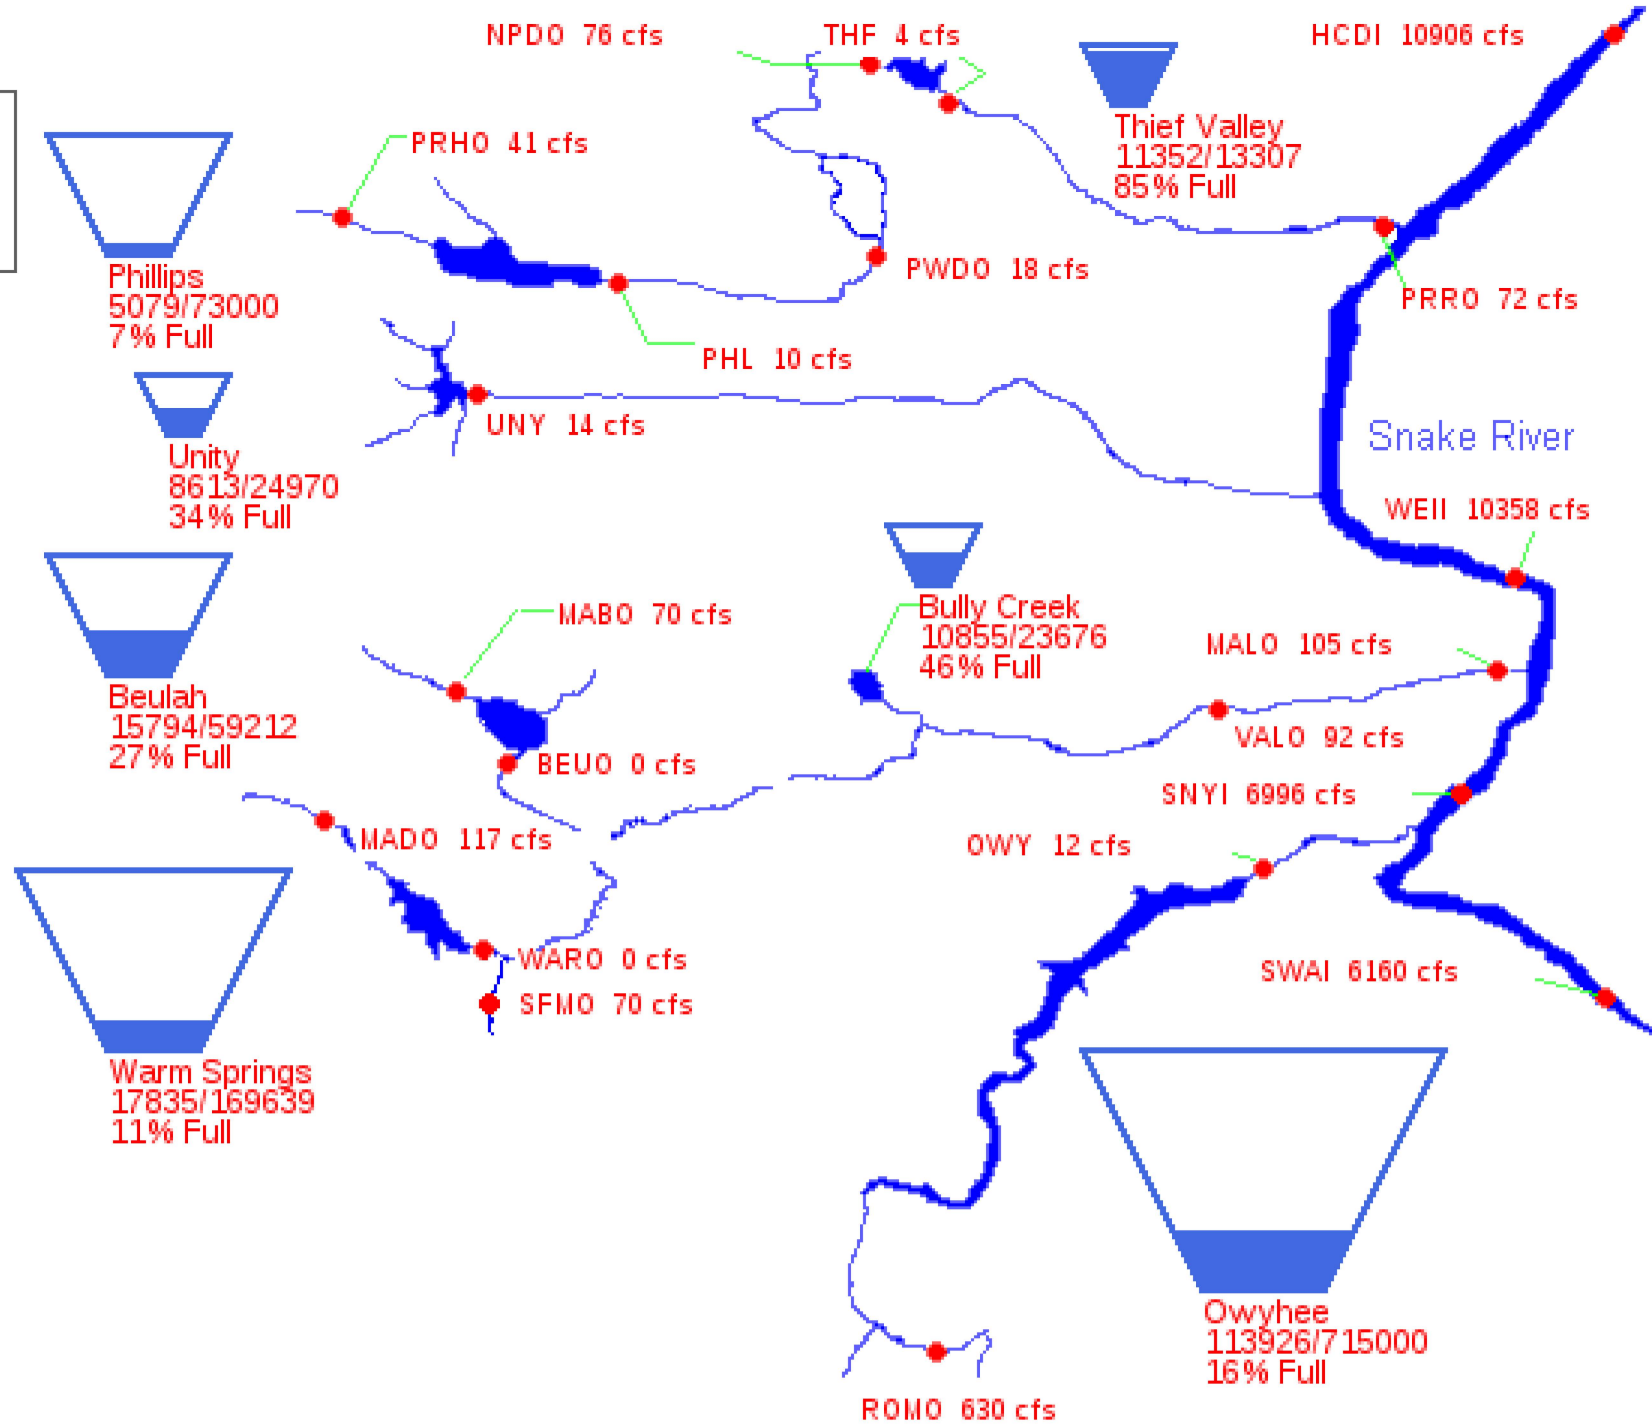


02/07/2017

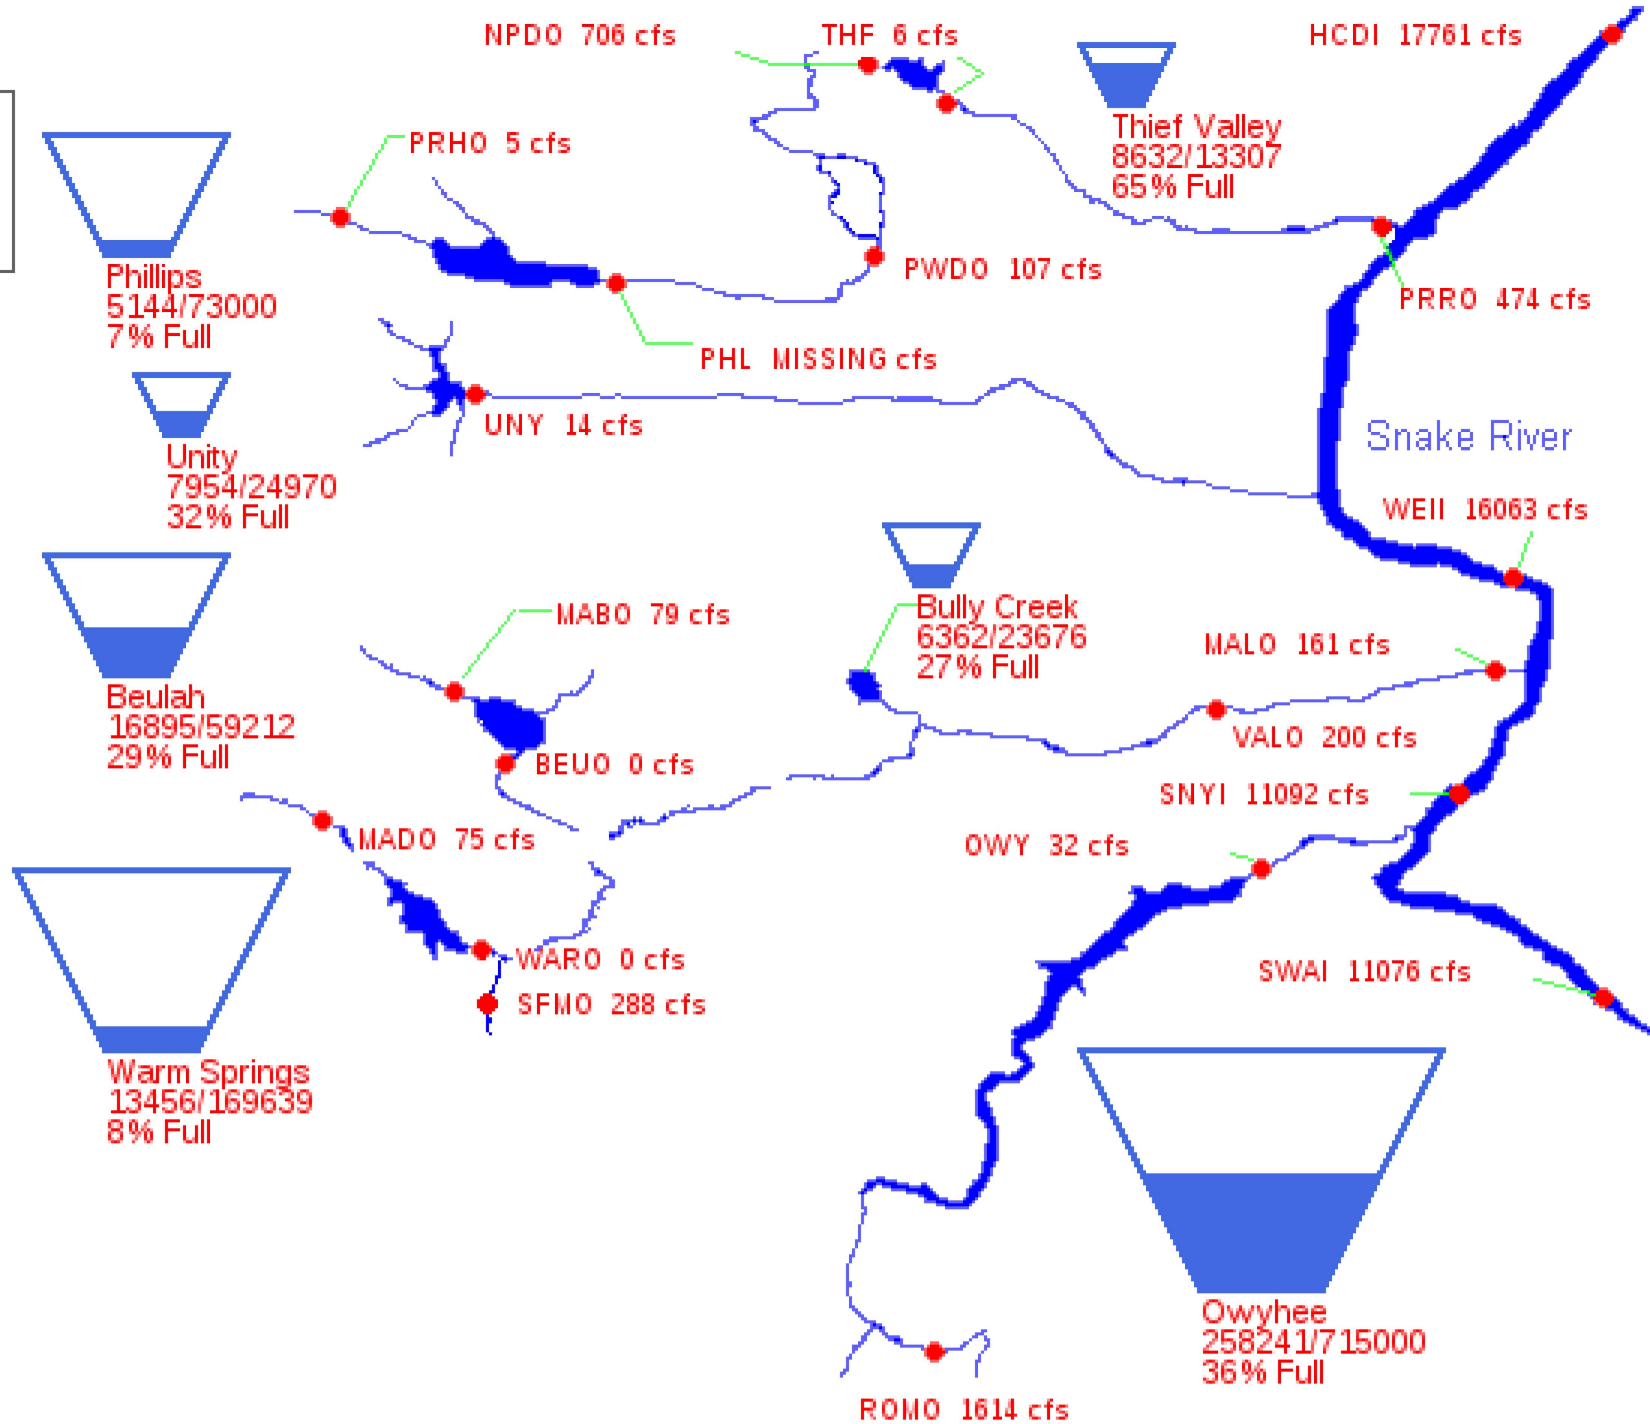


Owyhee Basin Runoff

February – July

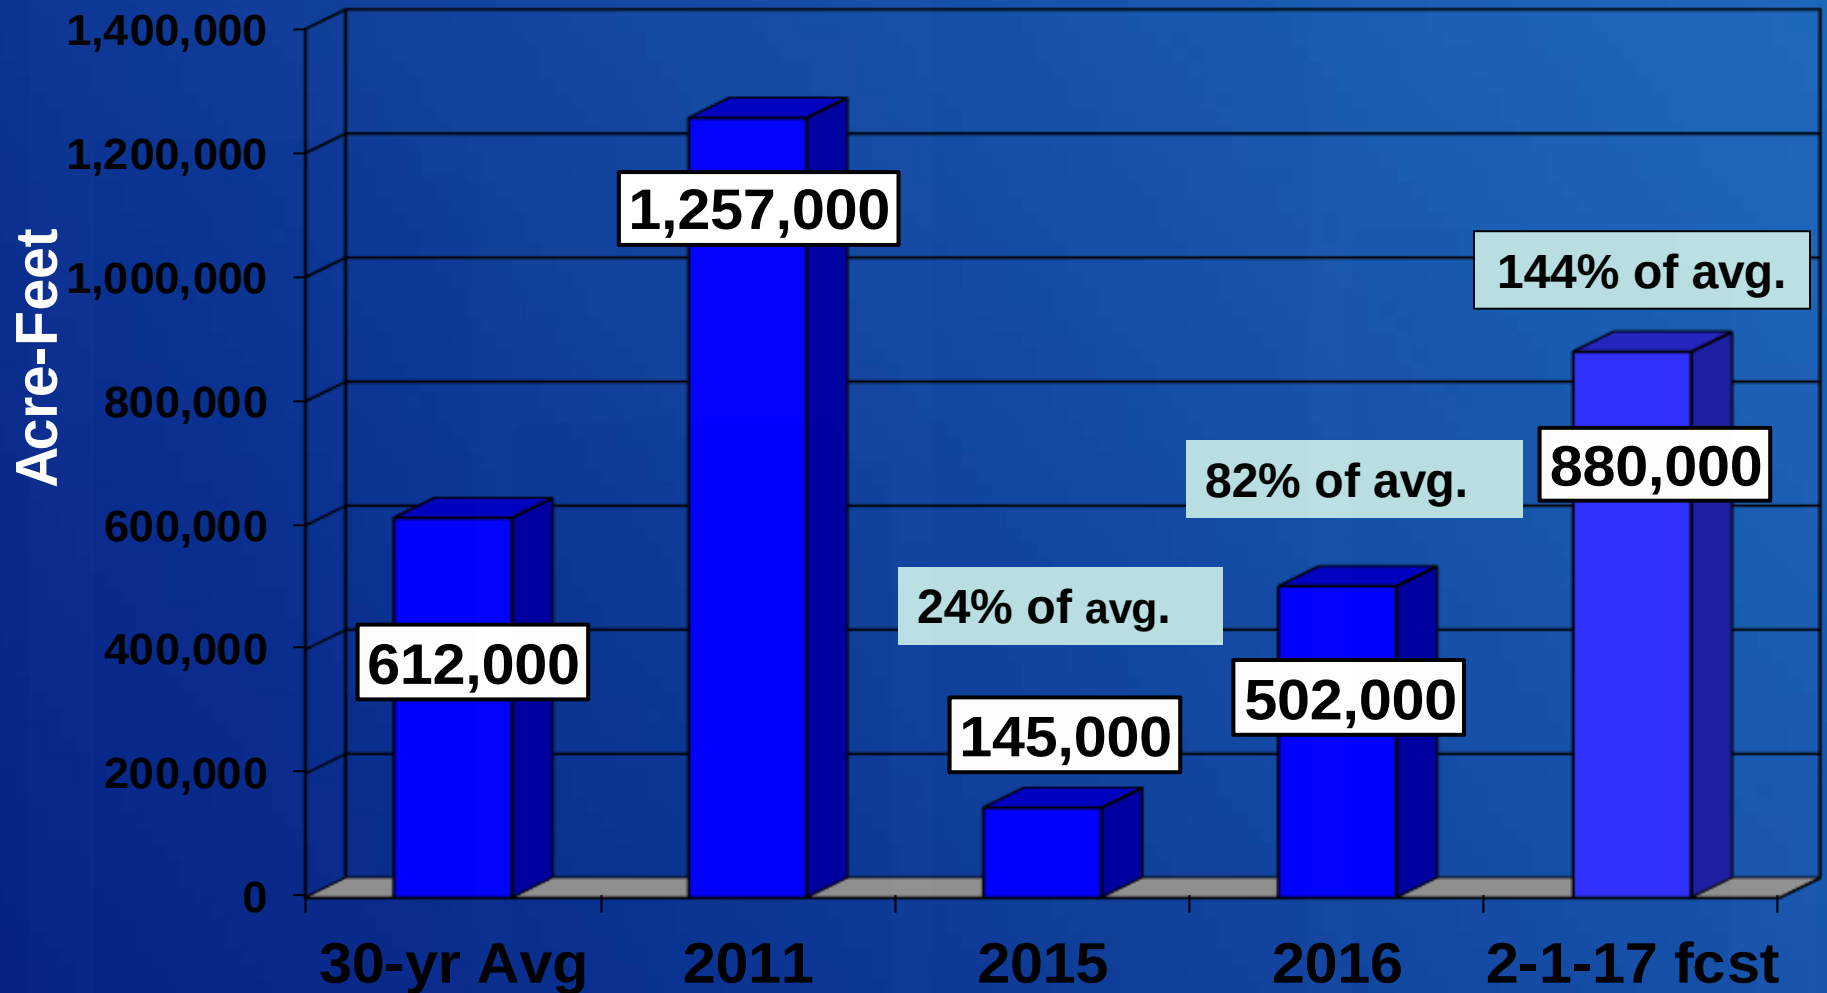

RECLAMATION

Owyhee Reservoir Storage (capacity = 715,000 ac-ft)

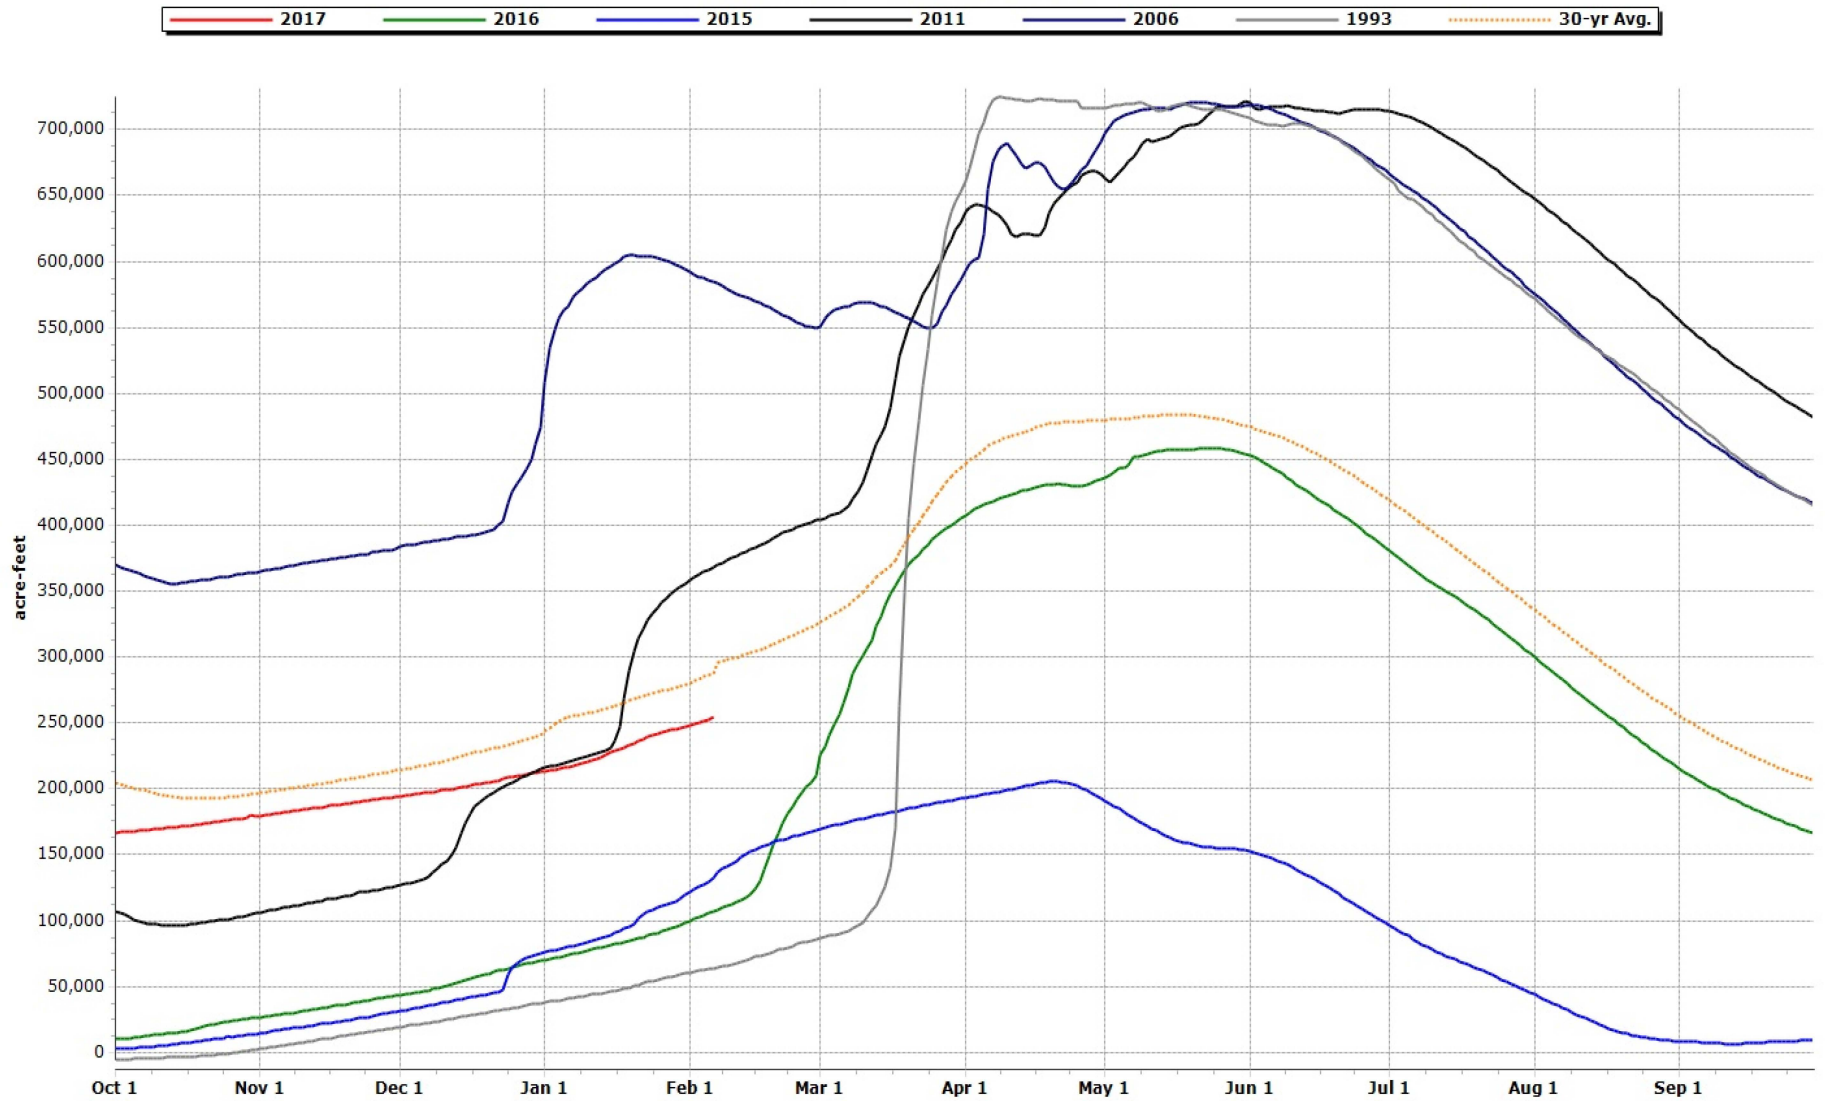

RECLAMATION







RECLAMATION

Deadwood Reservoir



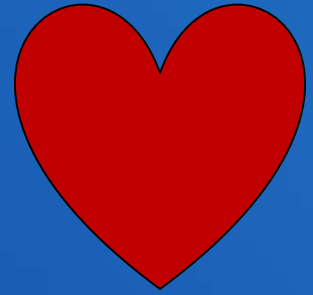


In the U.S., it's estimated that 64 percent of men do not make plans in advance for Valentine's Day.

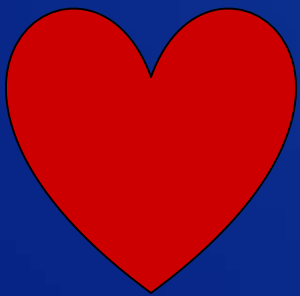

RECLAMATION

RECLAMATION

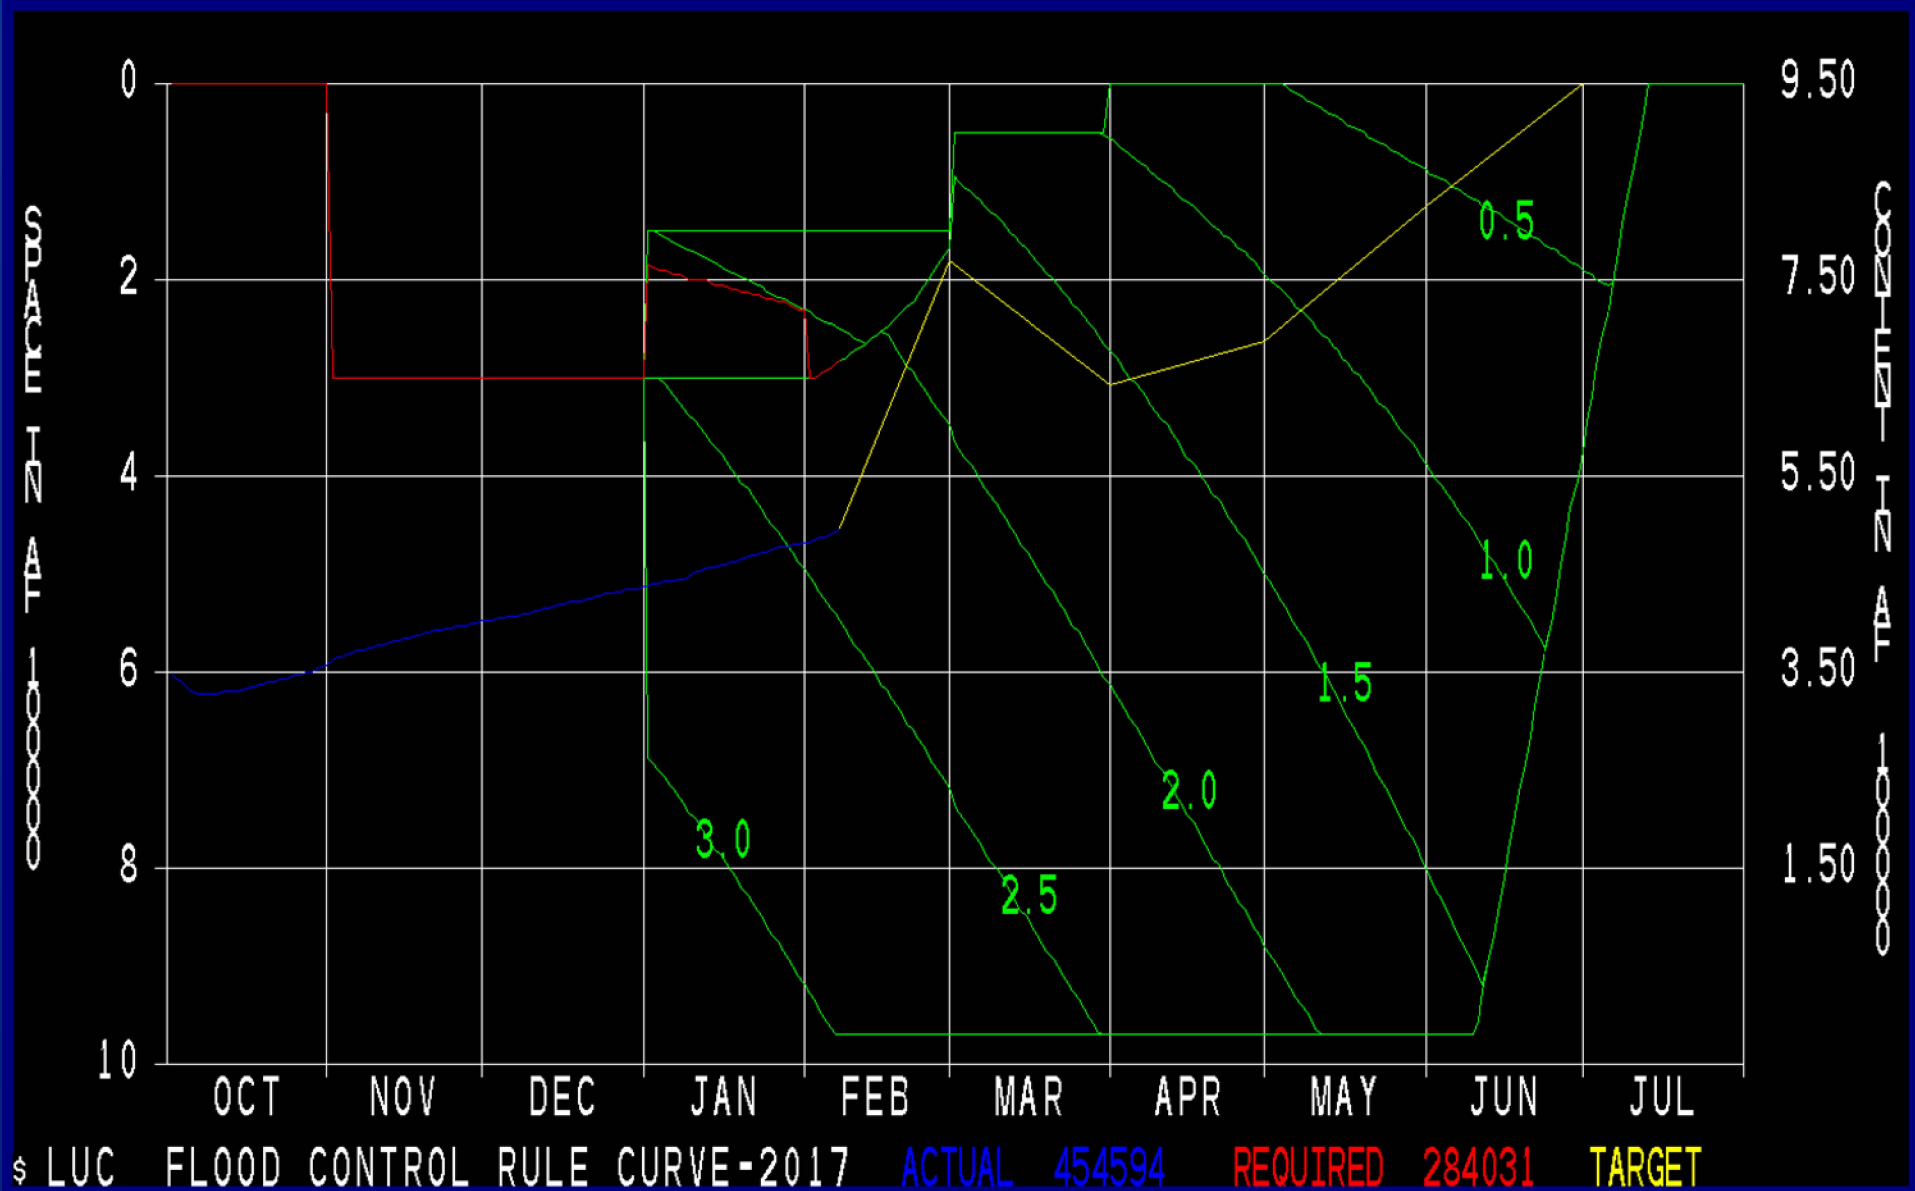

RECLAMATION